

Beaumont Basin Watermaster

2014 Annual Report

FINAL

2014 Watermaster Board

Duane Burk, City of Banning, **Chairman**

George Jorritsma, South Mesa Water Company, **Vice Chairman**

Eric Fraser, Beaumont Cherry Valley Water District, **Secretary**

Joseph Zoba, Yucaipa Valley Water District, **Treasurer**

David Dillon, City of Beaumont

Alvarado Smith, **Legal Counsel**

ALDA Inc. in Association with Thomas Harder & Company, **Engineering**

Rogers, Anderson, Malody, and Scott. LLP, **Financial Auditors**

December 2015

ALDA Inc.

5928 Vineyard Avenue
Alta Loma, CA 91701
Tel: (909) 587-9916
Fax: (909) 498-0423

December 2, 2015

George Jorritsma, Vice Chairman
Beaumont Basin Watermaster
560 Magnolia Avenue
Beaumont, CA 92223

Subject: **Beaumont Basin Watermaster
Final Annual Report for Calendar Year 2014**


Dear Mr. Jorritsma:

ALDA Inc., in association with Thomas Harder & Co. is pleased to submit to you, as Vice Chairman of the Beaumont Basin Watermaster, the Beaumont Basin Watermaster Annual Report for Calendar Year 2014. This final report expands on the earlier format of the Annual Report by incorporating information previously presented in the biannual Engineering Report. As such, this Annual Report summarizes all production, spreading, and storage activities that took place during calendar year 2014. Further, it documents changes in water levels and storage conditions, as well as, an estimate of the Basin Operating Safe Yield for 2014. Finally, the Annual Report presents an evaluation of water quality conditions in the basin for the 2010-2014 five year period.

Should you have any questions on this matter, please contact us at 909-587-9916 during normal business hours.

Very truly yours

ALDA Inc.



F. Anibal Blandon, P.E.
Principal

Table of Contents

Section 1 Background	1-1
1.1 History of the Beaumont Basin Stipulated Judgment	1-1
1.2 Essential Elements of the Judgment	1-2
1.3 Watermaster Responsibilities	1-3
1.4 Watermaster Address	1-4
1.5 Watermaster Website	1-4
1.6 Mission Statement	1-5
Section 2 Watermaster Activities	2-1
2.1 Makeup of the Board	2-1
2.2 Watermaster Accomplishments and Activities During 2014	2-1
2.2.1 Watermaster Meetings	2-1
2.2.2 Watermaster Committee Resolutions	2-2
2.2.3 Items Discussed in 2014	2-2
2.2.4 Redetermination of Safe Yield	2-4
2.3 Storage Applications and Agreements	2-4
2.4 Rules and Regulations	2-5
2.5 Active Party List	2-6
2.6 Financial Management	2-6
2.6.1 Budget	2-6
2.6.2 Financial Audit	2-7
Section 3 Status of the Basin and Administration of the Judgment	3-1
3.1 Climate, Hydrology and Hydrogeology	3-1
3.1.1 Climate	3-1
3.1.2 Surface Water Hydrology	3-2
3.1.3 Hydrogeology	3-2
3.1.3.1 <i>Regional Geologic Context</i>	3-2
3.1.3.2 <i>Faults</i>	3-2
3.1.3.3 <i>Groundwater Occurrence and Flow</i>	3-2
3.2 Production	3-3
3.2.1 Appropriative Party Production	3-3
3.2.2 Overlying Party Production	3-4
3.2.3 2003-2014 Annual Production Summary	3-5
3.3 Groundwater Recharge	3-5
3.3.1 State Water Project Water Recharge	3-6
3.3.2 Recycled Water Recharge	3-7
3.3.3 New Yield Stormwater Recharge	3-7
3.4 Water Transfers and Adjustments of Rights	3-7
3.4.1 Transfers between Appropriators	3-8

3.4.2	Transfers of Overlying Rights for Service by an Appropriator	3-8
3.4.3	Allocation of Unused Overlying Water.....	3-9
3.5	Storage Accounting	3-9
3.5.1	Annual Storage Consolidation.....	3-10
3.6	Changes in Groundwater Levels in the Beaumont Basin	3-10
3.6.1	Analysis of Groundwater Level Changes	3-10
3.6.2	Analysis of Change in Groundwater Storage	3-11
3.7	Operating Safe Yield	3-11
3.8	Recommendations	3-13
Section 4 Water Quality Conditions		4-1
4.1	Comparison with Management Zone Objectives.....	4-1
4.1.1	Total Dissolved Solids	4-1
4.1.2	Nitrate-Nitrogen.....	4-2
4.1.3	Nitrate Studies in the Beaumont Management Zone	4-2
4.2	Comparison with Federal and State Drinking Water Standards	4-5
4.2.1	Trace Metals.....	4-6
4.2.3	pH	4-8
4.2.4	Turbidity.....	4-8
Section 5 Land Subsidence		5-1

List of Figures

Figure 3-1	Historical Precipitation (1914-2013) at Beaumont Station 013.....	3-15
Figure 3-2	Geology of the Beaumont Basin.....	3-16
Figure 3-3	Appropriator and Overlyer Wells in the Beaumont Basin	3-17
Figure 3-4	Annual Groundwater Production in the Beaumont Basin (2003-14)	3-18
Figure 3-5	Groundwater Elevation Contours in the Beaumont Basin – Fall 2013	3-19
Figure 3-6	Groundwater Elevation Contours in the Beaumont Basin – Fall 2014	3-20
Figure 3-7	Change in Groundwater Elevation - 2013-2014	3-21
Figure 3-8	Groundwater Level Trends at Key Wells.....	3-22
Figure 4-1	Wells with Water Quality Data in the Beaumont Basin.....	4-9
Figure 4-2	Total Dissolved Solids in Groundwater (Max Concentrations 2010-14).....	4-10
Figure 4-3	Nitrate as N in Groundwater (Max Concentrations 2010-14)	4-11

List of Tables

Table 3-1	Appropriator Producer Summary of Annual Production (2003-09).....	3-23
Table 3-1A	Appropriator Producer Production Summary for CY 2010	3-24
Table 3-1B	Appropriator Producer Production Summary for CY 2011	3-25
Table 3-1C	Appropriator Producer Production Summary for CY 2012	3-26
Table 3-1D	Appropriator Producer Production Summary for CY 2013	3-27
Table 3-1E	Appropriator Producer Production Summary for CY 2014	3-28
Table 3-2A	Overlying Producer Production Summary for CY 2003.....	3-29
Table 3-2B	Overlying Producer Production Summary for CY 2004.....	3-30
Table 3-2C	Overlying Producer Production Summary for CY 2005.....	3-31
Table 3-2D	Overlying Producer Production Summary for CY 2006.....	3-32
Table 3-2E	Overlying Producer Production Summary for CY 2007.....	3-33
Table 3-2F	Overlying Producer Production Summary for CY 2008.....	3-34
Table 3-2G	Overlying Producer Production Summary for CY 2009.....	3-35
Table 3-2H	Overlying Producer Production Summary for CY 2010.....	3-36

Table 3-2I	Overlying Producer Production Summary for CY 2011	3-37
Table 3-2J	Overlying Producer Production Summary for CY 2012	3-38
Table 3-2K	Overlying Producer Production Summary for CY 2013	3-39
Table 3-2L	Overlying Producer Production Summary for CY 2014	3-40
Table 3-3	Production Summary for Appropriator and Overlying Producers in the Beaumont Basin for Calendar Year 2013.....	3-41
Table 3-4	Annual Supplemental Recharge to the Beaumont Basin: Calendar Years 2003 through 2013	3-42
Table 3-5	City of Beaumont Recycled Water Deliveries to DP-001 and DP-007	3-43
Table 3-6	Overlying Parties Production Rights Allocation Based on Revised Safe Yield.	3-44
Table 3-7	Summary of Unused Overlying Water: Calendar Years 2003 through 2013....	3-45
Table 3-8	Allocation of Unused Overlying Water: Calendar Years 2008 through 2018....	3-45
Table 3-9	Consolidation of Appropriator Production and Storage Accounts - Calendar Years 2003 through 2013	3-46

Appendices

- Appendix A Active and Interested Party List
- Appendix B FY 2013-14 Audit Letter
- Appendix C Production Estimation Methods for Unmetered Overlying Producers
- Appendix D Water Quality Analysis Summary (2010-2014) for Drinking Water Production Wells

Abbreviations

ac-ft	acre-feet
ac-ft/yr	acre-feet per year
Banning	City of Banning
Basin	Beaumont Basin
BCVWD	Beaumont-Cherry Valley Water District
BMZ	Beaumont Management Zone
Beaumont	City of Beaumont
CDPH	California Department of Public Health
CVCOI	Cherry Valley Community of Interest
CY	calendar year
du	dwelling unit
FY	fiscal year
IRWMP	Integrated Regional Water Management Program
MCL	Maximum Contaminant Level
NL	Notification Level
NTU	Nephelometric Turbidity Units
OSWDS	On-Site Waste Disposal Systems
Pass Agency	San Geronio Pass Water Agency
PPCPs	Pharmaceutical and Personal Care Products
SMWC	South Mesa Water Company
STWMA	San Timoteo Watershed Management Authority
STWMP	San Timoteo Watershed Management Program
SWP	State Water Project
TDS	Total Dissolved Solids
UCR	University of California, Riverside
USEPA	United States Environmental Protection Agency
Watermaster	Beaumont Basin Watermaster Committee
WEI	Wildermuth Environmental Inc.
YVWD	Yucaipa Valley Water District

Section 1

Background

The Eleventh Annual Report of the Beaumont Basin Watermaster Committee (Watermaster) consolidates the information about the basin previously presented in Annual Reports with the information presented in the bi-annual Engineer's Report. This report documents activities in the Beaumont Basin for Calendar Year 2014. Section 3 of the original annual report has been expanded and retitled as "Status of the Basin" to document the Administration of the Judgment as well as to provide an status of conditions in the basin addressing water production, water levels, and storage activities. In addition, a Water Quality section, Section 4, has been added to document historical water quality of selected compounds at selected wells, as well as, basin wide concentrations.

1.1 History of the Beaumont Basin Stipulated Judgment

In January 2001, the City of Beaumont (Beaumont), the Beaumont-Cherry Valley Water District (BCVWD), the South Mesa Water Company (SMWC), and the Yucaipa Valley Water District (YVWD) formed the San Timoteo Watershed Management Authority (STWMA). One of the initial tasks of STWMA was to develop a watershed-wide program to develop and implement a comprehensive management program for the San Timoteo watershed.

Phase I of the management program, documented in the San Timoteo Watershed Management Program, Phase I Report (WEI, 2002), included the following goals:

- Enhancing water supplies
- Protecting and enhancing water quality
- Optimizing the management of STWMA area groundwater basins
- Protecting riparian habitat in San Timoteo Creek and protecting/enhancing habitat in the STWMA area
- Equitably distributing the benefits and costs of developing the Integrated Regional Watershed Management Program for the San Timoteo watershed

One of the elements identified in the management plan to achieve the listed goals consisted in the establishment of a groundwater management entity for the Beaumont Basin. As a result of this initiative, two groups representing overlying users and water agencies with interest in this basin began negotiations in May 2002.

Over the next 18 months of negotiations, a Stipulated Agreement was developed and submitted to the Court. Honorable Judge Gary Tranbarger of the Superior Court of the State of California for the County of Riverside signed the Agreement, titled "San Timoteo Watershed Management Authority, vs. City of Banning, et al." (Case No. RIC 389197), on February 4, 2004, (the Judgment).

Pursuant to the Judgment, the Court appointed a five-member Watermaster Committee, consisting of representatives from each of the Appropriator parties: the City of Banning,

Beaumont, BCVWD, SMWC, and YVWD. The effective date of the Judgment for accounting purposes was retroactively established to July 1, 2003.

The Court gave the responsibility of managing the Basin to the Watermaster by approving the Stipulated Agreement but retained continuing jurisdiction should there be any future need to resolve difficult questions among the Parties.

1.2 Essential Elements of the Judgment

Elements of the 2004 Judgment are as follows:

- All producers shall be allowed to pump sufficient water from the Basin to meet their respective requirements.
- The Safe Yield of the Basin was established at 8,650 ac-ft/yr to be distributed among the Overlying Producers. The Safe Yield of the Basin is to be re-evaluated every 10 years, at a minimum.
- The Overlying Parties can extract a combined total of 8,650 ac-ft/yr. with individual rights set for each Overlying Producer. If an Overlying Party pumps more than five times its share of the operating safe yield in any five consecutive years, the overlying producer shall provide Watermaster with sufficient funds to replace the overproduction.
- A controlled overdraft of the basin is allowed to create enough additional storage capacity to prevent the waste of water. This controlled overdraft, also known as Temporary Surplus, allows Appropriators to extract up to 160,000 ac-ft of water from the basin over the 10-year period immediately following the Judgment inception. The Temporary Surplus will cease after the initial 10 years of operations.
- During the first ten years after adoption of the Judgment, the Appropriators have the right to extract, as a whole, a maximum of 16,000 ac-ft/yr not including storage credits from spreading supplemental water or transfers from Overlying Parties. The Temporary Surplus has been divided among the Appropriators as follows:

✓ Beaumont Cherry Valley WD	42.51 percent or 6,802 ac-ft/yr
✓ City of Banning	31.43 percent or 5,029 ac-ft/yr
✓ South Mesa Water Company	12.48 percent or 1,997 ac-ft/yr
✓ Yucaipa Valley Water District	13.58 or 2,173 ac-ft/yr
- After the first 10 years of operation, Appropriators can extract only the amount each has in storage or credited to them. An Appropriator shall provide Watermaster with sufficient funds to replace any amount of overproduction that may have occurred over a five-year consecutive period.
- The Watermaster has the authority to enter into Groundwater Storage Agreements with producers for the storage of supplemental water, wellhead protection and recharge, well abandonment, well construction, monitoring, replenishment, mitigation of overdraft, and collection of assessments.

- Supplemental replenishment water can be in the form of recycled water, imported State Project Water, or other imported water. Replenishment can be accomplished by spreading and percolation, injection, or in-lieu use of surface water or imported water.
- A minimum of 200,000 ac-ft of groundwater storage capacity shall be reserved for conjunctive use. Any person, party to the Judgment can make reasonable beneficial use of the groundwater storage capacity for storage of supplemental water provided that it is in accordance with a storage agreement with Watermaster.
- Minimal producers, those producing less than 10 ac-ft/yr from the basin, and not listed in the Judgment, are exempt from the provisions of the Judgment.

1.3 Watermaster Responsibilities

Under the Judgment, the Watermaster is granted discretionary powers to develop and implement a groundwater management plan for the Beaumont Basin, including water quality and quantity considerations and being reflective of the provisions of the Judgment.

In carrying out its duties, Watermaster is responsible for providing the legal and practical means of ensuring that the waters of the Basin are put to maximum beneficial use. Specific responsibilities are summarized below.

1.- Administer the Beaumont Basin Judgment. Watermaster operates under the Judgment and the Rules and Regulations, which were originally adopted June 8, 2004, and subsequently amended in 2006 and 2008. The Judgment and the Rules and Regulations establish the procedures by which Watermaster accounts for the water resources of the Basin. Watermaster has the power to collect administrative assessments from all Appropriators and replenishment assessments from those parties (Appropriative and Overlying) pumping in excess of their pumping right to fund its operations. Each year, Watermaster publishes an Annual Report, which documents production and recharge activities in the Beaumont Basin.

2.- Approve Producer Activities. All producers must notify and obtain approval, as necessary, from Watermaster for activities, such as recharging water, transferring or exchanging water, storing local water, and storing or recovering supplemental water.

3.- Maintain and Improve Water Supply. On an annual basis, Watermaster determines the amount of groundwater that each producer is entitled to pump from the Basin without incurring a replenishment obligation. Further, Watermaster is responsible for facilitating and coordinating the acquisition, recharge, and storage of imported water or other local supplemental water to replenish and/or conjunctively manage the Basin to increase local supplies.

4.- Monitor and Understand the Basin. Watermaster is responsible for collecting information from producers, and other cooperating agencies, in order to enhance its knowledge of how the Basin works and manage it more effectively. Information collected by the Watermaster includes:

- Water production, water level, and water quality information from the Appropriator Parties.
- Water production and water level information from the Overlying Parties.

- Water level and water quality data from the City of Beaumont, collected by the city as part of their Maximum Benefit and Monitoring Program.
- Ground surface elevations from periodic surveys conducted to determine whether ground subsidence may be occurring as a result of over pumping from the basin.

5.- Maintain and Improve Water Quality. Watermaster coordinates and participates in local efforts to preserve and/or enhance the quality of groundwater in the Basin. It assists and encourages regulatory agencies to enforce water quality regulations that may have an effect on the Basin groundwater sources and its surrounding resources. One of these programs is the Maximum Benefit Monitoring Program of the Beaumont Management Zone.

6.- Develop and Administer a Well Policy. Watermaster is responsible for developing a policy on the proper construction and abandonment of wells in the Basin. Through the adoption of Resolution 2004-04, the Watermaster adopted minimum standards for the construction, repair, abandonment and destruction of groundwater extraction wells in the Beaumont Basin. As part of this resolution, Watermaster adopted Riverside County Ordinance No. 682.3 and expanded it to require the installation of a sounding tube in order to facilitate the measurement of water levels on all future wells.

7.- Develop Contracts for Beneficial Programs and Services. Watermaster is responsible for developing and entering into contracts for programs and services that are beneficial to the Basin on behalf of the Parties to the Judgment. This includes programs for conjunctively utilizing the Basin for the storage of supplemental water with other agencies and programs to implement and expand the direct or indirect use of recycled water.

8.- Provide Cooperative Leadership. Watermaster may act jointly or cooperate with other local, state, and/or federal agencies to develop and implement regional scale programs for the management of the Basin and its surrounding resources.

1.4 Watermaster Address

For the purposes of conducting Watermaster business and maintaining records, Watermaster's official address remains as follows:

Office of the Watermaster Secretary
C/O Beaumont-Cherry Valley Water District
560 Magnolia Avenue
Beaumont, CA 92223

1.5 Watermaster Website

Watermaster website address is www.beaumontbasinwatermaster.org. This website is maintained by the YVWD and it is used by the Watermaster to communicate its activities to the Parties and the public. The website contains copies of the Judgment, the Rules and Regulations, Annual Reports, and Engineer's Reports. In addition, it contains meeting minutes, meeting agendas, and other documents of interest.

1.6 Mission Statement

Watermaster adopted the following mission statement in October 2004:

“Watermaster’s mission is to manage the yield of and storage within the Beaumont Basin to provide maximum benefit to the people dependent on it.”

Section 2

Watermaster Activities

2.1 Makeup of the Board

During the December 4, 2013 regular meeting of the Beaumont Basin Watermaster, elections were held; the following officers to the Watermaster Committee were appointed:

- Mr. Duane Burk – Chairman
- Mr. George Jorritsma – Vice Chairman
- Mr. Eric Fraser – Secretary
- Mr. Joseph Zoba – Treasurer

The Committee Representatives serving each Appropriator Party during CY 2014 were as follows:

- City of Banning - Duane Burk, Director of Public Works
- City of Beaumont – Kyle Warsinski, as an alternate member
- Beaumont-Cherry Valley Water District – Eric Fraser, General Manager
- South Mesa Water Company - George Jorritsma, General Manager
- Yucaipa Valley Water District - Joseph B. Zoba, General Manager

Legal counsel during CY 2014 was provided by Alvarado Smith APC, represented by Keith McCullough and Thierry Montoya, while Engineering Services were provided by ALDA Inc., represented by Hannibal Blandon, in association with Thomas Harder & Company, represented by Thomas Harder.

2.2 Watermaster Accomplishments and Activities During 2014

2.2.1 Watermaster Meetings

A total of nine meetings were held during CY 2014, six regular meetings and three special project meetings, on the following dates:

- February 5, 2014
- May 7, 2014 – Special Project
- August 6, 2014
- October 15, 2014 – Special Project
- December 3, 2014
- April 3, 2014
- June 4, 2014
- October 1, 2014
- October 29, 2014 – Special Project

Agendas and approved minutes from each of the above meetings can be viewed at and/or downloaded from Watermaster's website or by making a request to the Watermaster Secretary. Pursuant to Resolution 2009-001, all of Watermaster's public records are open for inspection during office hours, provided that a written request to inspect said records has been submitted.

2.2.2 Watermaster Committee Resolutions

There were no resolutions considered or approved during Calendar Year 2014.

2.2.3 Items Discussed in 2014

This section is simply an unofficial summary of topics addressed at Watermaster meetings. The Beaumont Basin Watermaster maintains official meeting minutes that report the items discussed and actions taken during normal and special meetings. Official meeting minutes may be accessed at: www.beaumontbasinwatermaster.org

The following items were discussed during the nine meetings held in CY 2014 along with their resulting outcome.

Items Discussed During the February 5, 2014 Regular Watermaster Committee Meeting

- Status Report on the Beaumont Basin Groundwater Model and Redetermination of Safe Yield. [Memorandum 14-01]. An overview of the hydraulic model and preliminary results of the safe yield analysis was provided.

Items Discussed During the April 3, 2014 Regular Watermaster Committee Meeting

- Status Report on the Beaumont Basin Groundwater Model and Redetermination of Safe Yield. [Memorandum 14-02]. A status report was presented, questions answered, and feedback from the Committee members provided.

Items Discussed During the May 7, 2014 Special Project Committee Meeting

- Status Report on the Beaumont Basin Groundwater Model and Redetermination of Safe Yield. [Memorandum 14-03]. A brief update was provided. In addition, the Watermaster Committee approved and authorized \$11,720 for additional analyses under Tasks 1 through 3, in support of finalizing the safe yield of the Beaumont Basin.

Items Discussed During the June 4, 2014 Regular Watermaster Committee Meeting

- Proposed Budget for Fiscal Year 2014-15 [Memorandum 14-04]. An amended budget for Fiscal Year 2013-14 was presented and the proposed budget for Fiscal Year 2014-15 was discussed. Motion was approved to amend the 2013-14 budget and to adopt the 2014-15 budget.
- Status Report on the Beaumont Basin Groundwater Model and Redetermination of Safe Yield. [Memorandum 14-05]. Mr. Blandon and Mr. Harder provided an overview of the report and items of the report were discussed by the Committee.

Items Discussed During the August 6, 2014 Regular Watermaster Committee Meeting

- Beaumont Basin Watermaster Report of Water Conservation Activities by Individual Agencies [Memorandum No. 14-06].
- Presentation of the Draft 2013 Consolidated Annual Report and Engineering Report [Memorandum No. 14-07]. A presentation on the various aspects of the annual report was made by Mr. Blandon (ALDA Inc.) and comments requested.
- Status Report on the Beaumont Basin Groundwater Model and Redetermination of Safe Yield. [Memorandum 14-08]. A brief update was provided.

Items Discussed During the October 1, 2014 Regular Watermaster Committee Meeting

- Overview of the 2013 Consolidated Annual Report and Engineering Report [Memorandum 14-09]. Mr. Blandon addressed corrections on water transfers between BCVWD and SMWC in 2012 and a miscalculation on the operating safe yield. A motion was made and approved to receive and file the annual report.
- Independent Accountant's Financial Report of Agreed-Upon Procedures for the Beaumont Basin Watermaster [Memorandum 14-10]. A motion was made and approved to receive and file the report.
- Status Report on the Beaumont Basin Groundwater Model and Redetermination of Safe Yield [Memorandum 14-11]. After much discussion on the status of the study, a motion was made to conduct additional workshops on October 15, October 29, and November 12, 2014 to review and discuss the model and final report. Motion was approved.

Items Discussed During the October 15, 2014 Special Project Committee Meeting

- Status Report on the Beaumont Basin Groundwater Model and Redetermination of Safe Yield. Consultant was given the task of creating a presentation at the October 29, 2014 meeting to address the quantification of return flows and outlining the factors that affect it.

Items Discussed During the October 29, 2014 Special Project Committee Meeting

- Status Report on the Beaumont Basin Groundwater Model and Redetermination of Safe Yield. Mr. Harder provided a two-part presentation for Committee discussion. The first part was a return flow analysis that took into consideration potential sources including source water, location use, and methods of delivery as well as presenting scenarios when return flows are enhanced. The second portion dealt with subsurface inflows enhancement and challenges that could occur considering several different scenarios.

Items Discussed During the December 3, 2014 Regular Watermaster Committee Meeting

- Authorization for ALDA Inc. to Prepare a Water Level Monitoring Assessment Plan [Memorandum 14-12]. Watermaster authorized ALDA Inc. to conduct an assessment of existing monitoring wells, identify new potential monitoring sites, develop a cost estimate to acquire and install new monitoring equipment, and to review water level data collected by USGS since 2011. Expenditures related to this assessment are to be conducted under Task Order No. 4, On-Call Services.

- Consideration of Amendment No. 2 to Task Order No. 3 Related to the Groundwater Model Update and Redetermination of Safe Yield [Memorandum 14-13]. Watermaster Committee approved Amendment No. 2 in the amount of \$26,430.00 to conduct additional analysis under Task Order No. 3. Task Order upper limit was increased to \$267,360.00.
- Review of Documents Pertaining to the Transfer of Overlying Water Rights from Sunny-Cal Egg and Poultry Company to CV Communities, LLC [Memorandum 14-14]. The transfer of Overlying Water Rights, as documented by Legal Counsel, was approved by the Watermaster Committee on a 3-2 vote.
- Presentation of Recycled Water Recharge Requirements by the California Department of Public Health and the Regional Water Quality Control Board [Memorandum 14-15]. Mr. Blandon made a presentation of the requirements for surface and subsurface applications of recycled water recharge, treatment requirements, tracer analysis, and groundwater quality monitoring.
- Reimbursement to Beaumont Cherry Valley Water District for the Water Meter Installation at Sunny Cal Egg Ranch [Memorandum 14-16]. Watermaster Committee approved the reimbursement to BCVWD in the amount of \$2,412.72.
- Status Report on the Beaumont Basin Groundwater Model and Redetermination of Safe Yield [Memorandum 14-17]. Mr. Harder provided an overview of the safe yield process and the steps taken since the last meeting as well as an analysis of the return flow methodology by Appropriator.

2.2.4 Redetermination of Safe Yield

Under the Judgment (2003) the Safe Yield of the Beaumont Basin was established at 8,650 ac-ft/yr. to be distributed among the Overlying Producers. The Judgment indicates that the Safe Yield of the Beaumont Basin shall be redetermined at least every 10 years beginning 10 years after the date of entry of the Judgment (February 4, 2004).

At the February 2013 Watermaster meeting, the Watermaster Committee authorized a study to develop a hydrologic model of the groundwater basin to be used as a tool in the re-evaluation of the safe yield of the basin. The study was initially scheduled to be completed in 2014; however, additional return flow analysis extended the completion schedule into 2015. The purpose of this study is to determine the natural safe yield of the basin and the maximum amount of groundwater that Overlying Producers can extract over the ensuing 10-year period.

2.3 Storage Applications and Agreements

The first applications to use the Basin for storage purposes were approved in FY 2005-06 when Watermaster approved applications by Banning, BCVWD, SMWC, and YVWD to store up to 135,000 ac-ft of water in the Basin. The City of Beaumont's application to store water was approved by Watermaster in FY 2007-08 bringing the total storage allocation to 157,000 ac-ft. In FY 2009-10, Watermaster approved additional applications by Banning, BCVWD, Beaumont, and YVWD to increase the total storage allowed to 260,000 ac-ft. It is our understanding that

the Watermaster Committee has not yet amended the respective Storage Agreements to reflect the current storage limits.

An application for a storage agreement was received by the Watermaster from the San Gorgonio Pass Water Agency (SGPWA) in mid 2010 and brought for discussion at the summer of 2012. The application was rejected because it was determined to be incomplete.

An application for a storage agreement was also received from the Morongo Band of Mission Indians at the December 2012 meeting. Watermaster deemed the application incomplete and requested further information from the applicant to address questions posed by members of the Watermaster Committee. The application was subsequently approved at the June 5, 2013 meeting allowing the Morongo Band of Mission Indians to store up to 20,000 ac-ft of imported water in the basin.

As of December 31, 2014, the total storage allowed stands at 280,000 ac-ft; storage limits by participant are as follows:

- | | |
|-----------------------------------|--------------|
| ▪ City of Banning | 80,000 ac-ft |
| ▪ City of Beaumont | 30,000 ac-ft |
| ▪ Beaumont Cherry Valley WD | 80,000 ac-ft |
| ▪ South Mesa Water Company | 20,000 ac-ft |
| ▪ Yucaipa Valley Water District | 50,000 ac-ft |
| ▪ Morongo Band of Mission Indians | 20,000 ac-ft |

A new application for Groundwater Storage Agreement was developed in early 2013; the application was presented and discussed at several Watermaster Committee meetings where input was received and questions were addressed. The new application was approved by the Watermaster Committee in August 2013 and will be used for future applicants.

2.4 Rules and Regulations

The original Rules and Regulations of the Watermaster were adopted on June 8, 2004. The Judgment provides for their periodic update as deemed necessary by the Watermaster. On September 9, 2008, the Watermaster adopted Rule and Regulation 7.8, entitled "Availability of Unused Overlying Production and Allocation to the Appropriator Parties". The objective of this rule is to define the process through which unused production by Overlying Parties is allocated to the Appropriator Parties. The unused water will be allocated based on each Appropriator's percent share of the operating safe yield, as described in Exhibit C of the Judgment. This allocation will have no impact on the legal water rights owned by the Overlying Parties in subsequent years. The initial allocation to take place on or after February 4, 2009.

No changes to the Rules and Regulations were made during Calendar Year 2014.

2.5 Active Party List

Part VII, Paragraph 1 of the Judgment, indicates that Watermaster shall maintain an updated list of parties to whom notices are to be sent for the purpose of service. Said list should include names, addresses for the Parties or their successors. A copy of the list has been included with this annual report as Appendix A.

2.6 Financial Management

The Watermaster must develop and administer a budget for all administrative, operational, and capital costs it incurs. The following discussion summarizes the budget established for the FY 2014 operations.

2.6.1 Budget

The budget for Fiscal Year 2014 was initially approved at the June 5, 2013 Watermaster meeting in the amount of \$107,060.00 for Administrative expenses and \$180,710.00 for Special Project expenses. This Administrative budget was \$16,110.00 higher than the approved budget for Fiscal Year 2013 of \$90,950.00 and was primarily developed to fund administrative expenses. The approved budget was funded through a combination of carryover funds from FY 2013 (\$71,027.40) and a water agency contribution of \$7,206.52 each. The adopted budget for FY 2014 added \$10,000.00 to the Reserve Fund.

The Special Project expenses to fund the Groundwater Model Update and Redetermination of Safe Yield were primarily funded from carryover funds from 2013 (\$178,210.00). In addition, \$2,500.00 was collected from the water agencies based on their share of the operating safe yield; the City of Beaumont did not provide any funds for the special project.

The initial budget was amended at the June 4, 2014 to Watermaster Committee meeting to increase the Special Project expenses by \$11,720.00 to \$192,430.00. This additional funding was collected from the water agencies based on their share of the operating safe yield.

The proposed budget for FY 2015 includes \$113,050.00 for administrative expenses and \$25,000.00 for special projects. Funding for administrative expenses is expected to be cover from a carryover of \$10,000.00 and water agencies contributions of \$20,610.00 each. Funding for the special project will be funded by the water agencies based on their share of the operating safe yield. The City of Beaumont will not be contributing to the funding for special projects.

The following table presents a comparison between the approved and amended budgets for FY 2013-14 and the approved budget for FY 2014-15.

<i>Operating Expense</i>	<i>FY 2013-14 Approved Budget</i>	<i>FY 2013-14 Amended Budget</i>	<i>FY 2014-15 Approved Budget</i>
<u>Administrative Expenses</u>			
Bank Fees and Interest	\$ 60.00	\$ 60.00	\$ 50.00
Miscellaneous and Meetings	\$ 500.00	\$ 500.00	\$ 500.00
Acquisition/computation & Annual Report	\$ 55,000.00	\$ 55,000.00	\$ 75,000.00
Annual Audit	\$ 2,000.00	\$ 2,000.00	\$ 2,500.00
Engineering Services	\$ 17,000.00	\$ 17,000.00	\$ 10,000.00
Legal Expenses	\$ 22,500.00	\$ 22,500.00	\$ 15,000.00
Reserve Funding	\$ 10,000.00	\$ 10,000.00	\$ 10,000.00
	\$ 107,060.00	\$ 107,060.00	\$ 113,050.00
<u>Special Project Expenses</u>			
Engineering	\$ 178,210.00	\$ 189,930.00	\$ 22,500.00
Litigation	\$ 2,500.00	\$ 2,500.00	\$ 2,500.00
	\$ 180,710.00	\$ 192,430.00	\$ 25,000.00
Total Operating Expense	\$ 287,770.00	\$ 299,490.00	\$ 138,050.00

2.6.2 Financial Audit

The Beaumont Basin Watermaster has a financial audit performed on annually on a fiscal year basis. The audit assists in properly accounting for the revenues and expenses of the Watermaster and tracking the financial resources of the agency. The detailed audit report for FY 2014, prepared by Rogers, Anderson, Malody, and Scott, LLP, was presented at the October 2014 Watermaster meeting. A copy of the audit is included under Appendix B.

Their independent auditors' report of the Watermaster's financial statements is that they fairly present the organization's financial position in all material aspects and its operations were conducted in conformity with generally accepted accounting principles.

At the beginning of the 2013-2014 fiscal year, the Beaumont Basin Watermaster had unrestricted net assets in the amount of \$219,553.00. During the fiscal year, the Watermaster collected \$50,407.00 in revenues and expended \$247,903.00. As of June 30, 2014, the Watermaster had unrestricted net assets in the amount of \$22,057.00.

No recommendations were provided as part of this audit; the results of the audit disclosed no instances of non-compliance or other matters that are required to be reported under Government Auditing Standards.

Section 3

Status of the Basin and Administration of the Judgment

The Beaumont Basin Watermaster is responsible for the accounting of groundwater production, recharge of supplemental water, groundwater transfers and storage activities in the Beaumont Basin. Since the inception of the Judgment accounting has been conducted on a fiscal year basis starting on July 1, 2003.

Through the adoption of Resolution No. 2011-01, on September 21, 2011, Watermaster changed the accounting from a fiscal year basis to a calendar year basis starting in CY 2011. The conversion of Fiscal Year basis to Calendar Year basis was documented in the Annual Report for CY 2011 that was adopted by the Board in early 2013. The annual report for CY 2014 builds on the information presented in previous annual reports.

3.1 Climate, Hydrology and Hydrogeology

3.1.1 Climate

The Beaumont Basin is located in a semi-arid region characterized by warm summers and mild winters with average summer high temperatures in the mid to upper 90s (Fahrenheit) and average winter low temperatures in the mid to low 40s. Precipitation in the region occurs as snowfall in the upper elevations of the San Bernardino Mountains to the north and rainfall in the Basin. Annual precipitation in the Beaumont Basin, as recorded at the County of Riverside's Beaumont Station 013 averaged 17.65 inches over the 100-year period between 1914 and 2013. On the average, 70 percent of precipitation falls during the winter between December and March.

Figure 2-1 illustrates annual precipitation at this station for the reporting period including a plot of the cumulative departure from the mean (CDFM) precipitation. This parameter is used to assess the occurrence, duration, and extent of wet and dry precipitation cycles. Upper trending periods in the graph represent periods with above average precipitation such as the 1913-46 period; average precipitation during this period was 20.5 inches or close to 16 percent above the long-term average. Other above average precipitation periods include the 1977-83 and 1990-98 periods. Conversely, down trending periods indicate periods of below average precipitation as in the 1947-77 period when average precipitation was only 15.2 inches. The 1984-90 period with seven consecutive years of below average precipitation was also characterized as a dry period.

Currently, the Basin is in a dry period that began in 1999. During this 15-year period three of the five years with the lowest precipitation ever recorded at Station 13 have occurred; 6.3 inches (lowest ever) in 1999, 7.40 inches in 2013, and 8.07 inches in 2009. It should be noted that the average precipitation during the base period (1997-2001) used to determine the safe yield of the Basin was 13.43 inches, close to 25 percent below the long-term average for the Basin.

3.1.2 Surface Water Hydrology

There are three significant drainage systems that overlie the Beaumont Basin: the San Timoteo Creek drainage system which is tributary to the Santa Ana River; the Potrero Creek drainage system in the San Jacinto watershed; and the Smith Creek drainage system tributary to the White Water River which is part of the Salton Sea drainage basin.

Surface water flows originate in the San Bernardino Mountains to the north of the Basin. The streams and creeks that flow into the Beaumont Basin are dry for most of the year with occasional runoff during rainfall events. There are no stream gages in the Basin that can be used to estimate surface water recharge to the Basin or discharge from the Basin.

3.1.3 Hydrogeology

3.1.3.1 Regional Geologic Context

The Beaumont Basin is located in the San Gorgonio Pass, a low-relief highland that is bordered on the north by the San Bernardino Mountains, on the southeast by the San Jacinto Mountains, and on the west by the San Timoteo Badlands. Surface sediments in the Beaumont Basin and nearby lowlands consist of unconsolidated to semiconsolidated Quaternary alluvium. Surrounding the alluvial sediments are semiconsolidated rocks of the San Timoteo Formation and igneous and metamorphic rocks that make up the San Jacinto and San Bernardino Mountains (see Figure 2-2). The San Timoteo Formation is composed primarily of sandstone, conglomerate, siltstone, and mudstone (Rewis, et al., 2007). The igneous and metamorphic rocks form the crystalline basement rocks in the area (Bloyd, 1971). The unconsolidated Quaternary alluvium and the upper portion of the underlying San Timoteo Formation constitute the water-bearing aquifer of the Beaumont Basin (Rewis, et al., 2007).

3.1.3.2 Faults

The boundaries of the Beaumont Basin are based on faults that often form barriers to groundwater flow (Bloyd, 1971). Major faults in the area include the Banning and Cherry Valley faults, which form the northern boundary of the basin (see Figure 2-2). Groundwater levels within the Beaumont Basin are generally lower than groundwater levels in the surrounding areas. Along the Banning Fault, groundwater levels on the north side of the fault and outside the basin are as much as 400 ft higher than groundwater levels on the south side of the fault and inside the basin. The same condition has been observed along the southern Beaumont Basin boundary.

3.1.3.3 Groundwater Occurrence and Flow

Groundwater in the Beaumont Basin occurs at depth in the Quaternary alluvium and the underlying San Timoteo Formation. Groundwater flow within the Beaumont Basin generally depends on location with respect to a groundwater flow divide which occurs in the center of the basin, approximately coincident with the Noble Creek drainage (see Figure 2-2). West of the Noble Creek drainage, groundwater generally flows to the northwest and ultimately as

underflow beneath San Timoteo Wash. East of the Noble Creek drainage, groundwater flows to the southeast towards the City of Banning.

The groundwater system in the Beaumont Basin is replenished from multiple sources. These include:

- Infiltration of precipitation within the unlined portions of natural streams
- Subsurface seepage across fault boundaries
- Return flow from irrigation and individual septic systems
- Artificial recharge in man-made basins (e.g. Noble Creek Recharge Facility).

Groundwater discharges from the Beaumont Basin primarily occur from:

- Groundwater production
- Underflow out of the basin at the downgradient margins
- Rising water in San Timoteo Creek
- Evapotranspiration

3.2 Production

The Beaumont Basin Watermaster is responsible for the tracking and accounting of groundwater production by all producers named in the Judgment regardless of the amount of groundwater produced. Other producers, not listed in the Judgment, and pumping less than 10 ac-ft /yr., also known as minimal producers, are exempt from the provisions of the Judgment. Figure 3-3 illustrates the location of all production wells that belong to the Appropriators and Overlying parties of the Judgment.

3.2.1 Appropriative Party Production

There are five Appropriative Producers; namely, Banning, Beaumont, the BCVWD, the SMWC, and the YVWD. The amount that each Appropriator produces in any given year, without incurring a replenishment obligation, varies from year to year and results from a combination of:

- Their share of the Operating Yield, based on the Temporary Surplus of 16,000 ac-ft/yr for all Appropriators,
- Transfers from other Appropriators,
- Transfers of unused production from Overlying Producers,
- Water withdrawn from their storage account, and
- New yield created by the Appropriator.

It should be noted that the Temporary Surplus was not available for Calendar Year 2014 as it officially ended during Fiscal Year 2013.

Annual production by well for each of the five Appropriative Parties for the CY 2003-2009 period is summarized in Table 3-1 while monthly production for the last five years of operation (CY 2010-14) are presented in a series of tables starting with Table 3-2A for CY 2010 and continuing on an annual basis through Table 3-2E for CY 2014. These tables also include the overall Temporary Surplus Allocation and the amount of unused production that is eligible for storage for each Appropriator. It should be noted that all production by Appropriators is currently being metered; however, no information is available as to the accuracy of existing meters.

During CY 2014, Appropriators pumped a combined amount of 15,063 ac-ft of groundwater from the Beaumont Basin representing the third highest production year since the inception of the Judgment. Groundwater production by Appropriators in CY 2014 was 3.6 percent higher than 2013 production and 22.0 percent higher than 2012 production. Groundwater production in CY 2014 was the second highest on record since the inception of the Judgment.

With the exception of BCVWD, production by other agencies increased significantly from FY 2013. The City of Banning production jumped by over 23 percent, SMWC by 54 percent, and YVWD by 16 percent. Production by BCVWD decreased by close to three percent.

3.2.2 Overlying Party Production

Overlying Parties are defined in the Judgment as persons, or their assignees, that are part of the Judgment and who are owners of land which overlies the Beaumont Basin and have exercised Overlying Water Rights to pump therefrom. Overlying Parties include successors in interest and assignees. Overlying Producers were assigned a share of the Basin's Safe Yield, estimated in 2003 at 8,650 ac-ft/yr. Individual Overlying Producers may not pump more than five times their assigned share of the Basin's Safe Yield in any five-year consecutive period without incurring a replenishment obligation.

Currently, there are 17 Overlying Producers in the Basin pumping from 22 groundwater wells. All active wells operated by the larger producers are metered. Meters were installed by individual owners or as part of an effort initiated by Watermaster in 2013 to obtain a closer production accounting from Overlying Parties. Production from metered wells represented close to 96 percent of the total production by Overlying Parties in CY 2014.

The remaining wells, operated by smaller producers, did not have meters for some or most of 2014 and their production is estimated using the water duty method. This method was initially proposed by Wildermuth Environmental Inc. (WEI), during the preparation of the 2005-06 Annual Report. After being accepted by the Watermaster, an updated water duty method was developed by WEI and it has been used since. The estimate of unmetered production for the CY 2014 Annual Report uses the updated method developed by WEI as detailed in Appendix C.

Similar to the production reported for the Appropriators, a series of tables was developed to report monthly and annual production from the Overlying Parties on a calendar year basis. Starting with Table 3-2A for CY 2003 and continuing on an annual basis through Table 3-2L for CY 2014, these tables show the actual or estimated production by well and by user. In addition, their share of the safe yield and the amount of unused water for each Overlying Party is shown.

It should be noted that these tables have been revised to reflect updated production records from Sharondale Mesa Owner Association since 2011.

During CY 2014, Overlying Producers produced an estimated 1,922 ac-ft; this level of production is the lowest on record since accounting began in 2003. Part of the reason is related to revisions made to production totals by Oak Valley Partners in CY 2014. Production by this Overlying Party has been reported in the past at approximately 310 ac-ft per year under the assumption that a significant amount of water has been produced for agricultural purposes. A field visit to the property conducted in early April 2015 revealed that agricultural production has not taken place in that area for a number of years. In addition, two of the four wells have been abandoned and the other two produce minimally; annual production has been conservatively estimated 2.5 ac-ft/yr. Production quantities from this Overlying Producer were revised for CY 2014; however, production may be revised further into the past depending on additional research being conducted. Production in CY 2004 by the Overlying Parties would have been the lowest on record even if the numbers for Oak Valley Partners would have not been revised.

3.2.3 2003-2014 Annual Production Summary

Annual production for all Appropriators and Overlying Parties since 2003 is summarized in Table 3-3 on a calendar year basis. Production from 2003 only includes production for the second half of the year. Since July 2003, a total of 186,703 ac-ft have been pumped from the Beaumont Basin; an estimated 82.3 percent of this total has been pumped by Appropriators. The percentage of groundwater production from Appropriators has steadily increased since the Judgment inception from a low of 74.3 percent registered in CY 2003 to a high of 88.7 percent recorded in CY 2014 and has averaged 85.2 percent over the last five calendar years.

Groundwater production peaked in CY 2007 when close to 20,000 ac-ft were pumped from the basin; since, it declined steadily through 2011 to approximately 14,000 ac-ft; however, production over the last three years has increased by 21 percent. Groundwater production since CY 2004 has averaged 16,108 ac-ft/yr. In CY 2014, a combined total of 16,984 ac-ft were pumped from the basin; of this total, 15,063 ac-ft, or approximately 89 percent, were pumped by Appropriators. Annual production for each of the Appropriators and for the Overlying Producers combined is depicted in Figure 3-4.

3.3 Groundwater Recharge

The Watermaster is responsible for maintaining an annual account of all water artificially recharged in the Beaumont Basin and any losses of water supplies or Safe Yield resulting from such recharge water. Sources of groundwater recharge include imported water from the State Water Project (SWP), recycled water, and new yield sources developed in the basin since the Judgment inception in July 2003. The Watermaster has maintained the accounting of groundwater recharge; however, losses from the basin, if any, have not been estimated. Table 3-4 presents a summary of the annual groundwater recharge in the Beaumont Basin since 2003 on a calendar year basis.

3.3.1 State Water Project Water Recharge

BCVWD's Noble Creek spreading facility, located in the vicinity of Beaumont Avenue and Cherry Valley Boulevard, is the only facility in the Beaumont Basin where deliveries of imported water can be used to recharge the groundwater basin. The location of this spreading facility is depicted in Figure 3-3. Deliveries of imported water are conducted through the San Gorgonio Pass Water Agency, which is the State Water Contractor for this area.

The BCVWD began taking deliveries of imported water for groundwater recharge in the Fall of 2006 when 3,501 ac-ft were spread pursuant to the storage and recharge agreement on file with Watermaster. Deliveries of imported water for BCVWD increased over the next five years and peaked in CY 2011 at 7,979 ac-ft. Spreading of imported water slightly decreased through CY 2013 to 7,403 ac-ft; deliveries of imported water for spreading significantly declined for BCVWD in CY 2014 as less than 4,500 ac-ft were spread. A total of 46,439 ac-ft of imported water have been spread by the BCVWD since 2006 as illustrated in Table 3-4. Significant differences between the imported water deliveries provided by the BCVWD and those documented by the SGPWA were documented in the previous annual report. The inconsistencies between the BCVWD and SGPWA through CY 2011 have been addressed. Values provided by the SGPWA for CY 2014 need to be checked against information to be provided by the BCVWD.

The City of Banning began purchasing imported water for recharge at the BCVWD's Noble Creek facility in July 2008 and has since recharged 9,421 ac-ft. in accordance with their storage agreement on file with Watermaster. During CY 2012 and 2013, the City of Banning spread an average of 100 ac-ft per month; spreading in CY 2014 was reduced to approximately half of the amount spread during the previous two years.

In addition to imported water deliveries to BCVWD's Noble Creek facility, SGPWA has also delivered significant quantities of imported water at the Little San Gorgonio Creek Spreading Ponds. These spreading ponds are located outside the adjudicated boundary of the Beaumont Basin and to the north of the Banning Fault, as shown in Figure 3-3. Spreading of imported water at these spreading ponds may be a source of subsurface recharge to the Beaumont Basin; however, Watermaster has not adopted this finding. Subsurface recharge across the Banning Fault is being investigated as part of the Safe Yield of the Basin determination study, to be completed in early 2015.

Deliveries of imported water by the SGPWA to the Little San Gorgonio Creek Spreading Ponds began in August 2003; the agency has since recharged a total of 10,481 ac-ft averaging 1,046 ac-ft/yr. Deliveries in CY 2013, at 881 ac-ft, were less than half of the amount spread in CY 2011 and CY 2012. Deliveries in CY 2014 were basically non-existent as only 17 ac-ft were spread. At the present time, the SGPWA does not have a storage agreement with the Beaumont Basin Watermaster.

3.3.2 Recycled Water Recharge

Prior to March 2010, Beaumont's recycled water from Wastewater Treatment Plant No. 1 was discharged at Discharge Point No. 1 (DP-001) in Cooper's Creek where it infiltrates into the San Timoteo Management Zone and outside the Beaumont Basin. In March 2010, Beaumont began deliveries of recycled water to Discharge Point No. 7 (DP-007), located along an unnamed tributary of Marshall Creek, as shown in Figure 3-3. It is believed that a portion of the recycled water discharged at this location reaches and recharges the Beaumont Basin; in which case, this would be considered a new source of supplemental water for which Beaumont should receive credit pursuant to the storage agreement with the Watermaster and Section 5.4 of the Rules and Regulations. Technical documentation of the amount of recycled water that reaches and recharges the Beaumont Basin would need to be prepared by Beaumont and considered and accepted by Watermaster.

In CY 2014, the City of Beaumont discharged an estimated 2,992 ac-ft of recycled water at DP-001 in Cooper's Creek and an estimated 418 ac-ft at DP-007. Recycled water discharges in CY 2014 were approximately five percent lower than in CY 2013. Monthly discharges at DP-001 vary slightly seasonally and averaged 2.67 mgd in CY 2014; conversely, discharges at DP-007 vary significantly during the year from a low of 0.02 mgd in December to a high of 0.66 mgd in April 2014. Monthly recycled water discharges by the City of Beaumont since 2007 are summarized in Table 3-5.

3.3.3 New Yield Stormwater Recharge

Before accounting for any new yield resulting from the recharge of local surface water, not initially considered as part of the Basin Safe Yield, Watermaster needs to develop a methodology to quantify and credit the New Yield to the party that creates the new recharge. According to Part VI Paragraph 5.V of the Judgment, Watermaster shall make an independent scientific assessment of the estimated new yield created by each proposed project. It is our understanding that Beaumont has been recharging local waters at various locations in the Basin and would like to receive credit for the New Yield developed. For Beaumont to receive credit however, Watermaster will need to develop the methodology to compute and credit the New Yield dating back to February 20, 2003.

3.4 Water Transfers and Adjustments of Rights

Section 7 of the Watermaster Rules and Regulations, as amended in September 2008, provides for the adjustment of rights by and between Appropriators and Overlying Parties. This section indicates that Watermaster shall maintain an accounting for all transfers and include said transfers in the Annual Report or other relevant document. There are three types of transfers that Watermaster accounts for: a) transfer of water rights and/or water in storage between Appropriator Producers, b) transfer of water rights from Overlying Producers to an Appropriator Producer in exchange for water service, and c) the allocation of unused Overlying Water to the Appropriator Parties based on their share of the Operating Safe Yield.

According to Part VI, Administration, Paragraph 5Y of the Judgment, the Safe Yield of the Beaumont Basin shall be redetermined at least every 10 years after the date of entry of the

Judgment, February 4, 2004. In 2014 the Safe Yield of the Beaumont Basin was redetermined and estimated at 6,700 ac-ft/yr. This amount represents a 22.54 percent reduction from the previous estimate of 8,650 ac-ft/yr. Table 3-6 presents the initial and revised production rights from individual Overlying Producers and compares them against actual groundwater production during the 2010-14 period for each user. Annual groundwater production during this period for all Overlying Producers combined was estimated at 1,991.4 ac-ft/yr; this amount represents approximately 30 percent of the revised safe yield. Individually, none of the Overlying Producers produced more than their rights during the 2010-14 period.

3.4.1 Transfers between Appropriators

According to Section 7.3 of the Rules and Regulations, an Appropriator may transfer all or a portion of its production right or water in storage that exceeds its supply needs to another Appropriator. In January 2008, the SMWC and the BCVWD entered into a transfer agreement that allows BCVWD the option to purchase all water that SMWC determines to be available for transfer from their storage account. As part of the agreement, each year the SMWC estimates the amount of water available for transfer and offers it to the BCVWD for purchase prior to offering it to other Appropriators. Since the beginning of the agreement, SMWC has transferred 9,500 ac-ft of water to BCVWD with 3,500 ac-ft transferred in CY 2011. SMWC also transferred 1,500 ac-ft of water to Banning in 2007. The purchase agreements and transfers between these agencies are on file with Watermaster. Water transfers between Appropriators were not reported during CY 2014.

3.4.2 Transfers of Overlying Rights for Service by an Appropriator

The Judgment, under Part III, Paragraph 3, provides that to the extent an Overlying Party request water service from an Appropriator Party, and uses its adjudicated water rights to obtain said service; an equivalent volume of groundwater shall be reserved for the Appropriator Party providing the service to the Overlying Party. Further, Section 7 of the Rules and Regulations indicates that both the Overlying and Appropriator will file a Notice of Adjustments of Rights with Watermaster within 30 days after entering a service agreement.

The BCVWD has given verbal notification to Watermaster that is providing potable service to certain Overlying Parties; however, formal notification by either party for the adjustment of water rights has not been received by Watermaster. A formal notification will be required to complete the transfer of water rights from one or more Overlying Producers to BCVWD; the notification should be retroactive to the time service began. Upon formal completion of the transfer, Watermaster will be required to recalculate the allocation of unused Overlying Water to the Appropriators, as documented in Section 7 of the Rules and Regulations.

In early 2013, BCVWD provided detailed documentation of all the parcels now served by the District that were previously owned by Overlying Users including parcels owned by Oak Valley Partners, Southern California PGA, and Plantation on the Lake. The accounting of this information has been challenged by the Morongo Band of Mission Indians representatives. As of the time of this writing, the accuracy of the information has not been corroborated and it is therefore not included in this report.

3.4.3 Allocation of Unused Overlying Water

Section 7.8 of the Rules and Regulations, adopted on September 9, 2008, by Watermaster, outlines the process for distributing the volume of adjudicated water not produced by the Overlying Parties to the Appropriators. Under this section, if an Overlying Party produces less than five times of their share of the safe yield in any five-year period, the quantity of groundwater not produced by that Overlying Party shall be made available for allocation to the Appropriators. Transferring of unused production from Overlying Users does not diminish their legal right to produce in subsequent years.

Since the inception of the Judgment, transfers of unused production by Overlying Users has been made on a fiscal year basis coinciding with the preparation of the annual report. Preparing the annual report on a calendar year basis requires that the transfers of unused production also be made on the same basis. Based on the five-year format used in the Rules and Regulations, transfers to the Appropriator Parties for CY 2013 were based on unused production from Overlying Users in CY 2008. This required the recalculation of Overlying Users production, back to July 2003, on a calendar year basis. Under this format, unused production from the second half of 2003, with adjusted water rights for half of the year, was transferred to Appropriators for CY 2008. Table 3-7 summarizes the volume of unused Overlying water for CY 2003 through CY 2014. While groundwater production by Overlying Users has decreased by over 40 percent since 2004, the volume of unused overlying water has increased from approximately 5,000 ac-ft/yr in CY 2006 to well and estimated 6,728 ac-ft in CY 2014. Unused overlying water for CY 2014 and the second half of CY 2013 may be revised down as the new safe yield of the basin is anticipated to be lower than the 8,650 ac-ft/yr used for the 2004-13 fiscal period.

Table 3-8 presents the allocation of unused Overlying water to each Appropriator based on their shares of the safe yield and the schedule set forth under Section 7.8 of the Rules and Regulations. It should be noted that this schedule has been modified to reflect a calendar year basis for allocation. Under the modified schedule, unused Overlying production in CY 2009, estimated at 5,812 ac-ft, is allocated to Appropriators during CY 2014. Unused Overlying production during CY 2014, estimated at 4,778 ac-ft and subject to revision, would be allocated to Appropriators during CY 2019.

3.5 Storage Accounting

Section 6.7 of the Watermaster Rules and Regulations indicates that Watermaster shall calculate additions, extractions, and losses of all water stored and any losses of water supplies or Safe Yield resulting from such water stored. This section further indicates that Watermaster shall keep and maintain for public record an annual accounting thereof. While additions (spreading) and extractions (pumping) are easily quantifiable, losses from storage are more difficult to estimate. A methodology for estimating groundwater losses from the Basin is anticipated to be developed after the completion of the groundwater model update of the Beaumont Basin in CY 2015.

3.5.1 Annual Storage Consolidation

Consistent with the new reporting format to document extractions, spreading and other groundwater activities on a calendar year basis, Table 3-9 represents the consolidation of each Appropriator's storage account from CY 2003 through CY 2014. This table includes annual production by Appropriator, their share of Temporary Surplus, supplemental water recharge in its various forms, transfers between Appropriators, potable deliveries to parcels previously owned by Overlying Users, and transfers of unused water from Overlying Users. At the end of 2013, an overall total of 100,818 ac-ft of water were stored in the Basin for future use; this total was reduced in CY 2014 by 4,238 ac-ft to a cumulative total of 96,575 ac-ft. The amount of water in storage decreased for the first time since the Judgment inception; this was due to the expiration of the Temporary Surplus allocation at the end of FY 2013. As of the end of CY 2014, the City of Banning has the largest share (46.4 percent of total storage) of water in storage with 46,774 ac-ft followed by the BCVWD with 28.7 percent of the total (28,930 ac-ft).

3.6 Changes in Groundwater Levels in the Beaumont Basin

3.6.1 Analysis of Groundwater Level Changes

Changes in groundwater flow and groundwater levels between 2013 and 2014 were evaluated using a calibrated groundwater flow model that was previously developed to reevaluate the safe yield of the Beaumont Basin (TH&Co, 2015). For this analysis, the existing calibrated model was updated with groundwater pumping, recharge, and groundwater levels through the end of 2014. A model-generated groundwater contour map was created for Fall 2014 and compared to the model-generated Fall 2013 groundwater contour map in order to evaluate changes in groundwater flow patterns and basin-wide changes in groundwater levels. The model-generated groundwater contour maps for 2013 and 2014 are shown on Figures 3-5 and 3-6, respectively.

Groundwater flow within the Beaumont Basin generally depends on location with respect to a groundwater flow divide which occurs in the center of the basin approximately coincident with the Noble Creek drainage. West of the Noble Creek drainage, groundwater generally flows to the northwest and ultimately towards San Timoteo Wash. East of the Noble Creek drainage, groundwater flows to the southeast towards the City of Banning. The groundwater flow directions did not change significantly between 2013 and 2014.

Basin-wide groundwater level trends in the Beaumont Basin were evaluated based on hydrographs from eight key wells and the groundwater level change map developed by subtracting the 2013 groundwater surface from the 2014 groundwater surface (see Figures 4 and 5). In the northwest portion of the basin, groundwater levels declined slightly between Fall 2013 and Fall 2014. In the north central portion of the basin (TW-1), groundwater levels declined in the summer of 2014 and then stabilized. In the south-central portion of the basin, groundwater levels at Oak Valley No. 1 increased in 2014. At BCVWD Well No. 2, groundwater levels declined throughout 2014 until December when groundwater levels rose to the highest levels in eight years. At Banning Well C-4 (southeast Beaumont Basin),

groundwater levels have declined in the summer of 2014 but rose at the end of the year. However, the overall trend in this well since 2013 is downward. Groundwater levels in the northeast portion of the basin (335714116565002) were stable throughout 2013 and 2014.

3.6.2 Analysis of Change in Groundwater Storage

Basin-wide change in groundwater storage between Fall 2013 and Fall 2014 was analyzed as a function of the difference in groundwater levels across the basin and the specific yield of the aquifer sediments. Groundwater level change across the basin was analyzed using the following procedure:

1. The Fall 2013 and Fall 2014 model-generated groundwater contour maps were each converted into three-dimensional raster surfaces.
2. The basin was discretized into 164-ft by 164-ft grid cells.
3. Attributes were assigned to each grid cell including groundwater level change and specific yield.
4. The resulting attribute table was processed in a Geographic Information System (GIS) for calculating the change in storage.

The specific yield distribution used for the analysis was obtained from the calibrated groundwater flow model used to evaluate the safe yield of the Beaumont Basin, as summarized in TH&Co (2015).

Results of the analysis show a decrease in groundwater storage within the adjudicated basin of approximately 4,475 ac-ft between Fall 2013 and Fall 2014.

3.7 Operating Safe Yield

For purposes of this annual report, the annual operating safe yield (OSY) describes the net infiltration to the adjudicated groundwater basin (not including artificial recharge) for any given year. It is noted that the OSY is different than the Operating Yield, which is a function of the unused overlying production (Appropriative Water) and Temporary Surplus, as described in the Beaumont Basin Judgment (San Timoteo Management Authority v. Banning et al., 2004).

Operating safe yield is estimated based on the following equation:

$$OSY = \frac{\Sigma P + \Delta S - \Sigma AR}{\Delta T}$$

where:	ΣP	=	The sum of groundwater production (ac-ft)
	ΔS	=	The change in groundwater storage (ac-ft)
	ΣAR	=	The sum of groundwater recharge (ac-ft)
	ΔT	=	The time over which the OSY is estimated (years)

Total Beaumont Basin groundwater production in CY 2014 was 16,985 acre-ft (see Table 3-3). Total artificial recharge in CY 2014 was 5,013 acre-ft (see Table 3-4). It is noted that only the Noble Creek Recharge Facility recharge was used in the analysis of OSY (recharge at the Little San Gorgonio Creek facility is not included because it is outside the adjudicated area). The change in groundwater storage estimate is based on the analysis of groundwater levels described earlier in this TM. The period of time over which the OSY is evaluated is one year. The resulting OSY is estimated as:

$$\text{OSY} = \frac{16,985 + (-4,475) - 5,013}{1} = 7,497 \text{ ac-ft}$$

It is emphasized that the OSY, as presented herein, is based on one year of data. When evaluated on a long-term basis, this methodology can be used to estimate the long-term Safe Yield of the basin, as defined in the Beaumont Basin Judgment. As required by the Judgment, the Safe Yield of the basin was reevaluated in 2014.

It is also noted that there are a number of data limitations that could impact the OSY estimate. These limitations include:

- *Accuracy of Overlyer Production Data* – The accuracy of production from the Overlying Parties was an issue in the past because for many producers it was either estimated using a water duty method or production from previous years used under the assumption that the production pattern remained unchanged. Significant improvements in accuracy have been made over the last year as new water meters have been installed. In addition, Overlying producers have been contacted to corroborate the accuracy of their data. Additional improvements in this area will continue to increase the accuracy of the OSY. Under current conditions, potential discrepancies in estimated production are anticipated to affect the OSY (plus or minus) on the order of low hundreds or even high teens.
- *Change in Storage Calculation* – Although groundwater storage change estimates will always have inherent uncertainty, it is possible to develop more representative results through collection and analysis of additional data. These data include:
 - ✓ Static groundwater levels from dedicated non-pumping wells. There is evidence that groundwater levels measured in some wells had not recovered fully between pumping cycles in the well and were not, therefore, representative of true static conditions. This can be addressed by waiting longer after pumping to collect groundwater levels or constructing/designating non-pumping groundwater monitoring wells in strategic areas. This issue is currently being addressed by the implementation of the groundwater level monitoring program by Watermaster.
 - ✓ Measurement of surface water flow in selected drainages, hydrogeological data near Noble Creek and San Timoteo Creek, and hydrogeological analysis of faults

in the basin to help achieve a better calibrated model, resulting in more accurate groundwater head distributions. Bettering our understanding of the hydrogeology of this area will help improve the accuracy of the model and its output.

3.8 Recommendations

The Rules and Regulations, initially adopted in June 2004, were developed with the understanding that they should be revisited and/or revised from time to time to make sure they were consistent with the provisions of the Judgment. Revisions to the Rules and Regulations have been made over the years with the latest revision changing the reporting of Watermaster activities from a fiscal year basis to a calendar year basis.

Since the completion of the previous report, Watermaster is in the process of conducting additional groundwater studies, expected to be completed by early 2015, that may be used to address some of the recommendations from previous years including:

- The development of a methodology to account for new yield from capturing local stormwater in the basin.
- The development of a methodology to account for groundwater storage losses in the basin resulting from the spreading of additional water sources.
- The development of a methodology to account for recycled water recharge.

In preparing this annual report and through the review of previous annual reports, we have identified a number of issues/activities that should be considered by the Watermaster to ensure accurate accounting of production, transfers, recharge, and storage. It should be noted that many of the recommendations provided in this section have been previously documented in prior annual reports. Our recommendations are as follows:

- Consider adopting additional resolutions to address other accounting aspects related to the conversion of annual reporting from a fiscal year basis to a calendar year basis. The following issues should be reported on a calendar year basis:
 - ✓ Water transfers between Appropriators
 - ✓ Transfers of unused production from Overlying Parties to Appropriators
 - ✓ Spreading of imported water, recycled water, and new yield developed
- Develop a protocol to increase the accuracy and consistency of data reported to the Watermaster. Watermaster should identify a person and/or entity to be the central repository for data collection, transfer, and exchange. This person/entity shall be responsible for the collection and distribution of all groundwater production, water level, groundwater recharge, and water quality information. Quality control of the data in its various forms including checks for errors, omissions, and inconsistencies between the reporting agencies and/or parties should be part of this process.

- Develop a policy to account for transfers of water that may result when an Appropriator provides water service to an Overlying Party. Section 7 of the Rules and Regulations, Adjustments for Rights, provides initial guidelines to execute this transfer; however, it needs to be enhanced in the following areas: a) data requirements to complete the transfer, b) review process by Watermaster, c) schedule for completion so that proper accounting of transfers can be given and documented in the annual report.

As indicated earlier, Watermaster should revisit the Rules and Regulations to ensure that its activities are consistent with the requirements of the Judgment. The following inconsistencies between guidelines provided in this document and current Watermaster activities were identified:

- Watermaster has not conducted a meter maintenance program, as required under Section 3.1 of the Rules and Regulations, to make sure groundwater production is reported accurately. Individual parties may or may not maintain and calibrate their production meters at acceptable intervals.
- Under Section 3.2 of the Rules and Regulations, producers producing in an excess of 10 ac-ft/yr. should report on a monthly basis by the 15th day of the ensuing month while those producing less should file on an annual basis by the 15th of July. This provision should be revised as it was written for fiscal year accounting. Overlying Parties producing less than 10 ac-ft/yr should report by the 15th of January now that calendar year accounting is used. Proper supporting information should be provided.
- Watermaster has not enforced the submittal of notices of transfers prior to accounting for said transfers as defined in Sections 7.1 through 7.5 of the Rules and Regulations.
- Watermaster has not filed its annual reports with the Court. The Watermaster Board should make a formal determination as to whether the annual reports should be filed with the Court.



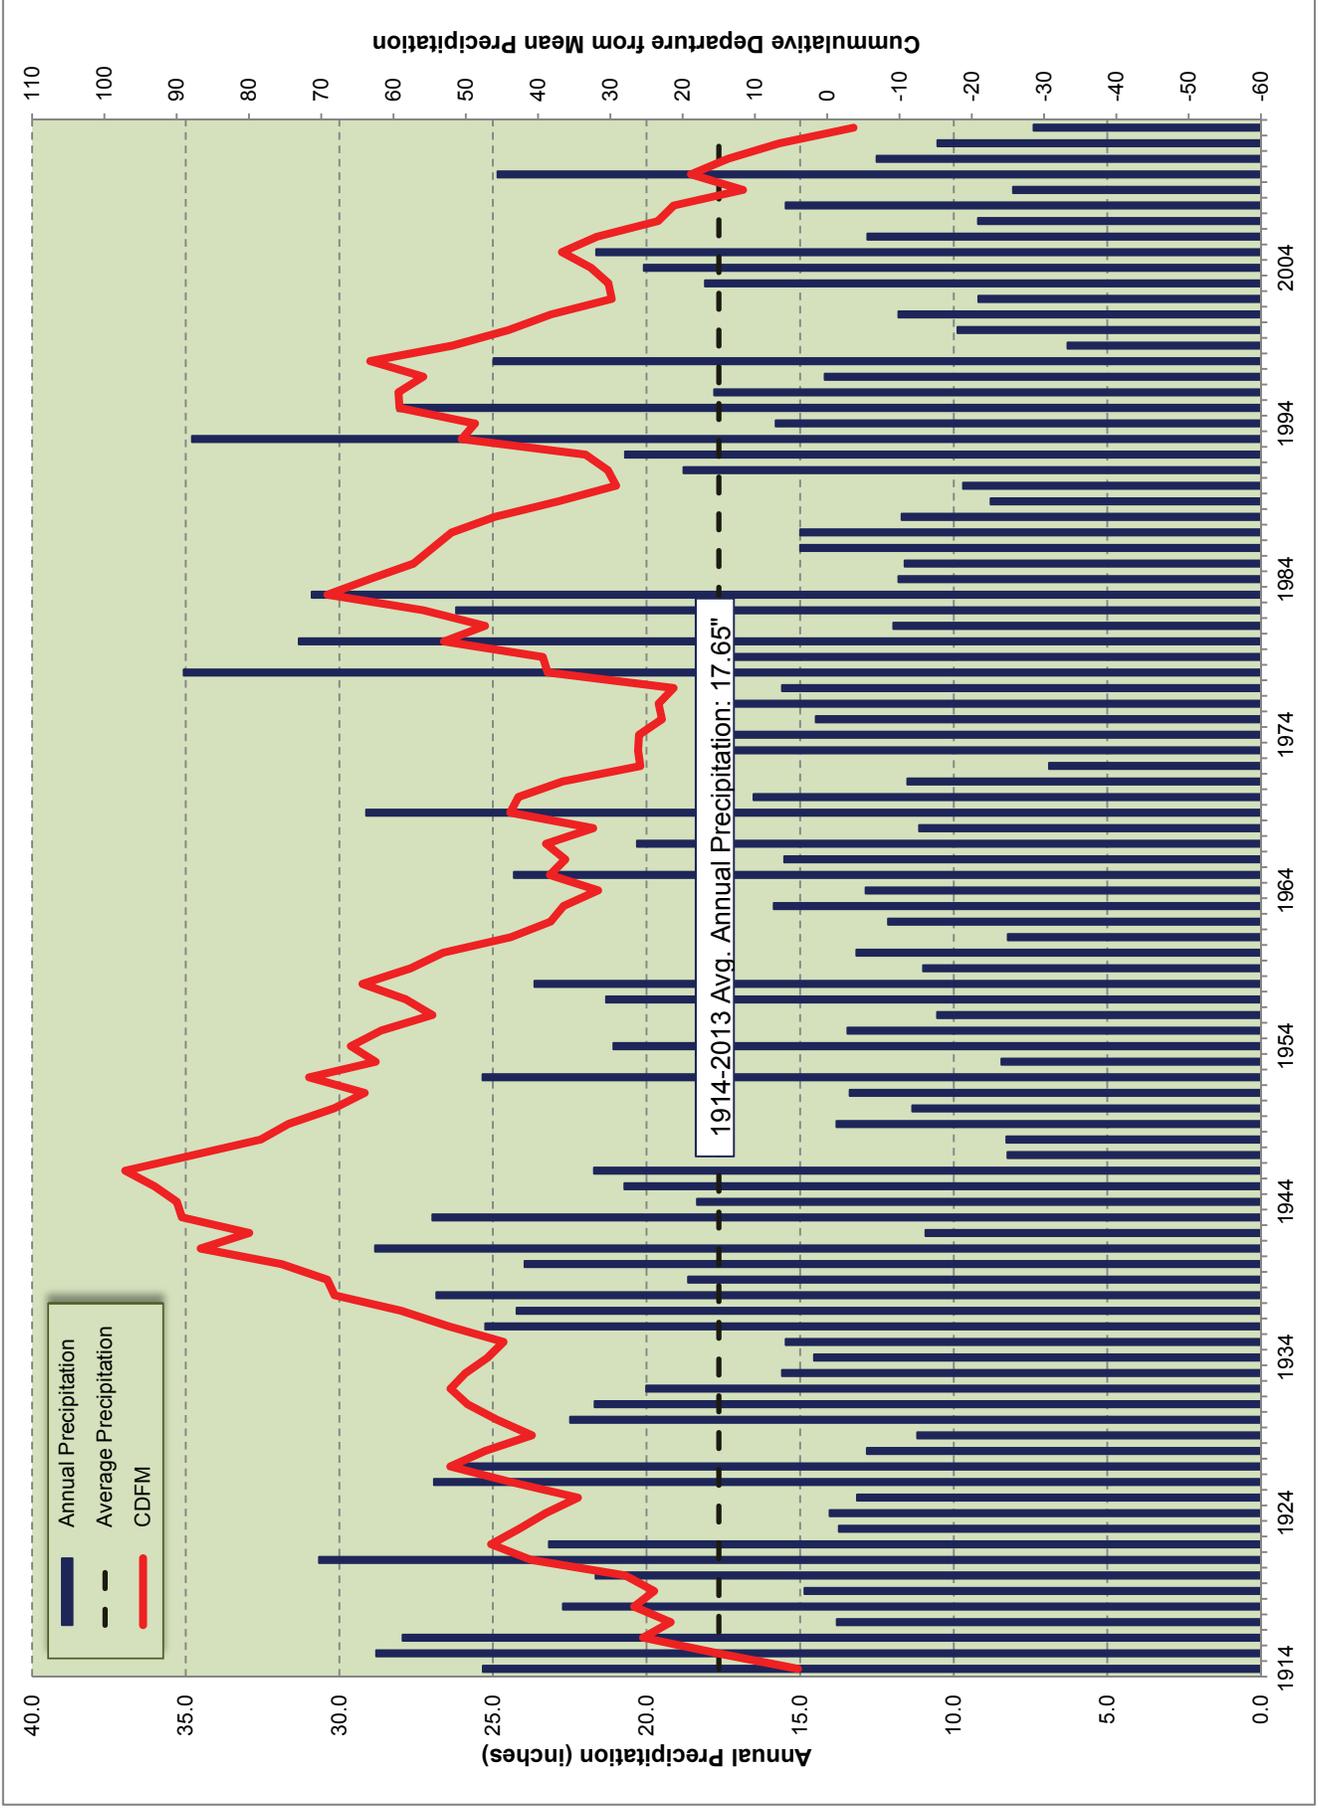



Figure 3-1
Annual Precipitation with Cumulative Departure from the Mean (1914-2013)

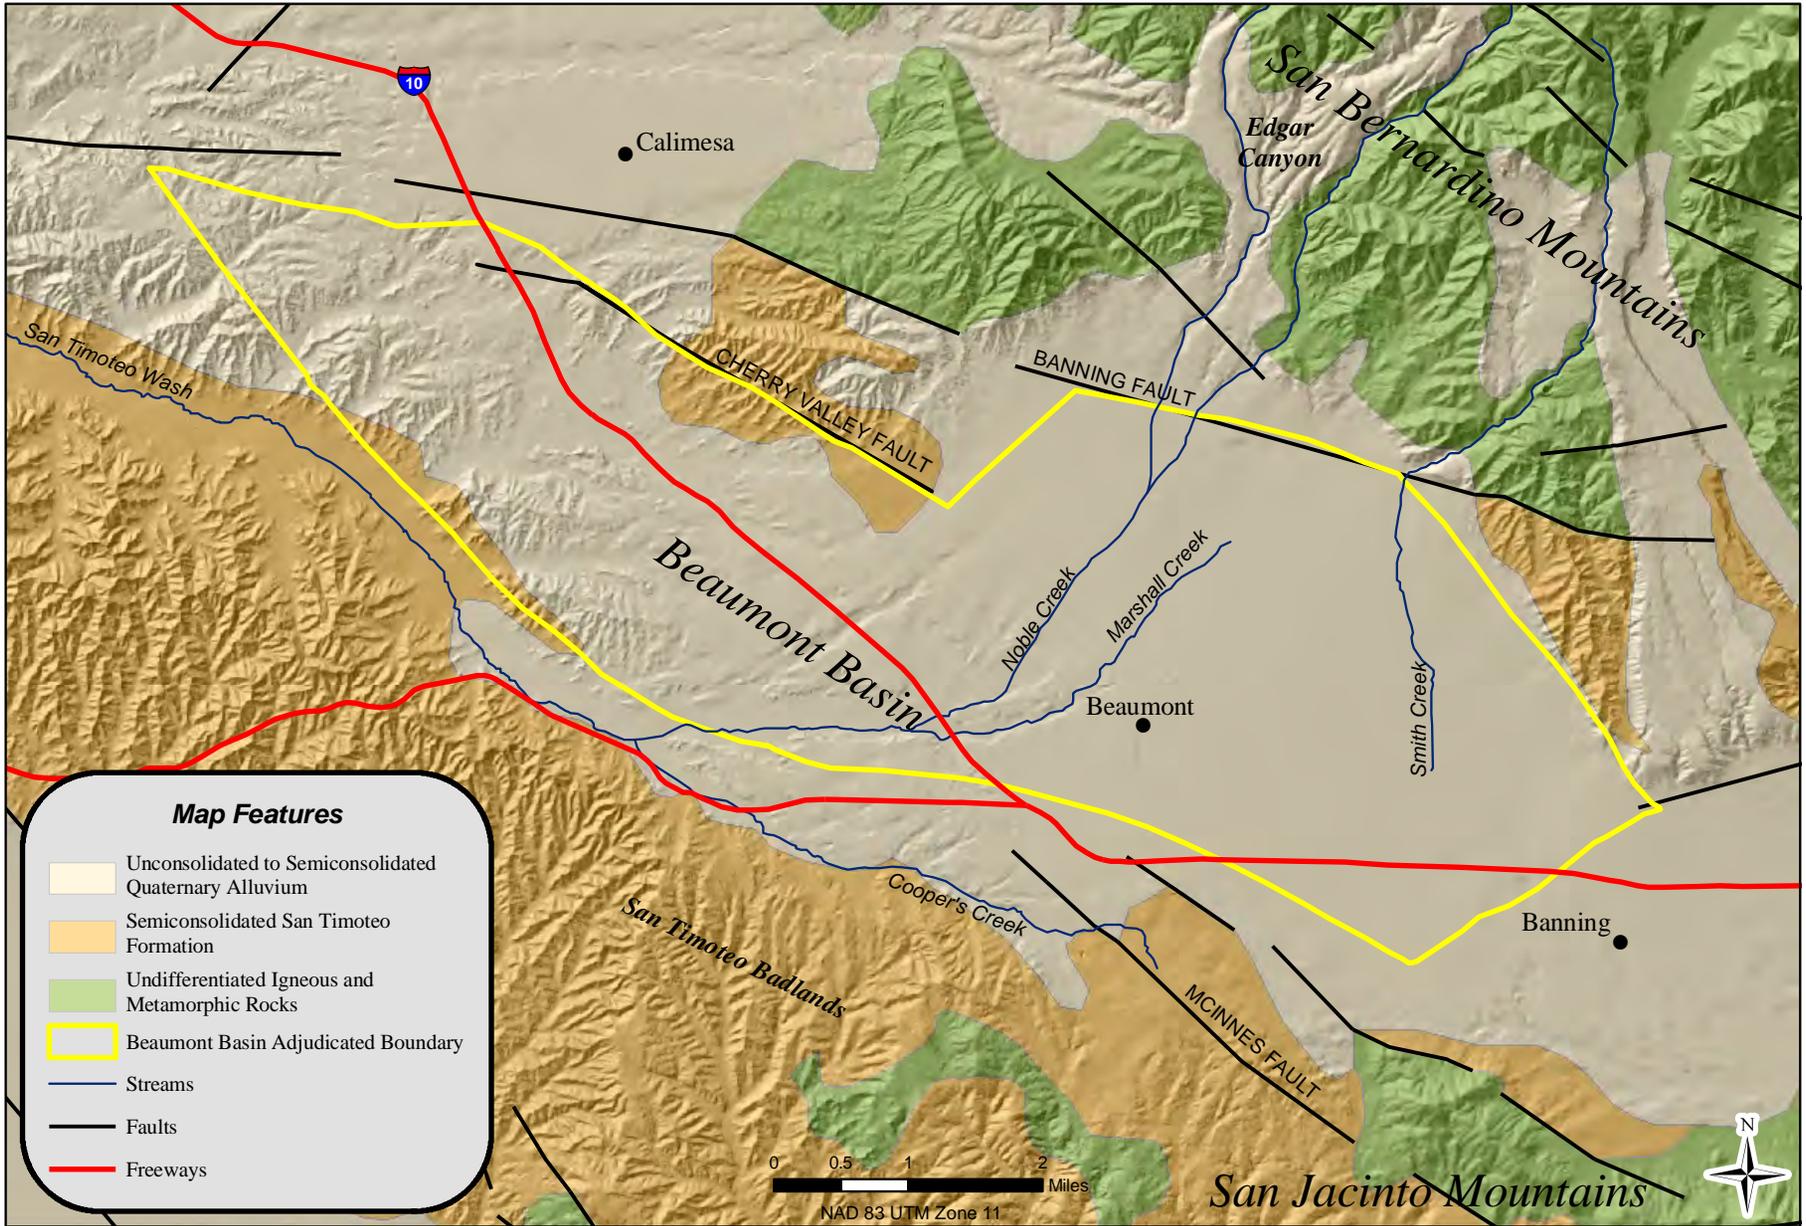

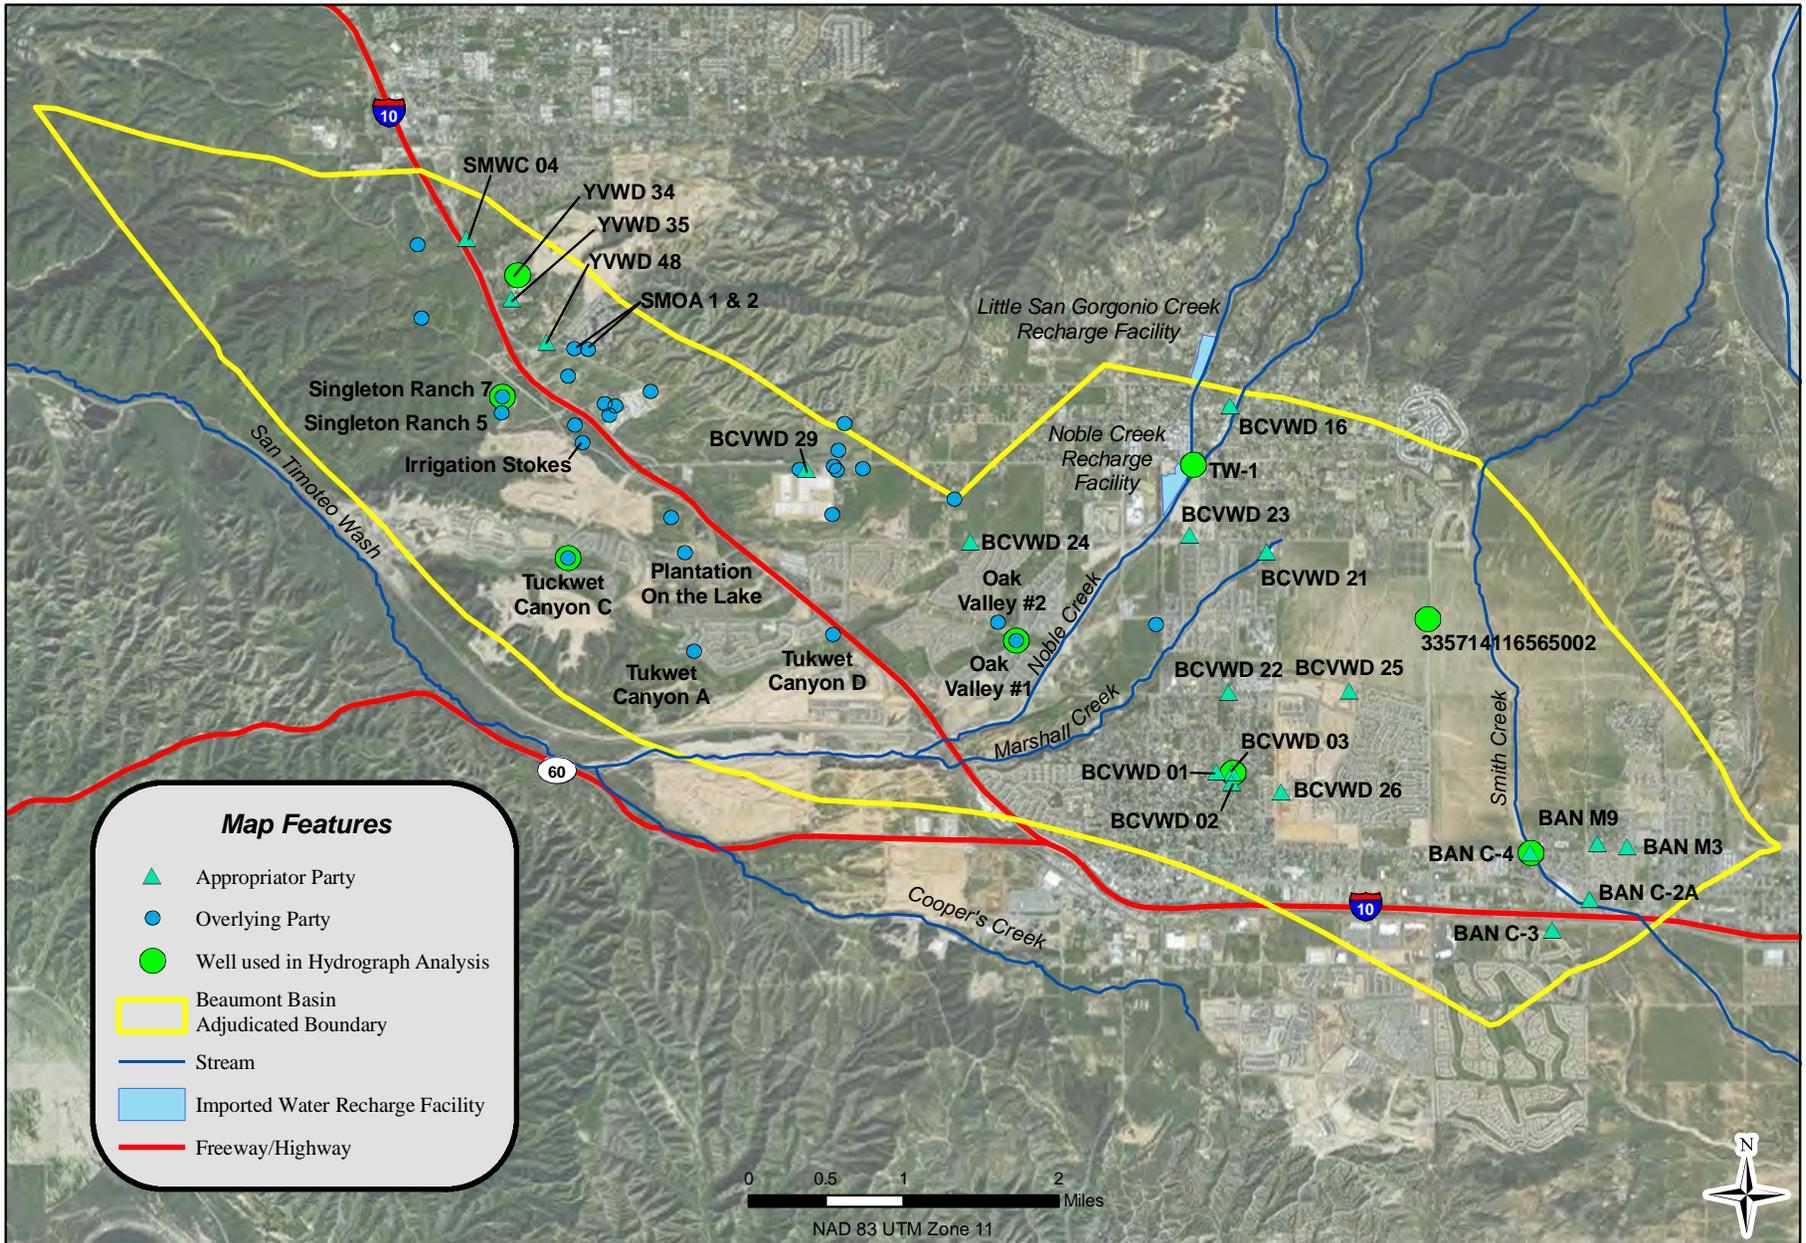

Map Features

- ▲ Appropriator Party
- Overlying Party
- Well used in Hydrograph Analysis
- Beaumont Basin Adjudicated Boundary
- Stream
- Imported Water Recharge Facility
- Freeway/Highway




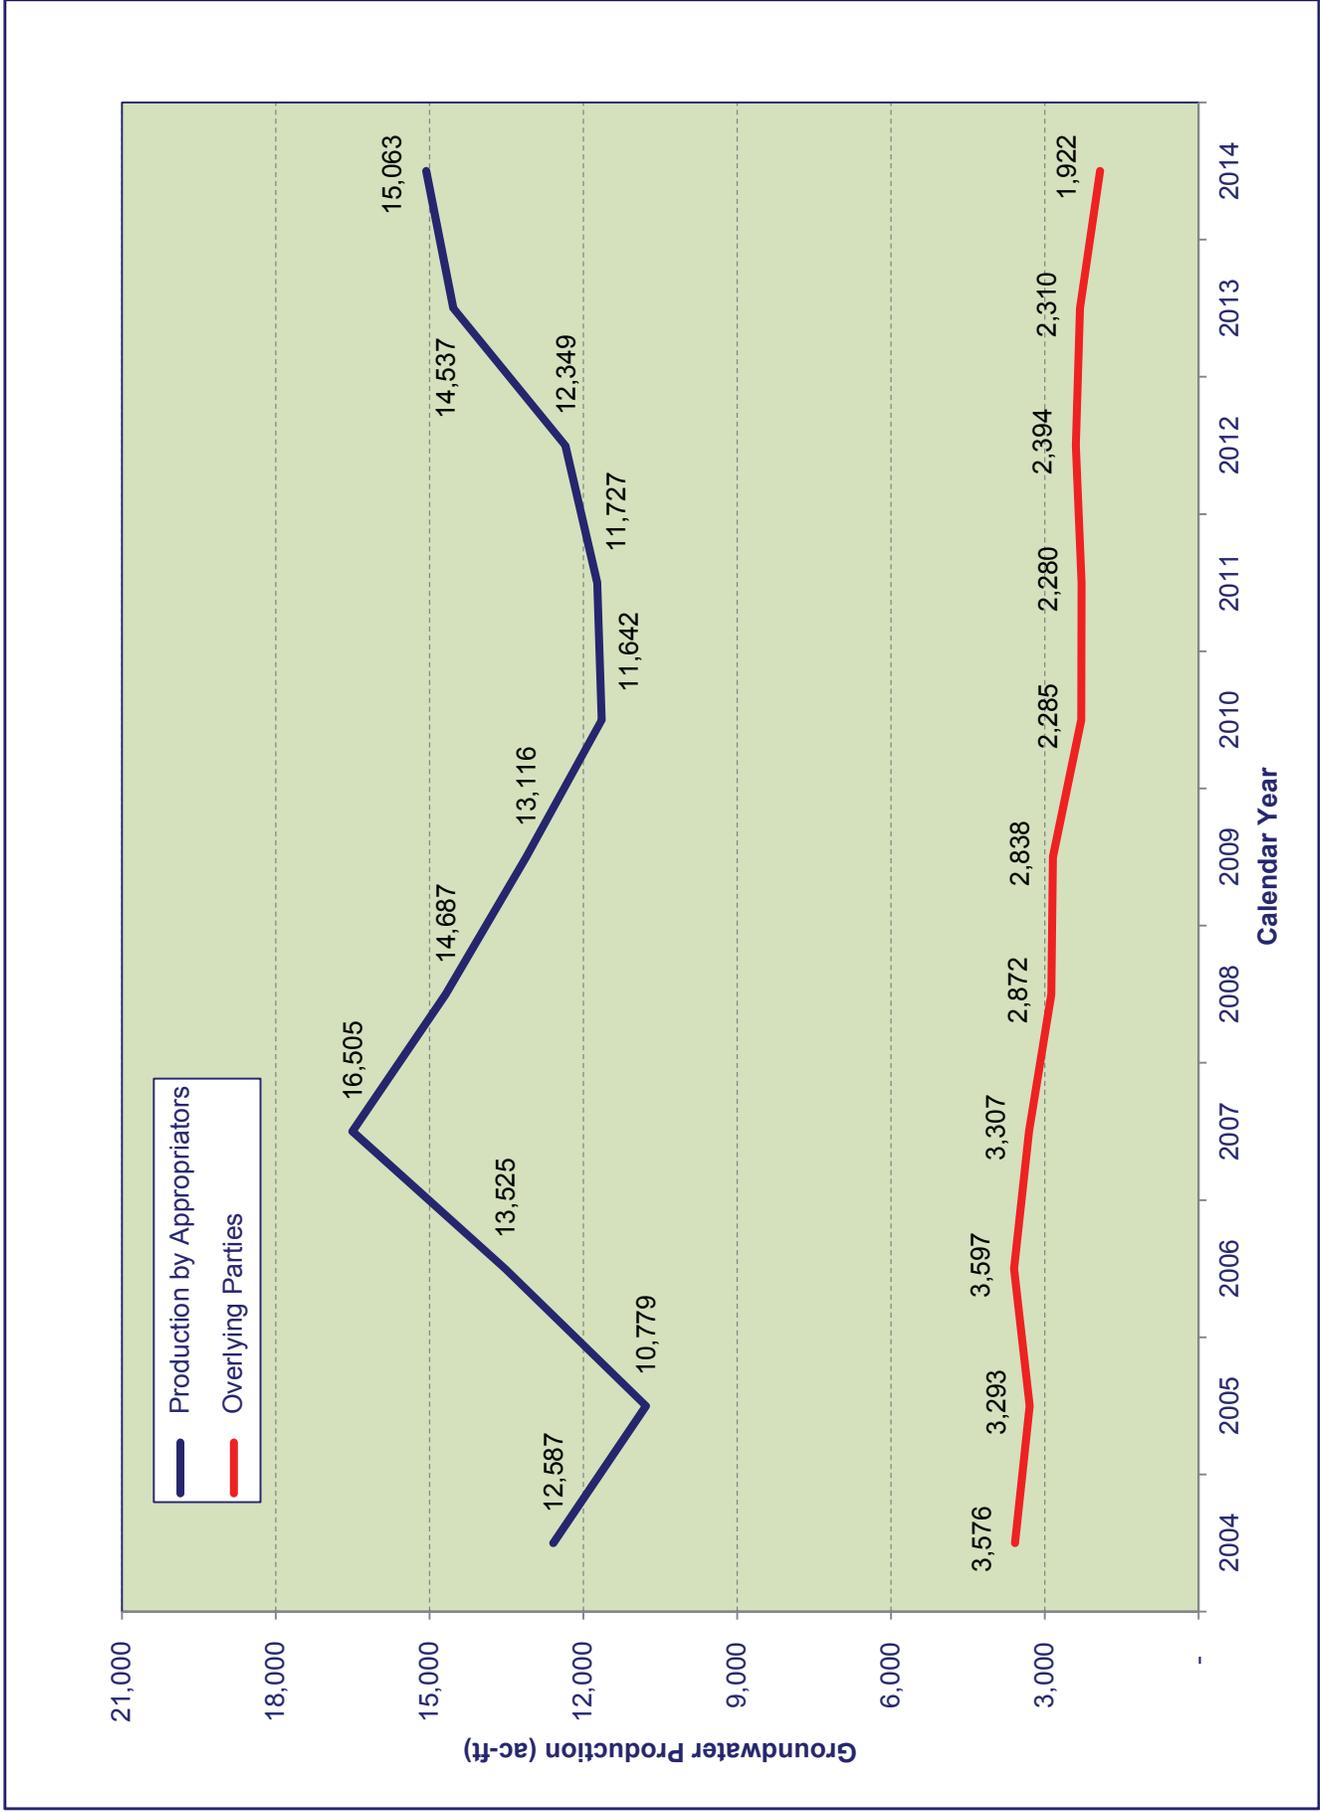


Figure 3-4
Annual Production by Appropriators and Overlaying Users (2003-14)




Alda, Inc. in association with

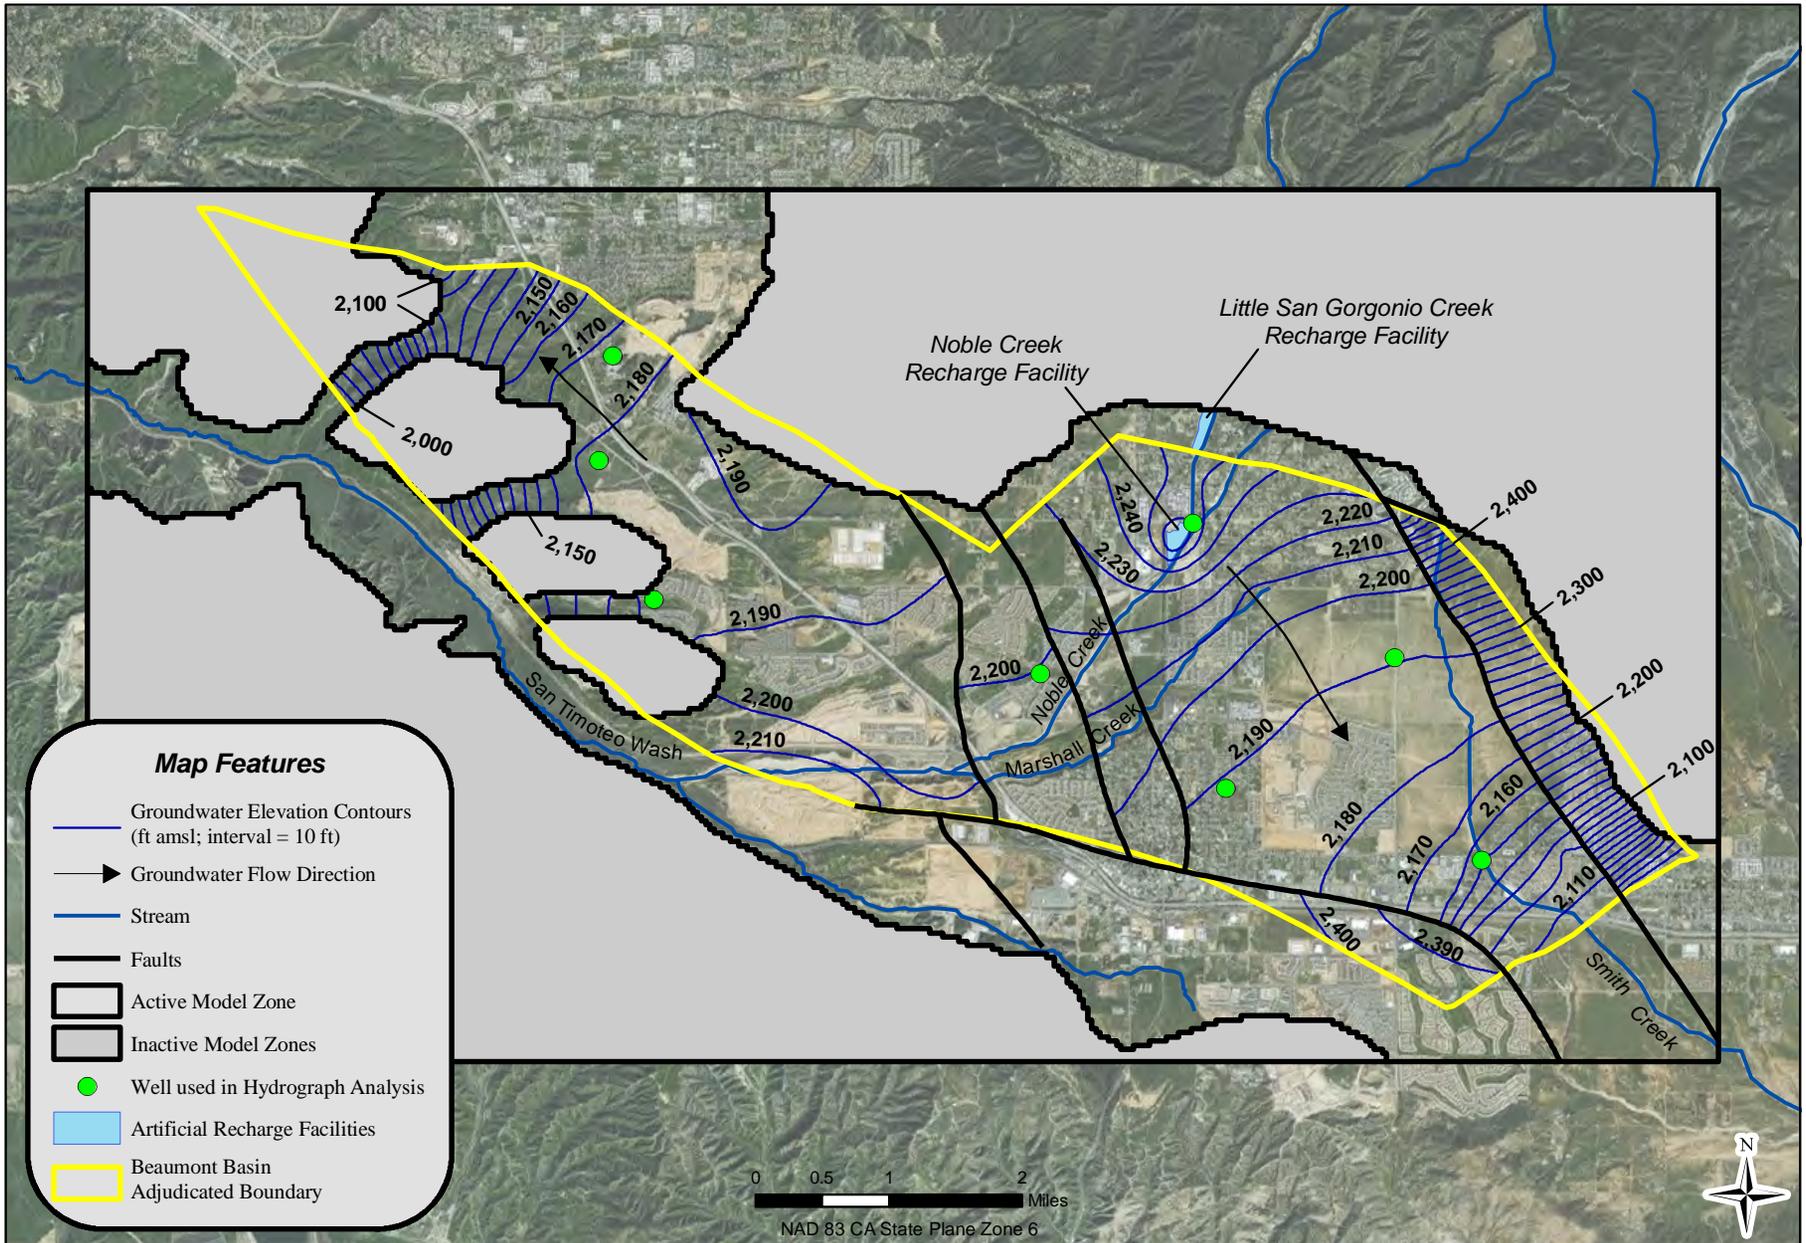

**Groundwater Elevation Contours
in the Beaumont Basin - Fall 2013**

Figure 3-5

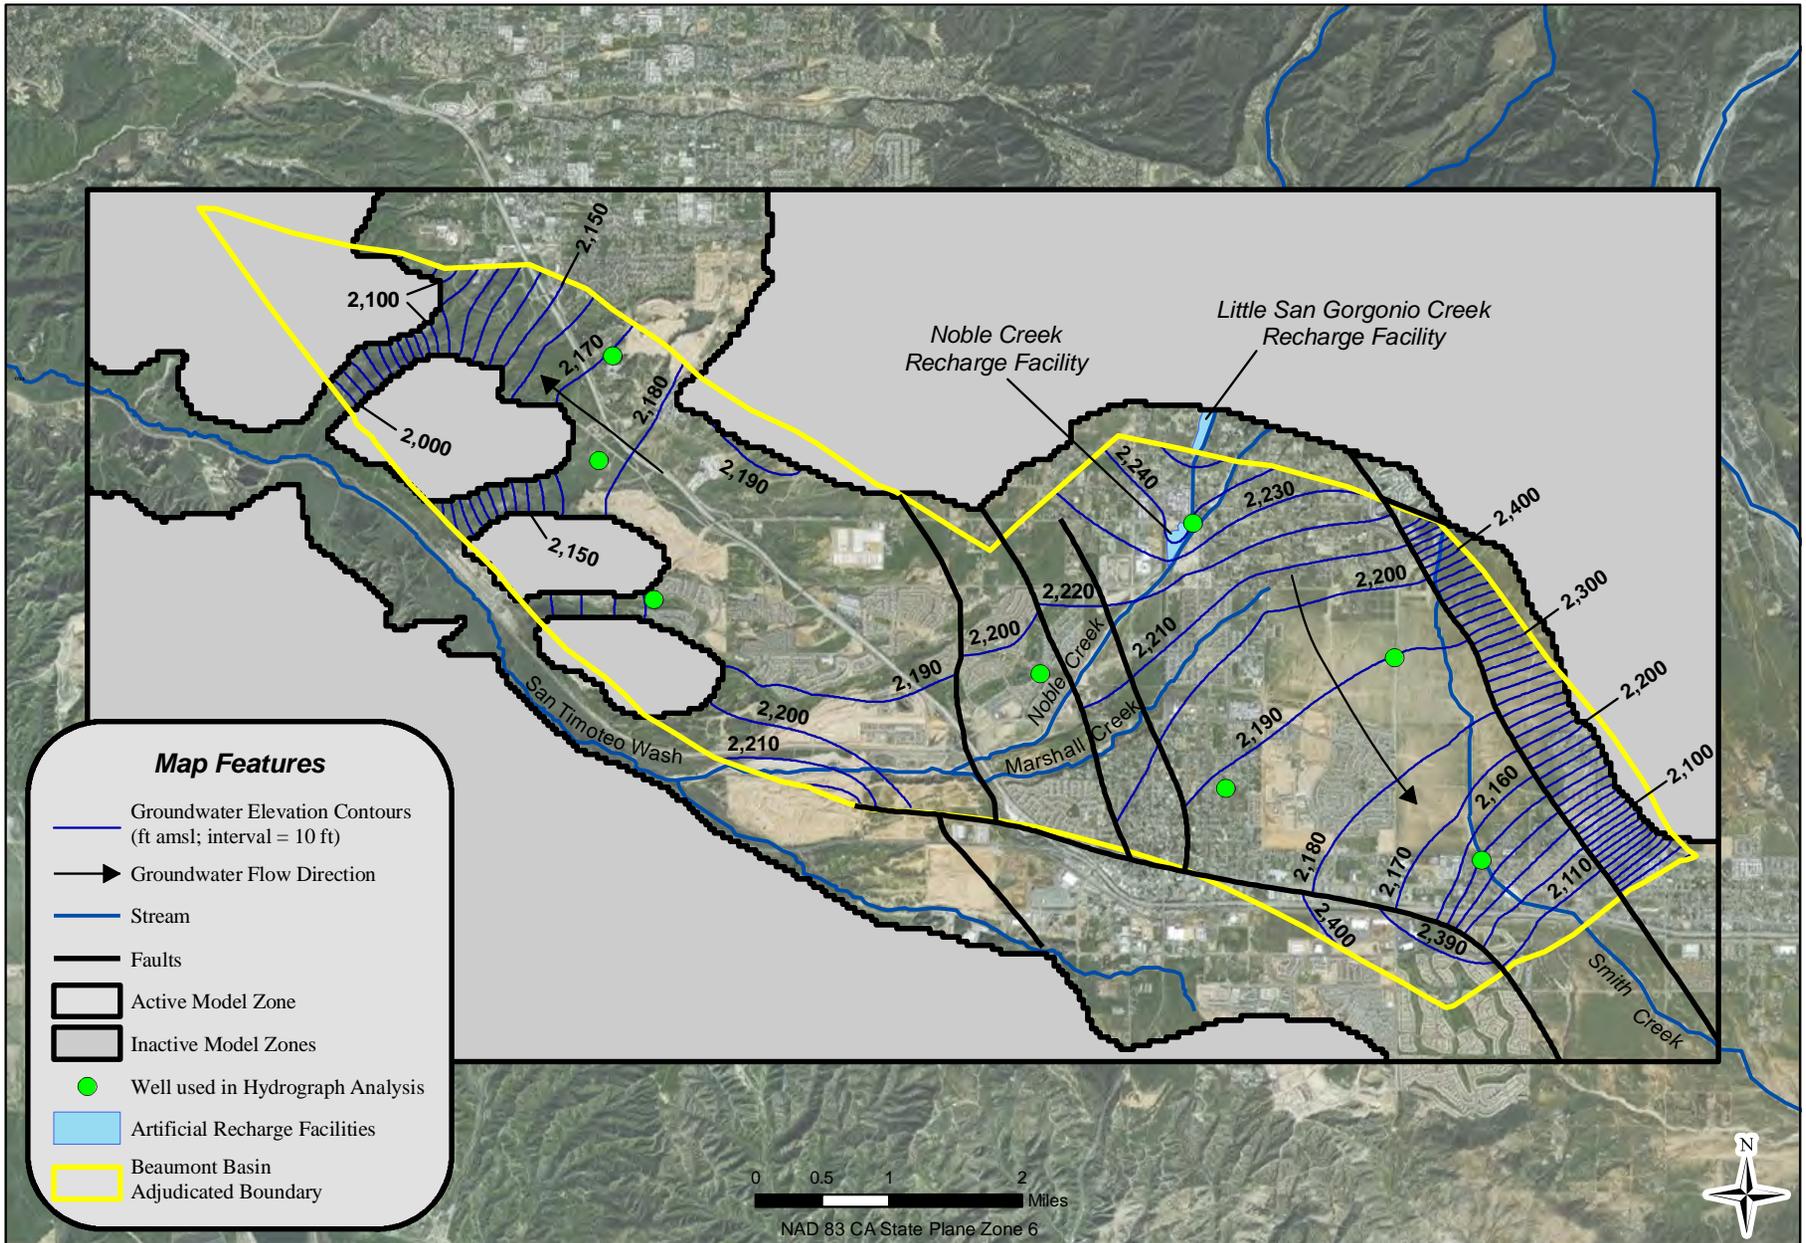


Alda, Inc. in association with

Thomas Harder & Co.
Groundwater Consulting

**Groundwater Elevation Contours
in the Beaumont Basin - Fall 2014**

Figure 3-6

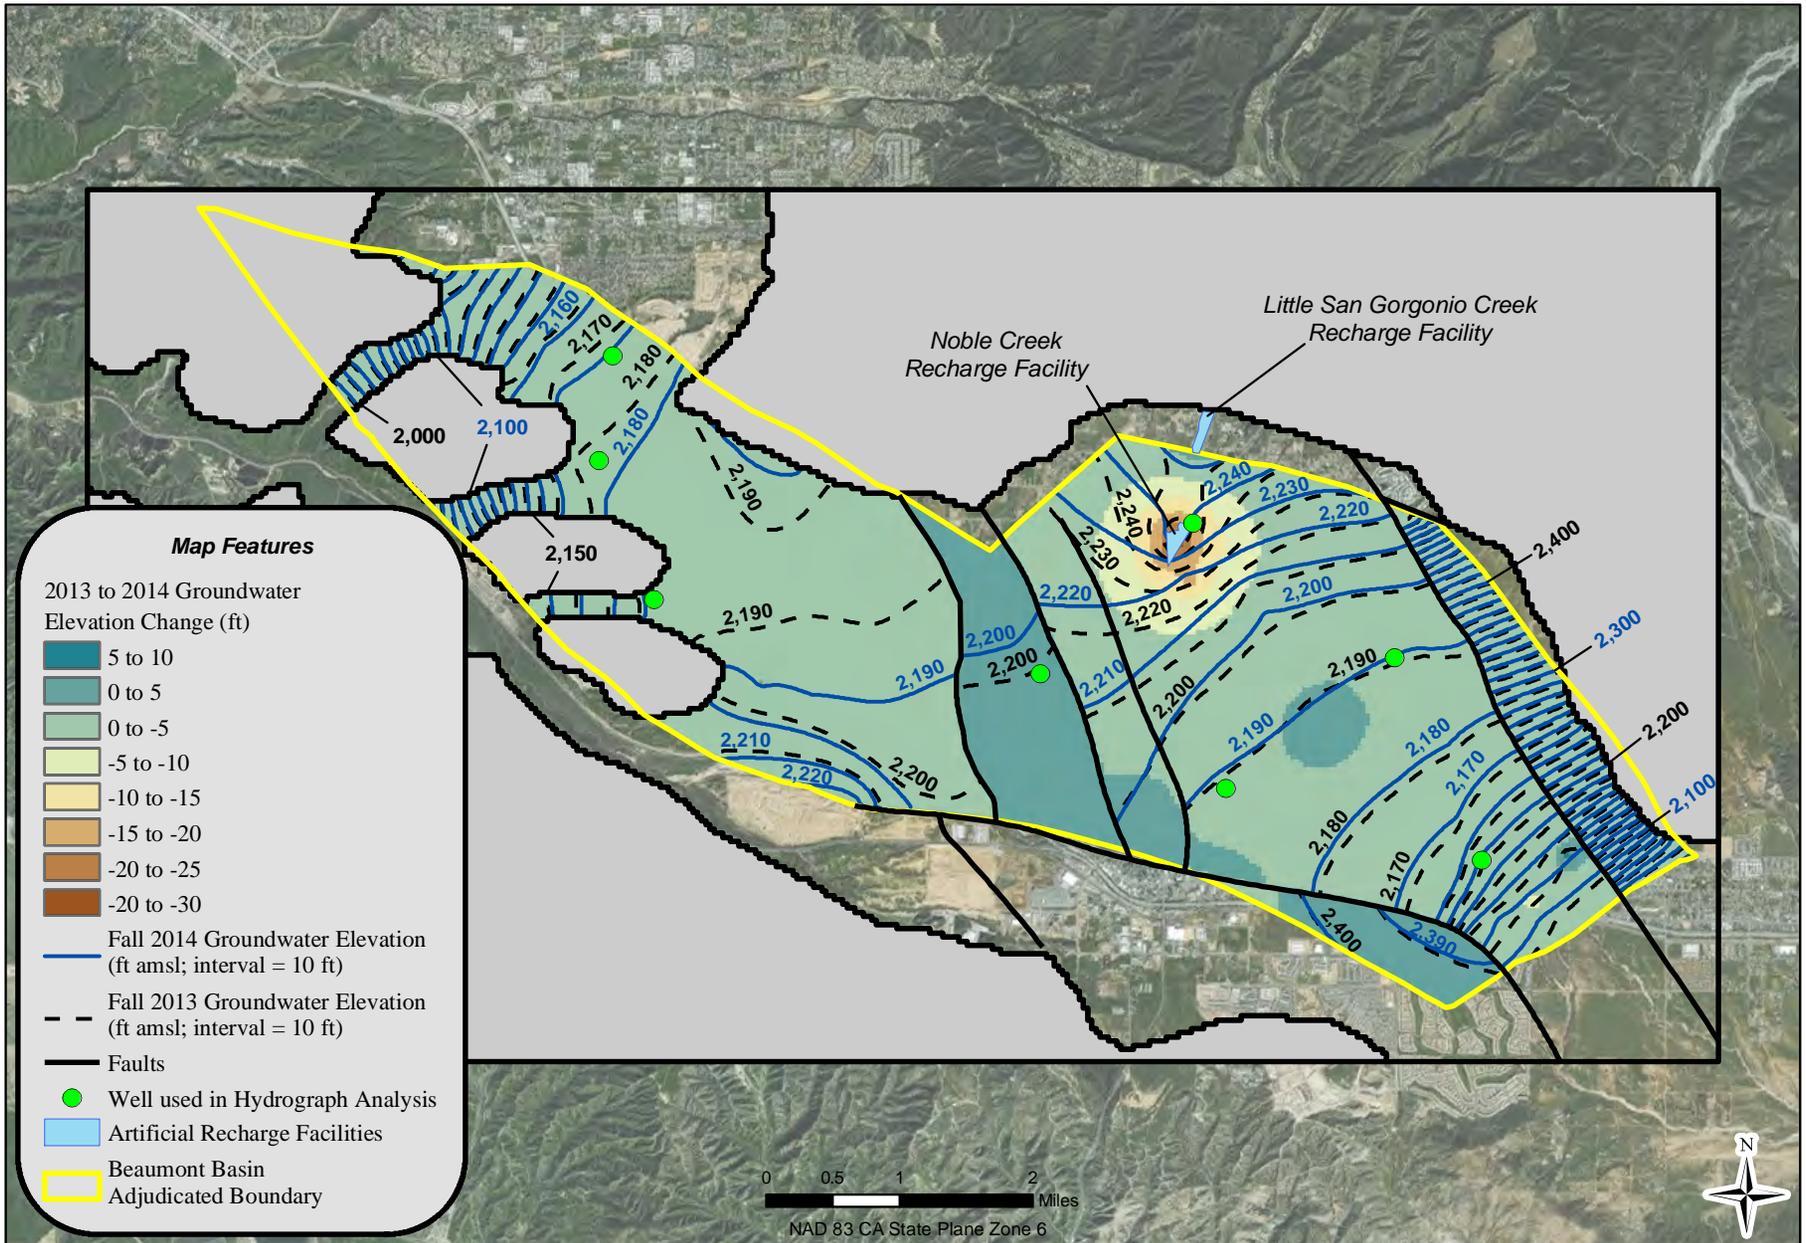


Alda, Inc. in association with



Change in Groundwater Elevation

2013 - 2014

Figure 3-7

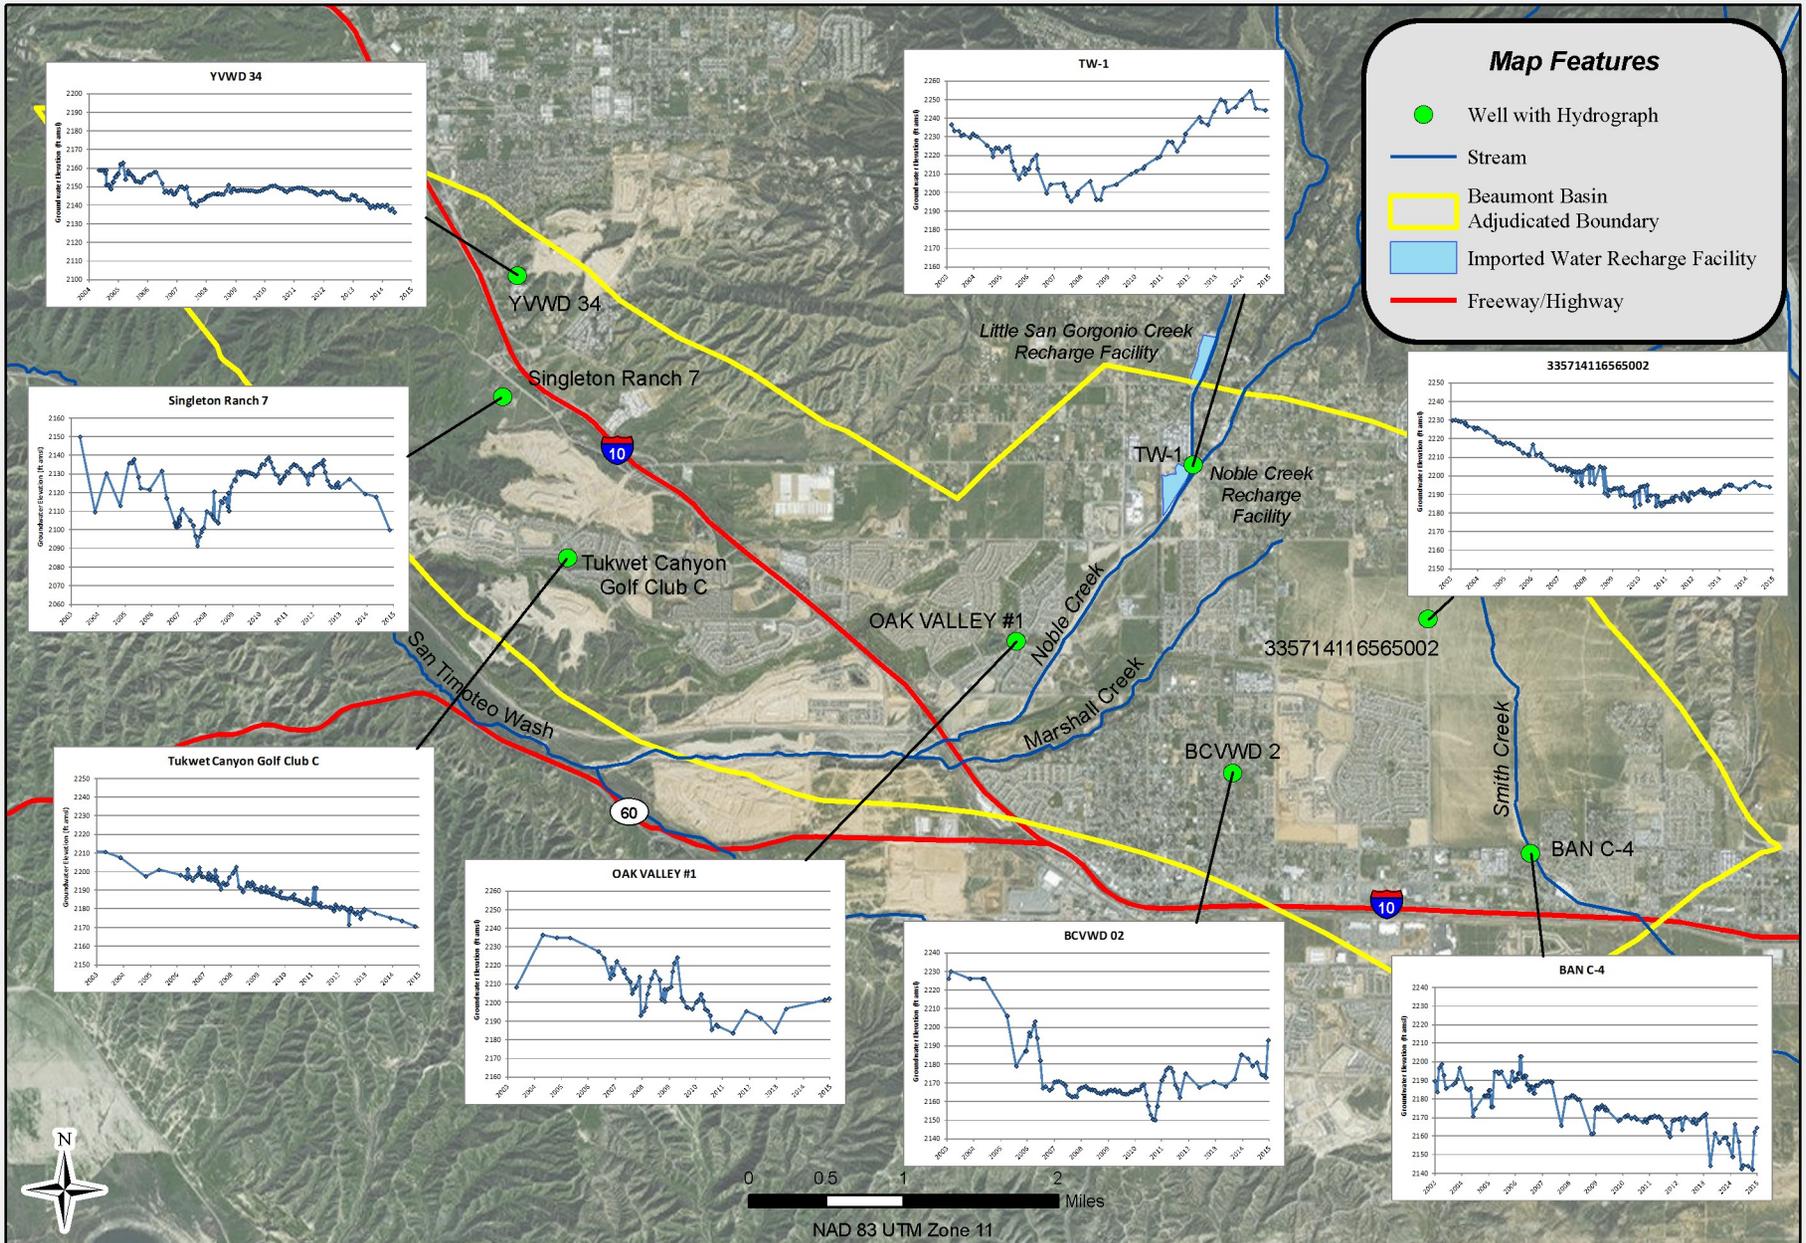

Alda, Inc. in association with
Thomas Harder & Co.
 Groundwater Consulting

**Groundwater Level Trends
 at Key Wells**
 Figure 3-8

Table 3-1
Appropriator Producer - Summary of Annual Production (2003 to 2009)

Owner & Well Name	Water Production by Well (ac-ft/yr) ⁽¹⁾								
	2003 ⁽²⁾	2004	2005	2006	2007	2008	2009		
Banning, City of									
Well C2-A	619.2	710.7	0.4	6.8	288.1	382.3	119.8		
Well C3	517.7	1,026.6	521.2	235.3	511.6	552.5	733.0		
Well C4	448.3	1,135.7	387.8	276.8	673.9	664.3	472.6		
Well M3	525.7	169.8	532.8	671.9	726.0	583.3	294.8		
Well M9	63.3	0.0	0.0	0.0	0.0	0.0	0.0		
From BCVWD ⁽³⁾	0.0	354.5	366.4	636.7	572.9	751.3	474.8		
Annual Production	2,174.2	3,397.3	1,808.6	1,827.5	2,772.6	2,933.6	2,095.0		
Eligible for Storage⁽⁴⁾	340.3	1,631.7	3,220.4	3,201.5	2,256.4	2,095.4	2,934.0		
Beaumont-Cherry Valley Water District									
Well 1	5.9	978.3	1,244.2	1,149.1	1,283.8	976.9	894.1		
Well 2	960.2	1,628.2	117.6	0.0	0.0	0.0	0.0		
Well 3	675.1	936.0	841.6	749.7	1,357.3	1,310.2	1,139.5		
Well 16	554.6	1,103.7	735.6	537.7	348.3	414.9	452.0		
Well 21	832.8	1,252.5	2,299.5	1,996.3	2,424.7	2,446.1	1,784.1		
Well 22	483.3	1,125.3	405.7	1,062.6	1,056.8	1,105.3	265.1		
Well 23	0.0	204.3	1,747.9	1,963.9	3,018.3	2,491.7	982.7		
Well 24				2,231.7	2,467.1	2,093.1	2,045.4		
Well 25					127.6	1,060.7	1,187.9		
Well 26					495.9		797.1		
Well 29									
To Banning ⁽³⁾	0.0	-354.5	-366.4	-636.7	-572.9	-751.3	-474.8		
Annual Production	3,511.9	6,873.9	7,025.6	9,054.1	11,383.3	10,710.5	10,133.9		
Eligible for Storage⁽⁴⁾	0.0	0.0	0.0	0.0	0.0	0.0	0.0		
South Mesa Water Company									
3rd No. 4 Well	223.2	482.5	663.2	616.0	665.8	470.9	382.2		
Annual Production	223.2	482.5	663.2	616.0	665.8	470.9	382.2		
Eligible for Storage⁽⁴⁾	774.8	1,513.5	1,332.8	1,380.0	1,330.2	1,525.2	1,613.8		
Yucaipa Valley Water District									
Well 35	58.9	226.3	117.5	220.0	163.8	3.2	0.0		
Well 48	1,103.5	1,607.4	1,163.7	1,807.2	1,519.1	568.8	504.4		
Annual Production	1,162.4	1,833.7	1,281.3	2,027.3	1,682.9	572.0	504.4		
Eligible for Storage⁽⁴⁾	0.0	339.3	891.7	145.7	490.1	1,601.0	1,668.6		
Annual Production	7,071.7	12,587.4	10,778.6	13,524.9	16,504.6	14,687.0	13,115.6		
Volume Eligible for Storage	1,115.1	3,484.5	5,445.0	4,727.2	4,076.7	5,221.5	6,216.4		

1.- Calendar Year Production. All values rounded and subject to revision based on receipt of more accurate information.
2.- 2003 Production only includes from July to December to account for first half of Fiscal Year 2004 Production.
3.- Pursuant to Part 1, Paragraph 3 B of the Judgment, and a separate Agreement (a copy of which is on file with the Watermaster).
4.- Volume of water available for storage is equal to the positive difference between the temporary surplus allocation and the volume of groundwater produced by each agency. Temporary surplus based on 16,000 ac-ft/yr allocated from Fiscal Year 2004 to Fiscal Year 2013. Annual allocation is as follows: a) City of Banning, 5,029 ac-ft/yr, b) Beaumont Cherry Valley Water District, 6,802 ac-ft/yr, c) South Mesa Water Company, 1,996 ac-ft/yr, and d) Yucaipa Valley Water District, 2,173 ac-ft/yr. Allocations for 2003 are based on 50 percent of the annual allocation to account for the second half of the year only.

**Table 3-1A
Appropriator Producer - Summary of Production for Calendar Year 2010 (ac-ft)**

Owner & Well Name	Water Production by Appropriator (ac-ft) ⁽¹⁾												Total Production	Eligible for Storage ⁽²⁾
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec		
Banning, City of														
Well C2-A	0.5	0.0	2.6	0.3	0.4	0.3	1.6	1.3	9.6	8.4	0.9	1.0	26.8	
Well C3	35.4	12.7	8.9	49.4	119.2	107.0	113.8	120.6	114.8	47.1	76.1	38.1	843.0	
Well C4	3.4	0.4	2.9	0.6	0.5	0.6	3.5	22.3	14.3	0.3	1.6	1.1	51.4	
Well M3	1.1	0.2	7.3	0.3	0.2	11.4	30.5	21.4	1.9	3.5	0.4	1.8	80.0	
Well M9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
From BCVWD ⁽³⁾	65.8	59.3	17.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	142.5	
Subtotal	106.3	72.6	39.0	50.6	120.2	119.3	149.3	165.6	140.5	59.3	78.9	42.0	1,143.6	3,885.4
Beaumont-Cherry Valley Water District														
Well 1	36.7	50.6	53.3	48.2	73.9	98.7	115.0	87.5	116.1	68.5	46.3	14.3	809.1	
Well 2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Well 3	44.3	60.7	57.3	57.2	91.1	116.5	155.6	119.1	73.7	0.0	0.0	0.0	775.6	
Well 16	0.3	1.2	0.5	2.6	0.0	0.6	2.5	0.5	0.7	1.5	0.7	0.9	11.9	
Well 21	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7.2	0.0	1.5	0.0	8.7	
Well 22	52.4	43.0	41.6	20.0	6.4	11.3	69.1	42.5	80.4	9.0	4.6	1.4	381.7	
Well 23	96.5	45.7	106.0	156.3	182.2	203.0	271.3	217.3	296.4	146.1	101.6	108.1	1,930.4	
Well 24	110.2	293.4	148.8	166.2	226.2	219.2	243.5	178.7	255.7	88.3	128.1	141.4	2,199.6	
Well 25	12.5	0.0	25.2	44.1	155.0	191.8	250.0	209.1	196.7	138.3	66.8	11.0	1,300.4	
Well 26	85.9	59.3	69.7	97.2	150.6	144.3	159.9	124.0	167.1	66.6	96.8	90.8	1,312.2	
Well 29	39.1	0.0	0.0	0.0	0.5	89.6	165.8	131.7	177.9	92.7	86.9	50.2	834.4	
To Banning ⁽³⁾	-65.8	-59.3	-17.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-142.5	
Subtotal	412.0	494.6	485.1	591.8	885.9	1,075.0	1,432.7	1,110.3	1,371.8	611.0	533.1	418.1	9,421.3	0.0
South Mesa Water Company														
3rd No. 4 Well	18.1	14.9	16.6	23.0	32.1	52.4	53.8	58.2	56.5	32.5	32.4	14.5	405.0	
Subtotal	18.1	14.9	16.6	23.0	32.1	52.4	53.8	58.2	56.5	32.5	32.4	14.5	405.0	1,591.1
Yucaipa Valley Water District														
Well 35	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Well 48	6.4	0.9	21.5	18.0	59.6	84.2	127.4	115.6	137.3	44.3	33.6	23.6	672.4	
Subtotal	6.4	0.9	21.5	18.0	59.6	84.2	127.4	115.6	137.3	44.3	33.6	23.6	672.4	1,500.6
Total	542.7	583.0	562.1	683.3	1,097.9	1,331.0	1,763.2	1,449.8	1,706.1	747.1	678.0	498.2	11,642.3	6,977.0

1.- All values rounded and subject to revision based on receipt of more accurate information
2.- Volume of water available for storage is equal to the positive difference between the temporary surplus allocation and the volume of groundwater produced by each agency. Temporary surplus based on 16,000 ac-ft/yr allocated from Fiscal Year 2004 to Fiscal Year 2013. Annual allocation is as follows: a) City of Banning, 5,029 ac-ft/yr, b) Beaumont Cherry Valley Water District, 6,802 ac-ft/yr, c) South Mesa Water Company, 1,996 ac-ft/yr, and d) Yucaipa Valley Water District, 2,173 ac-ft/yr.
3.- Pursuant to Part I, Paragraph 3 B of the Judgment, and a separate Agreement (a copy of which is on file with the Watermaster).

**Table 3-1B
Appropriator Producer - Summary of Production for Calendar Year 2011 (ac-ft)**

Owner & Well Name	Water Production by Appropriator (ac-ft) ⁽¹⁾												Total Production	Eligible for Storage ⁽²⁾
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec		
Banning, City of														
Well C2-A	0.4	0.6	1.2	0.3	0.3	12.5	10.4	1.3	0.9	1.2	0.4	3.2	32.5	
Well C3	24.5	24.7	41.9	59.0	107.5	111.8	95.6	45.5	45.9	80.3	52.8	87.1	776.6	
Well C4	0.9	0.9	1.4	1.2	1.0	3.5	95.5	82.3	7.6	2.2	0.5	0.6	197.5	
Well M3	0.5	0.3	0.4	0.3	0.6	10.7	91.6	109.8	99.7	19.2	0.8	1.2	335.1	
Well M9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
From BCVWD ⁽³⁾	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Subtotal	26.3	26.5	45.0	60.7	109.5	138.4	293.1	239.0	154.0	103.0	54.4	92.0	1,341.7	3,687.3
Beaumont-Cherry Valley Water District														
Well 1	7.1	0.5	20.5	20.8	66.4	75.7	79.1	87.5	65.0	31.3	4.8	2.9	461.7	
Well 2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Well 3	0.0	6.6	19.6	12.0	70.0	83.6	92.0	105.7	80.0	34.9	27.2	4.0	535.6	
Well 16	1.7	0.0	0.0	0.0	1.3	1.7	2.1	15.5	58.2	37.2	20.4	15.6	153.8	
Well 21	0.0	0.0	0.0	0.0	105.7	159.8	218.3	218.0	205.1	190.5	156.5	219.3	1,473.3	
Well 22	2.8	0.0	0.0	2.8	5.8	0.0	0.0	21.8	58.0	3.9	0.0	0.0	95.1	
Well 23	84.6	78.2	43.8	6.1	130.7	172.0	247.9	205.7	0.0	0.0	0.0	13.1	982.1	
Well 24	206.4	161.6	116.5	167.6	139.2	163.7	235.8	229.9	210.9	156.5	94.9	162.7	2,045.7	
Well 25	0.3	2.7	10.0	116.2	136.1	30.8	82.6	184.6	245.8	208.4	80.4	90.8	1,188.6	
Well 26	127.4	113.1	77.8	108.8	119.7	111.9	158.4	154.1	136.2	124.9	98.9	104.3	1,435.3	
Well 29	0.0	6.8	65.8	91.0	109.9	132.6	165.4	165.4	150.5	112.8	56.8	3.5	1,060.3	
To Banning ⁽³⁾	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Subtotal	430.1	369.5	354.0	525.2	884.7	931.7	1,281.8	1,388.3	1,209.7	900.4	540.0	616.0	9,431.3	0.0
South Mesa Water Company														
3rd No. 4 Well	18.3	16.8	19.9	20.7	30.2	50.9	52.9	56.8	52.3	45.2	30.3	25.5	419.9	
Subtotal	18.3	16.8	19.9	20.7	30.2	50.9	52.9	56.8	52.3	45.2	30.3	25.5	419.9	1,576.1
Yucaipa Valley Water District														
Well 35	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Well 48	27.37	23.43	22.25	33.71	50.16	67.00	84.85	82.47	76.06	46.97	12.18	7.69	534.1	
Subtotal	27.4	23.4	22.3	33.7	50.2	67.0	84.9	82.5	76.1	47.0	12.2	7.7	534.1	1,638.9
Total	502.1	436.2	441.2	640.3	1,074.6	1,188.1	1,712.6	1,766.5	1,492.1	1,095.5	636.8	741.1	11,727.1	6,902.3

1.- All values rounded and subject to revision based on receipt of more accurate information

2.- Volume of water available for storage is equal to the positive difference between the temporary surplus allocation and the volume of groundwater produced by each agency. Temporary surplus based on 16,000 ac-ft/yr allocated from Fiscal Year 2004 to Fiscal Year 2013. Annual allocation is as follows: a) City of Banning, 5,029 ac-ft/yr; b) Beaumont Cherry Valley Water District, 6,802 ac-ft/yr; c) South Mesa Water Company, 1,996 ac-ft/yr; and d) Yucaipa Valley Water District, 2,173 ac-ft/yr.

3.- Pursuant to Part I, Paragraph 3 B of the Judgment, and a separate Agreement (a copy of which is on file with the Watermaster).

**Table 3-1C
Appropriator Producer - Summary of Production for Calendar Year 2012 (ac-ft)**

Owner & Well Name	Water Production by Appropriator (ac-ft) ⁽¹⁾												Total Production	Eligible for Storage ⁽²⁾
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec		
Banning, City of														
Well C2-A	0.5	0.4	0.4	2.3	0.3	0.7	1.4	6.1	0.2	0.2	0.4	0.2	13.1	
Well C3	95.4	82.2	64.5	85.2	107.5	25.9	20.1	47.1	41.4	29.9	8.6	0.3	607.9	
Well C4	0.7	0.7	0.4	0.2	1.0	13.3	2.2	26.9	23.4	3.0	1.0	0.2	73.0	
Well M3	0.6	0.2	0.5	1.4	0.6	76.1	80.0	72.3	68.4	37.9	2.3	3.9	344.2	
Well M9	-	-	-	-	-	-	-	-	-	-	-	-	0.0	
From BCVWD ⁽³⁾	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Subtotal	97.1	83.4	65.8	89.1	109.5	116.1	103.6	152.3	133.3	71.0	12.4	4.7	1,038.3	3,990.7
Beaumont-Cherry Valley Water District														
Well 1	-	-	-	3.02	72.03	18.84	-	-	-	-	-	-	93.9	
Well 2	-	-	-	-	-	-	-	-	-	-	-	-	0.0	
Well 3	-	-	-	2.99	60.85	130.94	150.25	140.12	90.97	64.36	60.38	15.76	716.6	
Well 16	-	-	0.01	-	17.17	45.11	72.41	53.98	39.05	8.15	15.87	3.27	255.0	
Well 21	192.55	165.40	193.32	174.32	205.19	209.22	216.61	200.54	211.30	180.71	0.77	85.08	2,035.0	
Well 22	-	1.50	-	-	18.64	141.42	136.12	76.60	106.07	34.37	-	-	514.7	
Well 23	24.66	99.04	82.69	28.94	-	1.04	40.21	188.67	94.27	157.50	115.95	21.67	854.6	
Well 24	143.87	139.27	124.45	155.98	107.88	185.79	207.00	138.86	145.87	148.56	160.36	106.24	1,764.1	
Well 25	100.50	27.80	-	78.74	222.76	245.35	257.70	238.09	264.00	139.88	76.09	30.02	1,680.9	
Well 26	97.20	93.20	76.80	54.20	147.45	147.78	131.49	126.50	115.35	121.99	104.40	64.56	1,280.9	
Well 29	1.59	-	-	30.41	85.06	138.76	156.83	150.64	129.68	129.06	92.69	51.35	966.1	
To Banning ⁽³⁾	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Subtotal	560.4	526.2	477.3	528.6	937.0	1,264.3	1,368.6	1,314.0	1,196.6	984.6	626.5	378.0	10,162.0	0.0
South Mesa Water Company														
3rd No. 4 Well	27.77	23.65	23.13	23.22	41.79	70.07	69.08	62.75	53.24	27.30	8.18	18.32	448.5	
Subtotal	27.8	23.7	23.1	23.2	41.8	70.1	69.1	62.8	53.2	27.3	8.2	18.3	448.5	1,547.5
Yucaipa Valley Water District														
Well 35	-	-	-	-	-	-	-	-	-	-	-	-	0.0	
Well 48	7.19	39.11	19.00	37.39	76.94	100.79	108.51	129.60	70.41	67.78	31.59	11.79	700.1	
Subtotal	7.2	39.1	19.0	37.4	76.9	100.8	108.5	129.6	70.4	67.8	31.6	11.8	700.1	1,472.9
Total	692.5	672.4	585.2	678.4	1,165.3	1,551.2	1,649.8	1,658.6	1,453.5	1,150.6	678.6	412.7	12,348.9	7,011.1

1.- All values rounded and subject to revision based on receipt of more accurate information

2.- Volume of water available for storage is equal to the positive difference between the temporary surplus allocation and the volume of groundwater produced by each agency. Temporary surplus based on 16,000 ac-ft/yr allocated from Fiscal Year 2004 to Fiscal Year 2013. Annual allocation is as follows: a) City of Banning, 5,029 ac-ft/yr; b) Beaumont Cherry Valley Water District, 6,802 ac-ft/yr; c) South Mesa Water Company, 1,996 ac-ft/yr; and d) Yucaipa Valley Water District, 2,173 ac-ft/yr.

3.- Pursuant to Part I, Paragraph 3 B of the Judgment, and a separate Agreement (a copy of which is on file with the Watermaster).

**Table 3-1D
Appropriator Producer - Summary of Production for Calendar Year 2013 (ac-ft)**

Owner & Well Name	Water Production by Appropriator (ac-ft) ⁽¹⁾												Total Production	Eligible for Storage ⁽²⁾
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec		
Banning, City of														
Well C2-A	0.3	0.3	0.2	0.7	0.3	0.4	35.5	52.8	7.2	10.7	4.0	3.2	115.5	
Well C3	3.0	0.1	2.2	56.6	76.2	92.1	78.7	82.0	79.5	70.9	47.1	38.3	626.7	
Well C4	0.5	2.8	126.0	140.6	97.6	100.5	116.2	87.3	56.0	48.1	23.8	59.0	858.5	
Well M3	0.1	66.4	0.1	0.0	0.0	0.0	12.6	69.9	84.6	99.8	79.3	87.1	499.9	
Well M9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
From BCVWD ⁽³⁾	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Subtotal	4.0	69.7	128.5	197.9	174.1	193.0	243.0	292.1	227.3	229.4	154.1	187.6	2,100.7	2,928.3
Beaumont-Cherry Valley Water District														
Well 1	0.6	0.0	0.0	0.3	74.0	95.9	121.9	2.2	0.0	0.0	0.0	0.0	294.9	
Well 2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Well 3	0.5	0.0	0.0	0.0	79.2	113.9	154.4	160.8	139.9	104.0	26.5	9.9	789.2	
Well 16	0.2	0.0	35.7	52.4	43.2	53.3	0.0	45.2	53.6	41.6	9.2	26.5	360.8	
Well 21	47.1	50.6	170.6	188.9	226.7	215.4	189.1	225.5	226.6	211.0	199.5	190.2	2,141.1	
Well 22	0.0	0.0	0.0	0.0	48.0	94.0	43.1	76.5	72.7	4.5	9.7	10.3	358.9	
Well 23	0.7	0.0	54.0	36.2	168.0	198.6	240.1	89.7	0.0	0.0	0.0	0.0	787.3	
Well 24	157.5	123.4	128.7	159.7	109.3	122.6	100.2	118.8	123.4	120.1	118.1	144.6	1,526.5	
Well 25	78.6	77.8	80.8	165.8	112.5	144.0	204.6	292.8	287.0	253.9	203.3	132.5	2,033.4	
Well 26	70.2	75.7	80.7	125.0	115.4	144.8	148.6	155.9	146.2	126.8	68.6	0.0	1,257.9	
Well 29	64.0	65.9	93.1	123.2	144.0	144.6	192.4	89.0	273.7	144.6	118.5	94.3	1,547.3	
To Banning ⁽³⁾	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Subtotal	419.3	393.4	643.7	851.4	1,120.4	1,327.2	1,394.4	1,256.4	1,323.2	1,006.5	753.4	608.4	11,097.4	0.0
South Mesa Water Company														
3rd No. 4 Well	18.09	14.48	22.02	26.88	31.13	42.36	47.77	45.59	34.45	25.58	-	-	308.4	
Subtotal	18.1	14.5	22.0	26.9	31.1	42.4	47.8	45.6	34.5	25.6	0.0	0.0	308.4	1,687.7
Yucaipa Valley Water District														
Well 35	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Well 48	0.0	17.0	72.8	106.0	95.6	135.6	188.2	198.0	99.5	106.5	11.6	0.0	1,030.8	
Subtotal	0.0	17.0	72.8	106.0	95.6	135.6	188.2	198.0	99.5	106.5	11.6	0.0	1,030.8	1,142.2
Total	441.3	494.5	867.0	1,182.1	1,421.2	1,698.1	1,873.4	1,792.1	1,684.5	1,368.0	919.1	796.0	14,537.2	5,758.2

1.- All values rounded and subject to revision based on receipt of more accurate information

2.- Volume of water available for storage is equal to the positive difference between the temporary surplus allocation and the volume of groundwater produced by each agency. Temporary surplus based on 16,000 ac-ft/yr allocated from Fiscal Year 2004 to Fiscal Year 2013. Annual allocation is as follows: a) City of Banning, 5,029 ac-ft/yr, b) Beaumont Cherry Valley Water District, 6,802 ac-ft/yr, c) South Mesa Water Company, 1,996 ac-ft/yr, and d) Yucaipa Valley Water District, 2,173 ac-ft/yr.

3.- Pursuant to Part 1, Paragraph 3 B of the Judgment, and a separate Agreement (a copy of which is on file with the Watermaster).

**Table 3-1E
Appropriator Producer - Summary of Production for Calendar Year 2014 (ac-ft)**

Owner & Well Name	Water Production by Appropriator (ac-ft) ⁽¹⁾												Total Production	Eligible for Storage ⁽²⁾
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec		
Banning, City of														
Well C2-A	0.9	26.3	93.5	87.4	73.1	71.3	71.2	52.3	9.2	15.6	29.4	0.3	530.5	
Well C3	68.2	26.7	2.4	26.9	58.6	66.8	73.0	61.9	46.7	49.2	41.3	5.2	526.8	
Well C4	64.1	1.5	21.2	39.4	124.4	112.9	110.1	103.3	118.1	114.5	47.7	0.2	857.7	
Well M3	98.4	71.4	96.7	80.2	26.2	68.4	29.3	37.7	92.0	69.4	0.0	0.4	670.0	
Well M9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
From BCVWD ⁽³⁾	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Subtotal	231.7	125.9	213.9	233.9	282.2	319.4	283.6	255.2	265.9	248.7	118.4	6.0	2,585.1	2,443.9
Beaumont-Cherry Valley Water District														
Well 1	0.0	0.0	0.0	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.9	
Well 2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Well 3	7.4	81.4	72.5	140.9	143.4	161.8	192.3	124.1	135.0	122.2	85.1	15.6	1,281.8	
Well 16	21.7	0.0	0.0	0.0	0.0	0.0	0.0	35.1	45.5	51.3	20.7	7.8	182.2	
Well 21	229.5	181.2	184.3	170.1	231.5	242.0	283.3	262.8	211.4	212.5	177.6	174.4	2,560.7	
Well 22	0.1	0.0	0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	
Well 23	0.0	0.0	0.0	0.0	76.2	208.3	211.0	133.9	92.7	90.6	165.2	103.3	1,081.0	
Well 24	198.6	80.7	128.0	104.6	110.0	94.1	2.4	0.0	86.1	147.6	108.7	5.9	1,066.7	
Well 25	227.3	164.1	175.4	234.7	259.9	279.0	372.6	285.9	188.3	170.9	26.3	2.4	2,386.8	
Well 26	0.0	0.0	8.2	9.1	0.3	0.0	0.0	55.6	142.3	123.2	89.8	93.3	521.9	
Well 29	119.0	88.7	102.0	128.1	172.9	198.3	210.9	180.6	172.3	158.4	120.1	65.2	1,716.5	
To Banning ⁽³⁾	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Subtotal	803.6	596.1	671.3	794.4	994.3	1,183.5	1,272.5	1,078.1	1,073.7	1,076.7	793.6	467.8	10,805.5	0.0
South Mesa Water Company														
3rd No. 4 Well	17.43	24.26	56.87	30.32	38.34	50.25	56.87	46.55	54.69	45.88	33.22	19.04	473.7	
Subtotal	17.4	24.3	56.9	30.3	38.3	50.3	56.9	46.6	54.7	45.9	33.2	19.0	473.7	1,522.3
Yucaipa Valley Water District														
Well 35	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Well 48	5.1	57.0	81.7	143.3	96.6	127.1	136.5	108.9	127.9	156.6	117.9	39.9	1,198.5	
Subtotal	5.1	57.0	81.7	143.3	96.6	127.1	136.5	108.9	127.9	156.6	117.9	39.9	1,198.5	974.6
Total	1,057.8	803.4	1,023.8	1,201.9	1,411.5	1,680.2	1,749.4	1,488.8	1,522.2	1,527.9	1,063.1	532.8	15,062.8	4,940.8

1.- All values rounded and subject to revision based on receipt of more accurate information

2.- Volume of water available for storage is equal to the positive difference between the temporary surplus allocation and the volume of groundwater produced by each agency. Temporary surplus based on 16,000 ac-ft/yr allocated from Fiscal Year 2004 to Fiscal Year 2013. Annual allocation is as follows: a) City of Banning, 5,029 ac-ft/yr, b) Beaumont Cherry Valley Water District, 6,802 ac-ft/yr, c) South Mesa Water Company, 1,996 ac-ft/yr, and d) Yucaipa Valley Water District, 2,173 ac-ft/yr.

3.- Pursuant to Part I, Paragraph 3 B of the Judgment, and a separate Agreement (a copy of which is on file with the Watermaster).

**Table 3-2A
Overlying Producer - Summary of Production for Calendar Year 2003 (ac-ft)**

Owner and Well Name	Metered	Monthly Water Production by Overlying Producers ⁽¹⁾							Total ⁽²⁾ Production (Jul- Dec)	Overlying Water Right FY 03/04	Overlying Water Right (Jul-Dec) 2003	Unused Overlying Allocation in 2003
		Jul	Aug	Sep	Oct	Nov	Dec					
Beckman, Walter M.	No							16.20	(6)	75.00	37.50	21.30
California Oak Valley Golf and Resort LLC ³												
Oak Valley #1	Yes											
Oak Valley #2	Yes							736.20	(6)	950.00	475.00	0.00
Subtotal								3.60	(6)	550.00	275.00	271.40
Merlin Properties	No											
Oak Valley Partners, LP ⁴												
Haskell Ranch-Main	N/A							29.40				
Singleton Ranch #5	No							180.00				
Singleton Ranch #7	Yes							85.80				
Irrigation Stokes	No							6.00				
Subtotal								301.20	(6)	1,806.00	903.00	601.80
Plantation on the Lake LLC	Yes	26.80	38.00	38.10	31.60	25.50	18.60	178.60		581.00	290.50	111.90
Rancho Calimesa Mobile Home Park	No							35.40	(6)	150.00	75.00	39.60
Roman Catholic Bishop of San Bernardino	No							46.80	(6)	154.00	77.00	30.20
Sharondale Mesa Owners Association												
Well No.1	Yes	24.20	20.90	27.30	15.60	5.10	5.50	98.60				
Well No.2	Yes	0.00	0.00	0.00	0.00	0.00	5.70	5.70				
Subtotal		24.20	20.90	27.30	15.60	5.10	11.20	104.30		200.00	100.00	0.00
So Calif Section of the PGA of America ⁵												
Well A	Yes	35.79	38.59	25.89	18.33	7.65	4.56	130.80				
Well B	No							0.00				
Well C	Yes							0.00				
Well D	Yes	174.71	158.81	133.75	115.29	43.79	34.27	660.63				
Subtotal		210.50	197.40	159.64	133.62	51.44	38.83	791.43		2,200.00	1,100.00	308.57
Stearns, Leonard M. and Dorothy D.	No							1.05		200.00	100.00	98.95
Sunny-Cal Egg and Poultry Company								226.00	(7)	1,784.00	892.00	666.00
TOTAL								2,440.78		8,650.00	4,325.00	2,149.72

1.- All values rounded and subject to revision based on receipt of more accurate information.

2.- Total production is estimated for Overlying parties with un-metered wells.

3.- Metering began in late 2004 and was not reported monthly. One total production value for each well was reported to Watermaster for FY 2003/04. For the conversion to CY accounting, it was assumed that CY 2004 production for this entity was equal to FY 2003/04 production (1,227.4 acre-ft).

4.- Provided copies of state filing with annual calendar year totals for each well. Production values for Singleton Ranch #5 and Irrigation Stokes are estimated by Oak Valley Partners.

5.- Actual monthly production provided by the Morongo Band of Mission Indians - March 2014

6.- Production for the Jul-Dec 2003 period estimated as 60 percent of the annual production. This is based on average production for the Jul-Dec period for similar users.

7.- Production for the Jul-Dec 2003 period was based on 1,200,000 chickens and 66.4 irrigated acres, similar to 2004 quantities.

**Table 3-2B
Overlying Producer - Summary of Production for Calendar Year 2004 (ac-ft)**

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right Allocation in 2004	Unused Overlying Allocation in 2004	
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec				
Beckman, Walter M.	No														27.00	75.00	48.00
California Oak Valley Golf and Resort LLC⁽³⁾																	
Oak Valley #1	Yes																
Oak Valley #2	Yes																
Subtotal															728.64	950.00	221.36
Merlin Properties	No														1.58	550.00	548.42
Water Duty Method Used to Estimate Annual Production																	
Oak Valley Partners, LP⁽⁴⁾																	
Haskell Ranch-Main	N/A														19.60		
Singleton Ranch #5	No														300.00		
Singleton Ranch #7	Yes														111.08		
Irrigation Stokes	No														10.00		
Subtotal															440.68	1,806.00	1,365.32
Plantation on the Lake LLC	Yes	18.3	21.7	13.2	24.1	30.3	35.1	35.9	41.4	40.7	37.8	21.8	20.5		340.88	581.00	240.12
Water Duty Method Used to Estimate Annual Production																	
Rancho Calimesa Mobile Home Park	No														68.25	150.00	81.75
Water Duty Method Used to Estimate Annual Production																	
Roman Catholic Bishop of San Bernardino	No														59.06	154.00	94.94
Water Duty Method Used to Estimate Annual Production																	
Sharondeale Mesa Owners Association																	
Well No.1	Yes	5.0	3.4	5.9	7.4	10.0	14.4	19.4	12.0	9.2	8.0	8.5	7.9		111.00		
Well No.2	Yes				1.7	12.0	5.2	7.7	9.6	6.5	4.2	0.0	0.0		47.02		
Subtotal		5.0	3.4	5.9	9.1	22.0	19.6	27.1	21.6	15.8	12.3	8.5	7.9		158.02	200.00	41.98
So Calif Section of the PGA of America⁽⁵⁾																	
Well A	Yes	6.41	13.66	35.85	25.60	43.13	45.27	24.64	5.59	16.98	28.90	5.14	16.89		268.04		
Well B	No	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.00		
Well C	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.00		
Well D	Yes	36.51	14.05	56.44	64.85	113.66	147.98	208.31	193.95	143.74	41.01	12.98	45.17		1,078.64		
Subtotal		42.92	27.70	92.28	90.44	156.79	193.26	232.95	199.53	160.71	69.91	18.12	62.06		1,346.68	2,200.00	853.32
Water Duty Method Used to Estimate Annual Production																	
Stearns, Leonard M. and Dorothy D.	No														1.05	200.00	198.95
Water Duty Method Used to Estimate Annual Production																	
Sunny-Cal Egg and Poultry Company	N/A														404.42	1,784.00	1,379.58
Water Duty Method Used to Estimate Annual Production																	
TOTAL															3,576.26	8,650.00	5,073.75

1.- All values rounded and subject to revision based on receipt of more accurate information.

2.- Total production is estimated for Overlying parties with un-metered wells.

3.- Metering began in late 2004 and was not reported monthly. One total production value for each well was reported to Watermaster for FY 2003/04. For the conversion to CY accounting, it was assumed that CY 2004 production for this entity was equal to FY 2003/04 production (1,227.4 acre-ft).

4.- Provided copies of state filing with annual calendar year totals for each well. Production values for Singleton Ranch #5 and Irrigation Stokes are estimated by Oak Valley Partners.

5.- Actual monthly production provided by the Morongo Band of Mission Indians - March 2014

**Table 3-2C
Overlying Producer - Summary of Production for Calendar Year 2005 (ac-ft)**

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right Allocation in 2005	Unused Overlying Allocation in 2005	
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec				
Beckman, Walter M.	No														22.40	75.00	52.60
California Oak Valley Golf and Resort LLC³																	
Oak Valley #1	Yes	41.15	6.10		150.20	92.90		29.13	122.63	81.07					523.18		
Oak Valley #2	Yes		18.70		82.20	39.30		13.10	27.40	0.00					180.70		
Subtotal		41.15	0.00	24.80	0.00	232.40	132.20	0.00	42.23	150.03	81.07	0.00	0.00	0.00	703.88	950.00	246.12
Merlin Properties	No	Water Duty Method Used to Estimate Annual Production												1.55	550.00	548.45	
Oak Valley Partners, LP⁴																	
Singleton Ranch #5	No														300.00		
Singleton Ranch #7	Yes														40.22		
Irrigation Stokes	No														10.00		
Subtotal															350.22	1,806.00	1,455.78
Plantation on the Lake LLC	Yes	23.00	11.94	8.27	16.80	20.21	34.28	35.25	42.90	32.56	25.39	23.73			310.19	581.00	270.81
Rancho Calimesa Mobile Home Park	No	Water Duty Method Used to Estimate Annual Production												68.25	150.00	81.75	
Roman Catholic Bishop of San Bernardino	No	Water Duty Method Used to Estimate Annual Production												55.60	154.00	98.40	
Shardale Mesa Owners Association																	
Well No.1	Yes	5.24	5.90	2.54	8.75	9.20	13.28	7.00	12.81	9.56	4.43	5.81			98.39		
Well No.2	Yes	0.00	0.00	4.30	5.15	7.22	8.13	15.97	12.64	6.76	9.56	5.65			82.56		
Subtotal		5.24	5.90	6.84	13.90	16.42	21.41	22.97	25.45	16.32	13.99	11.46			180.95	200.00	19.05
So Calif Section of the PGA of America⁵																	
Well A	Yes	2.76	1.88	6.42	0.00	41.77	0.00	69.33	31.90	12.59	8.15	8.11			217.17		
Well C	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.00		
Well D	Yes	8.84	18.53	18.90	184.94	0.00	144.73	124.14	127.72	67.85	79.35	75.72			995.94		
Subtotal		11.59	20.41	25.32	184.94	41.77	144.73	193.48	159.62	80.44	87.50	83.83			1,213.11	2,200.00	986.89
Stearns, Leonard M. and Dorothy D.	No	Water Duty Method Used to Estimate Annual Production												1.05	200.00	198.95	
Sunny-Cal Egg and Poultry Company	No	Water Duty Method Used to Estimate Annual Production												385.44	1,784.00	1,398.56	
TOTAL															3,292.63	8,650.00	5,357.37

1- All values rounded and subject to revision based on receipt of more accurate information.

2- Total production is estimated for Overlying parties with un-metered wells.

3- Initially, production not reported monthly. Blank values indicate no report in that month. Production reported for January 2005 was 164.6 acre-ft, but represented four months of production (October 2004 through January 2005). To estimate January value of 41.15 acre-ft, the total production was assumed to be equal across all four months.

4- Provided copies of state filing with annual calendar year totals for each well. Production values for Singleton Ranch #45 and Irrigation Stokes are estimated by Oak Valley Partners. Meter reads were provided to the Watermaster, but due to inconsistent reporting, annual state recordation data was used.

5- Actual monthly production provided by the Morongo Band of Mission Indians - March 2014

**Table 3-2D
Overlying Producer Summary of Production for Calendar Year 2006 (ac-ft)**

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right	Unused Overlying Allocation in 2006		
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec					
Beckman, Walter M.	Yes	0.73	0.33	0.62	0.06	0.41	2.01	1.88	1.99	1.51	0.71	1.06	0.18	11.49	75.00	63.51		
California Oak Valley Golf and Resort LLC ³																		
Oak Valley #1	Yes	73.32	31.97	34.00	0.00	44.60	166.10	33.38	53.63	16.07	0.00	0.50	0.00	453.58				
Oak Valley #2	Yes	0.00	0.00	0.10	0.00	6.10	11.40	90.90	47.10	84.40	43.00	66.80	28.10	377.90				
Subtotal		73.32	31.97	34.10	0.00	50.70	177.50	124.28	100.73	100.47	43.00	67.30	28.10	831.48	950.00	118.53		
Merlin Properties	No	Water Duty Method Used to Estimate Annual Production														1.58	550.00	548.42
Oak Valley Partners, LP ⁽⁴⁾	No															300.00		
Singleton Ranch #5	Yes															2.14		
Singleton Ranch #7	No															10.00		
Irrigation Stokes	No															312.14	1,806.00	1,493.86
Subtotal																		
Plantation on the Lake LLC	Yes	27.64	21.64	20.66	12.03	20.37	28.76	39.65	41.53	40.76	35.49	32.04	29.51	350.09	561.00	230.91		
Rancho Calimesa Mobile Home Park	No	Water Duty Method Used to Estimate Annual Production														68.25	150.00	81.75
Roman Catholic Bishop of San Bernardino	No	Water Duty Method Used to Estimate Annual Production														58.97	154.00	95.03
Sharondale Mesa Owners Association																		
Well No.1	Yes	5.07	6.63	2.10	4.31	8.67	14.21	5.54	11.63	12.56	10.24	9.08	6.98	97.02				
Well No.2	Yes	4.81	3.42	4.04	4.67	7.67	8.95	22.35	13.08	10.69	7.01	3.48	1.43	91.60				
Subtotal		9.88	10.05	6.14	8.98	16.34	23.16	27.89	24.71	23.25	17.25	12.56	8.41	188.62	200.00	11.38		
So Calif Section of the PGA of America ⁵																		
Well A	Yes	8.37	5.70	3.10	14.34	0.65	2.90	2.64	3.13	6.71	6.99	195.20	92.00	341.74				
Well C	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
Well D	Yes	75.58	15.00	10.00	147.17	169.91	218.21	196.21	163.49	212.94	92.11	29.12	81.90	1,411.64				
Subtotal		83.95	20.70	13.10	161.51	170.56	221.11	198.86	166.62	219.65	99.10	224.32	173.90	1,753.38	2,200.00	446.62		
Stearns, Leonard M. and Dorothy D.	No	Water Duty Method Used to Estimate Annual Production														1.05	200.00	198.95
Sunny-Cal Egg and Poultry Company	No	Water Duty Method Used to Estimate Annual Production														2.63	1,439.50	1,436.87
Sunny-Cal North - Mannheim, Mannheim & Berman	No	Water Duty Method Used to Estimate Annual Production														13.22	300.00	286.78
Nikodinov, Nick	No	Water Duty Method Used to Estimate Annual Production														0.74	20.00	19.26
McAmis, Ronald L.	No	Water Duty Method Used to Estimate Annual Production														0.54	5.00	4.46
Aldana, Nicolas and Amalia	No	Water Duty Method Used to Estimate Annual Production														0.83	7.00	6.17
Gutierrez, Hector, et al.	No	Water Duty Method Used to Estimate Annual Production														1.37	10.00	8.63
Darmon, Boris and Miriam	No	Water Duty Method Used to Estimate Annual Production														0.35	2.50	2.15
TOTAL														3,596.7	8,650.0	5,053.3		

1.- All values rounded and subject to revision based on receipt of more accurate information.

2.- Total production is estimated for Overlying parties with un-metered wells.

3.- Production reported for January 2006 includes production from December 2005.

4.- Provided copies of state filing with annual calendar year totals for each well. Production values for Singleton Ranch #5 and Irrigation Stokes are estimated by Oak Valley Partners. Meter reads were provided to the Watermaster, but due to inconsistent reporting, annual state recordation data was used.

5.- Actual monthly production provided by the Morongo Band of Mission Indians - March 2014

**Table 3-2E
Overlying Producer - Summary of Production for Calendar Year 2007 (ac-ft)**

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right Allocation in 2007	Unused Overlying Allocation in 2007
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec			
Beckman, Walter M.	Yes	0.30	0.17	0.24	0.31	0.41	0.51	0.53	0.87	2.19	1.48	0.99	0.31	8.31	75.00	66.69
California Oak Valley Golf and Resort LLC																
Oak Valley #1	Yes	0.00	0.00	0.00	20.08	16.61	0.00	0.00	0.00	26.00	41.00	58.00	20.00	181.68		
Oak Valley #2	Yes	35.60	20.70	46.60	21.90	56.70	85.80	109.00	90.00	42.00	42.00	0.00	0.00	597.30		
Subtotal		35.60	20.70	46.60	41.98	73.31	85.80	109.00	116.00	83.00	83.00	58.00	20.00	778.98	950.00	171.02
Merlin Properties	No	Water Duty Method Used to Estimate Annual Production												1.59	550.00	548.41
Oak Valley Partners, LP ⁽³⁾	No	Water Duty Method Used to Estimate Annual Production												300.00		
Singleton Ranch #5	Yes	0.16	0.10	0.10	0.12	0.03	0.00	0.55	0.27	0.30	0.17	0.18	0.12	2.10		
Singleton Ranch #7	No	Water Duty Method Used to Estimate Annual Production												10.00		
Irrigation Stokes		Water Duty Method Used to Estimate Annual Production												312.10	1,806.00	1,493.90
Subtotal		21.63	21.14	16.88	31.72	23.72	38.11	44.40	39.10	45.60	30.90	2.20	28.80	344.19	561.00	236.81
Plantation on the Lake LLC	Yes	Water Duty Method Used to Estimate Annual Production												69.30	150.00	80.70
Rancho Calimesa Mobile Home Park	No	Water Duty Method Used to Estimate Annual Production												0.70	154.00	153.30
Roman Catholic Bishop of San Bernardino	No	Water Duty Method Used to Estimate Annual Production														
Shardale Mesa Owners Association		Water Duty Method Used to Estimate Annual Production														
Well No.1	Yes	5.05	7.25	12.44	13.70	2.87	14.15	15.00	26.80	12.40	2.90	13.20	4.30	130.06		
Well No.2	Yes	1.89	0.00	0.00	0.00	17.79	5.60	6.00	0.00	7.00	14.00	0.00	0.00	52.28		
Subtotal		6.94	7.25	12.44	13.70	20.66	19.75	21.00	26.80	19.40	16.90	13.20	4.30	182.34	200.00	17.66
So Calif Section of the PGA of America ⁴		Water Duty Method Used to Estimate Annual Production														
Well A	Yes	4.26	79.48	60.00	72.00	52.50	51.35	0.40	1.23	3.09	2.95	0.69	1.17	329.12		
Well C	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Well D	Yes	79.48	36.97	95.76	106.54	112.17	189.49	163.17	148.82	132.93	98.87	72.73	33.02	1,269.93		
Subtotal		83.74	116.45	155.76	178.54	164.67	240.84	163.58	150.04	136.02	101.81	73.42	34.19	1,599.05	2,200.00	600.95
Stearns, Leonard M. and Dorothy D.	No	Water Duty Method Used to Estimate Annual Production												1.05	200.00	198.95
Sunny-Cal Egg and Poultry Company	No	Water Duty Method Used to Estimate Annual Production												2.68	1,439.50	1,436.82
Albor Properties III, LP ⁽⁵⁾	No	Water Duty Method Used to Estimate Annual Production												2.33	300.00	297.67
Nikodinov, Nick	No	Water Duty Method Used to Estimate Annual Production												0.75	20.00	19.25
McAmis, Ronald L.	No	Water Duty Method Used to Estimate Annual Production												0.55	5.00	4.45
Aldama, Nicolas and Amalia	No	Water Duty Method Used to Estimate Annual Production												0.84	7.00	6.16
Gutierrez, Hector, et al.	No	Water Duty Method Used to Estimate Annual Production												1.39	10.00	8.61
Darmont, Boris and Miriam	No	Water Duty Method Used to Estimate Annual Production												0.35	2.50	2.15
TOTAL														3,306.5	8,650.0	5,343.5

1 - All values rounded and subject to revision based on receipt of more accurate information.

2 - Total production is estimated for Overlying parties with un-metered wells.

3 - As reported to state as annual totals. Production values for Singleton Ranch #6 and Irrigation Stokes are estimated by Oak Valley Partners.

4 - Actual monthly production provided by the Morongo Band of Mission Indians - March 2014

5 - Formerly Sunny-Can North - Manheim, Manheim & Burman.

**Table 3-2F
Overlying Producer - Summary of Production for Calendar Year 2008 (ac-ft)**

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right Allocation in 2008	Unused Overlying Allocation in 2008
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec			
Beckman, Walter M.	Yes	0.21	0.31	0.43	1.43	0.72	1.66	1.9	1.7	1.7	0.9	1.3	0.4	12.69	75.00	62.31
California Oak Valley Golf and Resort LLC																
Oak Valley #1	Yes	8.00	15.00	45.00	87.00	52.00	96.00	117.5	68.4	77.0	31.1	0.0	0.0	596.93		
Oak Valley #2	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.2	30.3	27.0	58.8	54.5	12.7	183.50		
Subtotal		8.00	15.00	45.00	87.00	52.00	96.00	117.7	98.7	104.0	89.9	54.5	12.7	780.43	950.00	169.57
Merlin Properties	No	Water Duty Method Used to Estimate Annual Production												1.60	550.00	548.40
Oak Valley Partners, LP ⁽³⁾	No													0.00		
Singleton Ranch #5	No													2.50		
Singleton Ranch #7	No													0.00		
Irrigation Stokes	No													0.00		
Subtotal														2.50	1,806.00	1,803.50
Plantation on the Lake LLC	Yes	15.80	18.20	17.70	23.50	30.70	35.40	38.7	43.5	40.8	34.9	32.1	22.8	354.04	581.00	226.96
Rancho Calimesa Mobile Home Park	No	Water Duty Method Used to Estimate Annual Production												69.30	150.00	80.70
Roman Catholic Bishop of San Bernardino	No	Water Duty Method Used to Estimate Annual Production												0.70	154.00	153.30
Sharondale Mesa Owners Association																
Well No.1	Yes	0.24	5.70	5.17	9.77	17.56	0.00	12.6	12.2	17.6	9.6	7.9	4.6	102.91		
Well No.2	Yes	3.00	0.00	4.00	3.00	0.00	21.00	14.4	10.3	15.0	7.9	7.4	4.3	90.39		
Subtotal		3.24	5.70	9.17	12.77	17.56	21.00	27.0	22.5	32.6	17.6	15.3	8.9	193.30	200.00	6.70
East Valley Golf Club ⁴																
Well A	Yes	1.03	1.04	2.06	1.64	0.20	0.20	1.9	0.6	0.4	0.4	1.0	0.7	11.18		
Well C	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.00		
Well D	Yes	19.84	21.00	78.85	98.85	131.60	128.86	220.1	181.6	89.3	85.3	60.3	10.7	1,126.41		
Subtotal		20.87	22.04	80.91	100.48	131.80	129.06	221.94	182.27	89.78	85.73	61.27	11.45	1,137.59	2,200.00	1,062.41
Stearns, Leonard M. and Dorothy D.	No	Water Duty Method Used to Estimate Annual Production												1.05	200.00	198.95
Sunny-Cal Egg and Poultry Company	No	Water Duty Method Used to Estimate Annual Production												4.19	1,439.50	1,435.31
Albor Properties III, LP ⁽⁵⁾	No	Water Duty Method Used to Estimate Annual Production												2.34	300.00	297.66
Nikodinov, Nick	No	Water Duty Method Used to Estimate Annual Production												0.75	20.00	19.25
McAmis, Ronald L.	No	Water Duty Method Used to Estimate Annual Production												0.55	5.00	4.45
Aldama, Nicolas and Amalia	No	Water Duty Method Used to Estimate Annual Production												0.85	7.00	6.15
Gutierrez, Hector, et al.	No	Water Duty Method Used to Estimate Annual Production												1.40	10.00	8.60
Darmont, Boris and Miriam	No	Water Duty Method Used to Estimate Annual Production												0.35	2.50	2.15
TOTAL														2,563.6	8,650.0	6,086.4

1.- All values rounded and subject to revision based on receipt of more accurate information.

2.- Total production is estimated for Overlying parties with un-metered wells.

3.- As reported to state as annual totals. Production values for Singleton Ranch #6 and Irrigation Stokes are estimated by Oak Valley Partners.

4.- Formerly the So Calif Section of the PGA of America. Actual monthly production provided by the Morongo Band of Mission Indians - March 2014

5.- Formerly Sunny-Cal North - Mannheim, Mannheim & Burman.

**Table 3-2G
Overlying Producer - Summary of Production for Calendar Year 2009 (ac-ft)**

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right	Unused Overlying Allocation in 2009
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec			
Beckman, Walter M.	Yes	0.66	0.29	0.34	1.28	1.28	1.37	1.79	2.21	1.93	0.75	0.84	0.14	12.88	75.00	62.12
California Oak Valley Golf and Resort LLC																
Oak Valley #1	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	76.77	9.57	49.35	0.00	135.69		
Oak Valley #2	Yes	32.50	25.70	27.50	86.10	77.00	66.30	108.10	104.67	42.73	43.92	8.05	8.41	630.98		
Subtotal		32.50	25.70	27.50	86.10	77.00	66.30	108.10	104.67	119.50	53.49	57.40	8.41	766.67	950.00	183.33
Merlin Properties	No	Water Duty Method Used to Estimate Annual Production												1.58	550.00	548.42
Oak Valley Partners, LP ⁽³⁾	No	Water Duty Method Used to Estimate Annual Production												0.00		
Singleton Ranch #5	No	Water Duty Method Used to Estimate Annual Production												2.50		
Singleton Ranch #7	No	Water Duty Method Used to Estimate Annual Production												0.00		
Irrigation Stokes	No	Water Duty Method Used to Estimate Annual Production												2.50	1,806.00	1,803.50
Subtotal														352.31	581.00	228.70
Plantation on the Lake LLC	Yes	15.51	17.41	13.52	26.58	37.84	34.79	36.78	33.98	33.98	33.98	33.98	33.98	69.30	150.00	80.70
Rancho Calimesa Mobile Home Park	No	Water Duty Method Used to Estimate Annual Production												0.70	154.00	153.30
Roman Catholic Bishop of San Bernardino	No	Water Duty Method Used to Estimate Annual Production														
Sharondale Mesa Owners Association																
Well No.1	Yes	4.46	2.73	5.04	6.76	7.75	7.73	8.79	10.23	9.70	8.35	7.02	1.74	80.30		
Well No.2	Yes	4.11	2.77	4.81	6.21	6.84	6.81	7.75	8.26	8.49	7.36	6.02	4.55	73.98		
Subtotal		8.57	5.50	9.85	12.97	14.59	14.54	16.54	18.49	18.19	15.71	13.04	6.29	154.28	200.00	45.72
East Valley Golf Club ⁴																
Well A	Yes	10.05	12.52	14.06	12.13	8.41	14.32	40.86	45.10	13.27	14.00	10.65	9.00	204.36		
Well C	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	-		
Well D	Yes	32.00	28.37	80.60	93.47	114.15	87.45	142.35	122.16	111.32	80.00	45.00	17.37	954.24		
Subtotal		42.05	40.89	94.66	105.60	122.56	101.76	183.21	167.26	124.59	94.00	55.65	26.37	1,158.60	2,200.00	1,041.40
Stearns, Leonard M. and Dorothy D.	No	Water Duty Method Used to Estimate Annual Production												1.05	200.00	198.95
Sunny-Cal Egg and Poultry Company	No	Water Duty Method Used to Estimate Annual Production												4.19	1,439.50	1,435.31
Albor Properties III, LP ⁽⁵⁾	No	Water Duty Method Used to Estimate Annual Production												2.27	300.00	297.73
Nikodinov, Nick	No	Water Duty Method Used to Estimate Annual Production												0.73	20.00	19.27
McAmis, Ronald L.	No	Water Duty Method Used to Estimate Annual Production												0.54	5.00	4.46
Aldama, Nicolas and Amalia	No	Water Duty Method Used to Estimate Annual Production												0.83	7.00	6.17
Gutierrez, Hector, et al.	No	Water Duty Method Used to Estimate Annual Production												1.37	10.00	8.63
Darmont, Boris and Miriam	No	Water Duty Method Used to Estimate Annual Production												0.35	2.50	2.15
TOTAL														2,530.15	8,650.00	6,119.90

1.- All values rounded and subject to revision based on receipt of more accurate information.
2.- Total production is estimated for Overlying parties with un-metered wells.
3.- Oak Valley Partners has not submitted data to the Watermaster since October 2009. Assumed annual production for Singleton Ranch #5 and Irrigation Stokes was the same as reported for 2004 through 2008.
4.- Formerly the So Calif Section of the PGA of America. Actual monthly production provided by the Morongo Band of Mission Indians - March 2014
5.- Formerly Sunny-Can North - Mannheim, Mannheim & Burman.

**Table 3-2H
Overlying Producer - Summary of Production for Calendar Year 2010 (ac-ft)**

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right Allocation in 2010	Unused Overlying Allocation in 2010
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec			
Beckman, Walter M.	Yes	0.45	0.06	0.30	0.18	0.91	0.61	1.09	0.81	1.22	0.24	0.30	0.20	6.37	75.00	68.63
California Oak Valley Golf and Resort LLC																
Oak Valley #1	Yes	5.18	7.81	9.45	6.14	57.30	24.61	45.63	24.61	94.27	25.28	3.95	0.00	304.23		
Oak Valley #2	Yes	13.48	0.00	24.04	15.30	36.52	26.93	41.38	59.10	4.38	0.13	30.39	9.24	260.89		
Subtotal		18.66	7.81	33.49	21.44	93.82	51.54	87.01	83.71	98.65	25.41	34.34	9.24	565.12	950.00	384.88
Merlin Properties	No	Water Duty Method Used to Estimate Annual Production												1.54	550.00	548.46
Oak Valley Partners, LP ⁽³⁾	No	Water Duty Method Used to Estimate Annual Production												0.00		
Singleton Ranch #5	No	Water Duty Method Used to Estimate Annual Production												2.50		
Singleton Ranch #7	No	Water Duty Method Used to Estimate Annual Production												0.00		
Irrigation Stokes	No	Water Duty Method Used to Estimate Annual Production												0.00		
Subtotal														2.50	1,806.00	1,803.50
Plantation on the Lake LLC	Yes	33.98	12.40	12.43	24.33	25.59	33.23	33.15	39.52	20.33	49.86	28.86	23.51	337.19	581.00	243.82
Rancho Calimesa Mobile Home Park	No	Water Duty Method Used to Estimate Annual Production												69.30	150.00	80.70
Roman Catholic Bishop of San Bernardino	No	Water Duty Method Used to Estimate Annual Production												0.00	154.00	154.00
Sharondale Mesa Owners Association																
Well No.1	Yes	0.14	1.52	2.96	3.10	7.36	9.80	9.11	10.37	9.70	5.22	4.81	3.60	67.69		
Well No.2	Yes	5.13	1.53	2.85	4.89	6.33	7.79	7.77	8.60	8.14	4.30	4.47	2.84	64.64		
Subtotal		5.27	3.05	5.81	7.99	13.69	17.59	16.88	18.97	17.84	9.52	9.28	6.44	132.33	200.00	67.67
Tukwet Canyon Golf Club ⁽⁴⁾																
Well A	Yes	1.50	2.46	4.89	1.69	8.74	28.22	16.43	26.75	11.56	3.28	10.04	3.08	118.64		
Well C	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Well D	Yes	19.49	24.93	30.37	65.07	99.82	119.82	84.15	16.75	192.74	31.99	21.93	26.10	733.16		
Subtotal		20.99	27.39	35.27	66.77	108.57	148.03	100.57	43.49	204.30	35.27	31.98	29.18	851.81	2,200.00	1,348.19
Stearns, Leonard M. and Dorothy D.	No	Water Duty Method Used to Estimate Annual Production												0.70	200.00	199.30
East Valley Golf Club ⁽⁴⁾	No	Water Duty Method Used to Estimate Annual Production												3.80	1,439.50	1,435.70
Albor Properties III, LP ⁽⁵⁾	No	Water Duty Method Used to Estimate Annual Production												2.12	300.00	297.88
Nikodinov, Nick	No	Water Duty Method Used to Estimate Annual Production												0.70	20.00	19.30
McAmis, Ronald L.	No	Water Duty Method Used to Estimate Annual Production												0.53	5.00	4.47
Aldama, Nicolas and Amalia	No	Water Duty Method Used to Estimate Annual Production												0.79	7.00	6.21
Gutierrez, Hector, et al.	No	Water Duty Method Used to Estimate Annual Production												1.32	10.00	8.68
Darmont, Boris and Miriam	No	Water Duty Method Used to Estimate Annual Production												0.35	2.50	2.15
TOTAL														1,976.5	8,650.0	6,673.5

1.- All values rounded and subject to revision based on receipt of more accurate information.

2.- Total production is estimated for Overlying parties with un-metered wells.

3.- Oak Valley Partners has not submitted production data to the Watermaster since October 2009. Assumed annual production for all wells as the average production for the 2004-2008 period.

4.- Formerly known as the East Valley Golf Course; prior to that known as the Southern California Section of the PGA of America. Actual monthly production provided by the Morongo Band of Mission Indians - March 2014

5.- Formerly Sunny-Can North - Manheim. Manheim & Burman.

Table 3-21
Overlying Producer - Summary of Production for Calendar Year 2011 (ac-ft)

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right Allocation in 2011	Unused Overlying Allocation in 2011
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec			
Beckman, Walter M. ⁽³⁾	Yes	0.20	0.20	0.17	0.17	0.17	0.40	1.79	2.21	1.93	0.75	0.84	0.14	8.98	75.00	66.02
California Oak Valley Golf and Resort LLC ⁽³⁾																
Oak Valley #1	Yes	10.65	1.00	0.23	0.00	0.00	0.00									
Oak Valley #2	Yes	0.30	9.55	0.56	15.36	72.15	12.58									
Subtotal		10.95	10.55	0.79	15.36	72.15	12.58	97.56	94.19	109.08	39.45	45.87	8.83	517.35	950.00	432.66
Merlin Properties	No	Water Duty Method Used to Estimate Annual Production														
Oak Valley Partners, LP ⁽⁴⁾	No															
Singleton Ranch #5	No															
Singleton Ranch #7	No															
Irrigation Stokes	No															
Subtotal														2.50	1,806.00	1,803.50
Plantation on the Lake LLC ⁽³⁾	Yes	16.09	23.37	15.94	20.68	24.09	34.30	35.24	45.73	27.15	41.92	31.42	28.74	344.67	581.00	236.33
Rancho Calimesa Mobile Home Park	No	Water Duty Method Used to Estimate Annual Production														
Roman Catholic Bishop of San Bernardino	No	Water Duty Method Used to Estimate Annual Production														
Sharondale Mesa Owners Association ⁽⁶⁾																
Well No.1	Yes	3.36	2.70	2.62	4.15	5.70	8.02	11.31	9.61	15.41	10.66	3.67	3.77	80.98		
Well No.2	Yes	3.25	2.57	2.39	4.12	6.16	6.45	6.60	8.81	2.08	2.80	3.34	3.46	52.01		
Subtotal		6.61	5.27	5.01	8.27	11.86	14.47	17.91	18.42	17.49	13.45	7.00	7.23	132.99	200.00	67.01
Tukwet Canyon Golf Club ⁽⁶⁾																
Well A	Yes	2.26	2.06	14.74	2.81	22.57	18.12	33.91	15.57	3.78	1.35	0.76	0.47	118.40		
Well C	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Well D	Yes	35.81	23.04	13.59	42.91	21.43	97.66	130.08	130.71	128.94	70.25	27.57	42.53	764.51		
Subtotal		38.07	25.10	28.33	45.72	44.01	115.77	163.99	146.28	132.71	71.60	28.33	43.00	882.91	2,200.00	1,317.09
Stearns, Leonard M. and Dorothy D.	No	Water Duty Method Used to Estimate Annual Production														
Sunny-Cal Egg and Poultry Company	No	Water Duty Method Used to Estimate Annual Production														
Albor Properties III, LP	No	Water Duty Method Used to Estimate Annual Production														
Nikodimov, Nick	No	Water Duty Method Used to Estimate Annual Production														
McAnnis, Ronald L.	No	Water Duty Method Used to Estimate Annual Production														
Aidama, Nicolas and Annalia	No	Water Duty Method Used to Estimate Annual Production														
Gutierrez, Hector, et al.	No	Water Duty Method Used to Estimate Annual Production														
Darmont, Boris and Miriam	No	Water Duty Method Used to Estimate Annual Production														
TOTAL														1,971.4	8,650.0	6,678.6

1.- All values rounded and subject to revision based on receipt of more accurate information in the future.

2.- Total production is estimated for Overlying parties with un-metered wells.

3.- Monthly production provided by BCWWD - Feb 2013. Production by Plantation on the Lake needs to be confirmed (May 2015).

4.- Oak Valley Partners has not submitted production data to the Watermaster since October 2009. Assumed annual production for all wells as the average production for the 2004-2008 period.

5.- Monthly production since 2011 provided by Clearwater Solutions, a company in charge of operating the water system.

6.- Formerly known as the East Valley Golf Course; prior to that known as the Southern California Section of the PGA of America. Actual monthly production provided by the Morongo Band of Mission Indians - March 2014.

Table 3-2J
Overlying Producer - Summary of Production for Calendar Year 2012 (ac-ft)

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right Allocation in 2012	Unused Overlying Allocation in 2012
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec			
Beckman, Walter M. ⁽³⁾	Yes	0.20	0.20	0.17	0.17	0.17	0.40	1.79	2.21	1.93	0.75	0.84	0.14	8.98	75.00	66.02
California Oak Valley Golf and Resort LLC ⁽³⁾																
Oak Valley #1	Yes															
Oak Valley #2	Yes	10.95	10.55	0.79	15.36	72.15	12.58	97.56	94.19	109.08	39.45	45.87	8.83	517.35	950.00	432.66
Subtotal																
Merlin Properties	No															
Oak Valley Partners, LP ⁽⁴⁾	No															
Singleton Ranch #5	No															
Singleton Ranch #7	No															
Subtotal																
Plantation on the Lake LLC ⁽³⁾	Yes	16.09	23.37	15.94	20.68	24.09	34.30	35.24	45.73	27.15	41.92	31.42	28.74	344.67	581.00	236.33
Rancho Calimesa Mobile Home Park	No															
Roman Catholic Bishop of San Bernardino	No															
Sharondale Mesa Owners Association ⁽⁶⁾																
Well No.1	Yes	4.28	3.94	3.60	4.52	8.44	10.20	10.43	8.00	9.49	9.14	4.75	2.44	79.23		
Well No.2	Yes	3.96	3.68	3.33	4.00	6.50	7.59	7.93	7.75	7.30	7.34	4.37	2.29	66.04		
Subtotal		8.24	7.63	6.93	8.52	14.94	17.80	18.37	15.74	16.79	16.47	9.12	4.72	145.27	200.00	54.73
Tukwet Canyon Golf Club ⁽⁶⁾																
Well A	Yes	0.47	0.58	0.83	0.59	20.36	44.05	38.86	36.60	29.52	28.86	16.30	0.45	217.47		
Well C	Yes	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
Well D	Yes	51.36	27.39	28.12	47.64	93.11	118.17	113.83	102.25	86.26	70.99	17.37	10.37	766.84		
Subtotal		51.82	27.97	28.95	48.23	113.47	162.21	152.69	138.85	115.78	99.85	33.67	10.82	984.32	2,200.00	1,215.69
Stearns, Leonard M. and Dorothy D.	No															
Sunny-Cal Egg and Poultry Company	No															
Albor Properties III, LP	No															
Nikodimov, Nick	No															
McAnnis, Ronald L.	No															
Aidama, Nicolas and Annalia	No															
Gutierrez, Hector, et al.	No															
Darmon, Boris and Miriam	No															
TOTAL														2,085.4	8,650.0	6,564.6

1.- All values rounded and subject to revision based on receipt of more accurate information in the future.
2.- Total production is estimated for Overlying parties with un-metered wells.
3.- Monthly production provided by BCWVD - Feb 2013. Production by Plantation on the Lake needs to be confirmed (May 2015).
4.- Oak Valley Partners has not submitted production data to the Watermaster since October 2009. Assumed annual production for all wells as the average production for the 2004-2008 period.
5.- Monthly production since 2011 provided by Clearwater Solutions, a company in charge of operating the water system.
6.- Formerly known as the East Valley Golf Course; prior to that known as the Southern California Section of the PGA of America. Actual monthly production provided by the Morongo Band of Mission Indians - March 2014.

Table 3-2K
Overlying Producer - Summary of Production for Calendar Year 2013 (ac-ft)

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ⁽¹⁾												Total ⁽²⁾ Production	Overlying Water Right	Unused Overlying Allocation in 2013	
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec				
Beckman, Walter M. ⁽³⁾	Yes	0.0	0.0	0.0	0.3	0.3	0.4	0.6	0.0	0.4	0.1	0.0	0.0	0.0	2.1	75.0	72.9
California Oak Valley Golf and Resort LLC ⁽³⁾																	
Oak Valley #1	Yes	11.5	12.4	12.5	11.4	55.2	66.1	97.7	0.0	0.0	0.0	0.0	0.0	0.0	266.8		
Oak Valley #2	Yes	1.3	0.7	1.1	0.8	0.0	0.0	2.5	68.9	49.7	70.4	53.3	110.4		359.0		
Subtotal		12.8	13.1	13.6	12.1	55.2	66.1	100.1	68.9	49.7	70.4	53.3	110.4		625.8	950.0	324.2
Merlin Properties	No	Water Duty Method Used to Estimate Annual Production												1.6	550.0	548.4	
Oak Valley Partners, LP ⁽⁴⁾	No													0.00			
Singleton Ranch #5	No													2.50			
Singleton Ranch #7	No													0.00			
Irrigation Stokes	No													2.5	1,806.0	1,803.5	
Subtotal															43.7	581.0	537.3
Plantation on the Lake LLC ⁽³⁾	Yes	1.8	2.1	2.3	4.0	2.7	4.7	4.9	5.5	4.7	4.9	3.3	2.7		69.3	150.0	80.7
Rancho Calimesa Mobile Home Park	No	Water Duty Method Used to Estimate Annual Production												0.0	154.0	154.0	
Roman Catholic Bishop of San Bernardino	No	Water Duty Method Used to Estimate Annual Production															
Sharondale Mesa Owners Association ⁽⁵⁾																	
Well No.1	Yes	2.7	3.1	4.8	7.3	7.6	9.7	10.8	10.9	3.6	1.6	5.8	4.0		72.0		133.4
Well No.2	Yes	2.5	2.8	4.1	5.9	5.8	6.6	7.6	7.8	13.3	12.2	3.0	3.7		75.0		75.0
Subtotal		5.2	6.0	8.8	13.2	13.4	16.3	18.3	18.7	16.9	13.8	8.8	7.7		147.0	200.0	53.0
Tukwet Canyon Golf Club ⁽⁶⁾																	
Well A	Yes	6.6	6.2	15.6	29.9	33.8	39.6	0.0	0.0	5.2	25.4	15.7	20.0		198.1		
Well C	Yes	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		0.0		0.0
Well D	Yes	20.2	13.3	35.3	70.2	86.0	111.1	152.8	143.9	117.1	77.7	41.6	31.2		900.3		
Subtotal		26.9	19.4	50.9	100.0	119.8	150.6	152.8	143.9	122.3	103.1	57.3	51.2		1,098.4	2,200.0	1,101.6
Stearns, Leonard M. and Dorothy D.	No	Water Duty Method Used to Estimate Annual Production												0.7	200.0	199.3	
Sunny-Cal Egg and Poultry Company	No	Water Duty Method Used to Estimate Annual Production												4.3	1,439.5	1,435.2	
Albor Properties III, LP	No	Water Duty Method Used to Estimate Annual Production												2.4	300.0	297.6	
Nikodinov, Nick	No	Water Duty Method Used to Estimate Annual Production												0.8	20.0	19.2	
McAmis, Ronald L.	No	Water Duty Method Used to Estimate Annual Production												0.6	5.0	4.4	
Aldama, Nicolas and Amalia	No	Water Duty Method Used to Estimate Annual Production												0.9	7.0	6.1	
Gutierrez, Hector, et al.	No	Water Duty Method Used to Estimate Annual Production												1.4	10.0	8.6	
Darmon, Boris and Miriam	No	Water Duty Method Used to Estimate Annual Production												0.4	2.5	2.2	
TOTAL															2,001.8	8,650.0	6,648.2

1.- All values rounded and subject to revision based on receipt of more accurate information in the future.

2.- Total production is estimated for Overlying parties with un-metered wells.

3.- Monthly production provided by BCWWD - Feb 2014

4.- Oak Valley Partners has not submitted production data to the Watermaster since October 2009. Assumed annual production for all wells as the average production for the 2004-2008 period.

5.- Monthly production since 2011 provided by Clearwater Solutions, a company in charge of operating the water system.

6.- Formerly known as the East Valley Golf Course; prior to that known as the Southern California Section of the PGA of America. Actual monthly production provided by the Morongo Band of Mission Indians - March 2014.

Table 3-2L
Overlying Producer - Summary of Production for Calendar Year 2014 (ac-ft)

Owner and Well Name	Metered	Monthly Water Production by Overlying Producer ¹												Total ² Production	Overlying Water Right	Unused Overlying Allocation in 2014		
		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec					
Beckman, Walter M. ⁽³⁾	Yes	0.0	0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.9	58.1	57.2
California Oak Valley Golf and Resort LLC ⁽³⁾																		
Oak Valley #1	Yes	0.0	2.0	3.3	4.7	6.4	5.5	4.0	5.9	0.0	0.0	4.9	18.7			55.4		
Oak Valley #2	Yes	28.7	16.9	0.0	0.0	42.8	69.0	24.7	54.9	98.7	25.9	0.0	361.6					
Subtotal		28.7	18.9	3.3	4.7	6.4	48.3	73.0	54.9	98.7	30.8	18.7	417.0			318.8		
Merlin Properties	No	Water Duty Method Used to Estimate Annual Production												1.6	426.0	424.4		
Oak Valley Partners, LP ⁽⁴⁾	No													0.00				
Singleton Ranch #5	No													2.50				
Singleton Ranch #7	No													0.00				
Irrigation Stokes	No													2.5	1,398.9	1,396.4		
Subtotal																54.0	450.0	396.0
Plantation on the Lake LLC ⁽³⁾	Yes	2.7	3.2	3.4	5.9	4.2	4.3	5.0	5.7	5.2	4.4	4.5	5.3			69.3	116.2	46.9
Rancho Calimesa Mobile Home Park	No	Water Duty Method Used to Estimate Annual Production																
Roman Catholic Bishop of San Bernardino	No	Water Duty Method Used to Estimate Annual Production												0.0	119.3	119.3		
Sharondale Mesa Owners Association ⁽⁵⁾																		
Well No.1	Yes	5.1	4.0	4.9	7.0	9.0	8.7	10.1	7.0	6.5	8.8	4.9	1.8			78.0		
Well No.2	Yes	4.8	3.7	4.3	5.4	6.3	6.4	6.9	4.4	5.4	5.5	4.6	1.7			59.3		
Subtotal		9.9	7.7	9.2	12.4	15.3	15.1	17.0	11.4	12.0	14.3	9.5	3.5			137.3	154.9	17.6
Tukwet Canyon Golf Club ⁽⁶⁾																		
Well A	Yes	24.0	15.9	20.1	29.3	34.3	43.4	41.1	29.6	12.1	23.5	3.5	0.8			277.6		
Well C	Yes	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0			0.0		
Well D	Yes	55.4	30.0	34.6	63.1	114.4	127.5	119.3	111.5	134.5	85.8	58.4	16.0			950.3		
Subtotal		79.4	45.8	54.7	92.4	148.7	170.9	160.3	141.1	146.6	109.3	61.9	16.7			1,227.9	1,704.0	476.1
Stearns, Leonard M. and Dorothy D.	No	Water Duty Method Used to Estimate Annual Production												0.7	154.9	154.2		
Sunny-Cal Egg and Poultry Company	No	Water Duty Method Used to Estimate Annual Production												4.3	1,115.0	1,110.6		
Albor Properties III, LP	No	Water Duty Method Used to Estimate Annual Production												2.4	232.4	229.9		
Nikodinov, Nick	No	Water Duty Method Used to Estimate Annual Production												0.8	15.5	14.7		
McAmis, Ronald L.	No	Water Duty Method Used to Estimate Annual Production												0.6	3.9	3.3		
Aldama, Nicolas and Amalia	No	Water Duty Method Used to Estimate Annual Production												0.9	5.4	4.6		
Gutierrez, Hector, et al.	No	Water Duty Method Used to Estimate Annual Production												1.4	7.7	6.3		
Darmon, Boris and Miriam	No	Water Duty Method Used to Estimate Annual Production												0.4	1.9	1.6		
TOTAL																1,922.0	6,700.0	4,778.0

1.- All values rounded and subject to revision based on receipt of more accurate information in the future.

2.- Total production is estimated for Overlying parties with un-metered wells.

3.- Monthly production provided by BCWWD - Feb 2015

4.- Estimated production based on field visit conducted in April 2015.

5.- Monthly production since 2011 provided by Clearwater Solutions, a company in charge of operating the water system.

6.- Formerly known as the East Valley Golf Course; prior to that known as the Southern California Section of the PGA of America. Actual monthly production provided by the Morongo Band of Mission Indians - March 2015

**Table 3-3
Production Summary for Appropriator and Overlying Producers in the Beaumont Basin
Calendar Year Accounting (ac-ft)**

	Annual Production (ac-ft)											Total Production			
	2003 ¹	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013		2014		
Appropriator Parties															
Banning, City of	2,174.2	3,397.3	1,808.6	1,827.5	2,772.6	2,933.6	2,095.0	1,143.6	1,341.7	1,038.3	2,100.7	2,585.1	25,218.2		
Beaumont-Cherry Valley Water District	3,511.9	6,873.9	7,025.6	9,054.1	11,383.3	10,710.5	10,133.9	9,421.3	9,431.3	10,162.0	11,097.4	10,805.5	109,610.7		
South Mesa Water Company	223.2	482.5	663.2	616.0	665.8	470.9	382.2	405.0	419.9	448.5	308.4	473.7	5,559.2		
Yucaipa Valley Water District	1,162.4	1,833.7	1,281.3	2,027.3	1,682.9	572.0	504.4	672.4	534.1	700.1	1,030.8	1,198.5	13,199.9		
Subtotal	7,071.7	12,587.4	10,778.6	13,524.9	16,504.6	14,687.0	13,115.6	11,642.3	11,727.1	12,348.9	14,537.2	15,062.8	153,587.9		
Overlying Parties															
Beckman, Walter M	16.2	27.0	22.4	11.5	8.3	12.7	12.9	6.4	9.0	9.0	2.1	0.9	138.3		
California Oak Valley Golf and Resort LLC	736.2	728.6	703.9	831.5	779.0	780.4	766.7	565.1	517.3	517.3	625.8	417.0	7,968.9		
Merlin Properties	3.6	1.6	1.6	1.6	1.6	1.6	1.6	1.5	1.6	1.6	1.6	1.6	21.1		
Oak Valley Partners, LP	301.2	440.7	350.2	312.1	312.1	310.5	310.5	2.5	2.5	2.5	2.5	2.5	2,349.9		
Plantation on the Lake LLC	178.6	340.9	310.2	350.1	344.2	354.0	352.3	337.2	344.7	344.7	43.7	54.0	3,354.5		
Rancho Calimesa Mobile Home Park	35.4	68.3	68.3	68.3	69.3	69.3	69.3	69.3	69.3	69.3	69.3	69.3	794.6		
Roman Catholic Bishop of San Bernardino	46.8	59.1	55.6	59.0	0.7	0.7	0.7	0.0	0.0	0.0	0.0	0.0	222.5		
Sharondale Mesa Owners Association	104.3	158.0	181.0	188.6	182.3	193.3	154.3	132.3	133.0	145.3	147.0	137.3	1,856.7		
Tukwet Canyon Golf Club ²	791.4	1,346.7	1,213.1	1,753.4	1,599.1	1,137.6	1,158.6	851.8	882.9	984.3	1,098.4	1,227.9	14,045.2		
Stearns, Leonard M. and Dorothy D.	1.1	1.1	1.1	1.1	1.1	1.1	1.1	0.7	0.7	0.7	0.7	0.7	10.9		
Sunny-Cal Egg and Poultry Company	226.0	404.4	385.4	2.6	2.7	4.2	4.2	3.8	4.2	4.3	4.3	4.3	1,050.5		
Albor Properties III, LP ³				13.2	2.3	2.3	2.3	2.1	2.3	2.4	2.4	2.4	31.9		
Nikodinov, Nick				0.7	0.8	0.8	0.7	0.7	0.8	0.8	0.8	0.8	6.7		
McAmis, Ronald L.				0.5	0.6	0.6	0.5	0.5	0.6	0.6	0.6	0.6	4.9		
Aldama, Nicolas and Anaila				0.8	0.8	0.9	0.8	0.8	0.9	0.9	0.9	0.9	7.6		
Gutierrez, Hector, et. al.				1.4	1.4	1.4	1.4	1.3	1.4	1.4	1.4	1.4	12.5		
Darmont, Boris and Miriam				0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	3.2		
Subtotal	2,440.8	3,576.3	3,292.6	3,596.7	3,306.5	2,871.6	2,838.2	1,976.5	1,971.4	2,085.4	2,001.8	1,922.0	31,879.7		
Total	9,512.5	16,163.6	14,071.3	17,121.6	19,811.1	17,558.6	15,953.7	13,618.7	13,698.4	14,434.3	16,538.9	16,984.7	185,467.6		

1.- 2003 groundwater production only includes Jul-Dec time period.

2.- Formerly known as the East Valley Golf Course and the Southern California Section of the PGA of America.

3.- Formerly known as Sunny Cal North - Manheim, Manheim & Berman.

**Table 3-4
Annual Supplemental Recharge to the Beaumont Basin -- Calendar Year Accounting**

Year	Supplemental Recharge (ac-ft)				Total
	Banning ¹	Beaumont ²	BCVWD ¹	SGPWA ³	
2003	-	-	-	-	-
2004	-	-	-	813.8	813.8
2005	-	-	-	687.4	687.4
2006	-	-	3,501.0	777.7	4,278.7
2007	-	-	4,501.0	541.3	5,042.3
2008	1,534.0	-	2,399.0	1,047.4	4,980.4
2009	2,741.2	-	2,741.2	823.4	6,305.8
2010	1,338.0	-	5,727.0	1,222.3	8,287.3
2011	800.0	-	7,979.0	1,842.0	10,621.0
2012	1,200.0	-	7,783.0	1,827.2	10,810.2
2013	1,200.0	-	7,403.0	881.8	9,484.8
2014	608.0	-	4,405.0	16.5	5,029.5
Totals	9,421.2	-	46,439.2	10,480.8	66,341.2

1.- SWP water recharged in the BCVWD Noble Creek Recharge Facility

2.- The City of Beaumont is seeking credit for recycled water recharge in the Beaumont Basin from DP-007 in an unnamed tributary to Marshall Creek. A technical demonstration of the estimated amount of recharge in the Beaumont Basin is pending.

3.- SWP water recharged in the Pass Agency's Little San Geronio Creek Spreading Ponds

Table 3-5
City of Beaumont Wastewater Treatment Plant - Monthly Discharges Since 2007
 Recycled Water Daily Average Discharges to DDP1 - Coopers's Canyon

Year	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Average (mgd)	Annual ac-ft
2007	2.32	2.17	2.25	2.23	2.61	2.57	2.57	2.66	2.66	2.67	2.63	2.50	2.49	2,786
2008	2.44	2.79	2.49	2.65	2.55	2.59	2.55	2.59	2.60	2.50	2.57	2.65	2.58	2,889
2009	2.52	2.66	2.56	2.58	2.59	2.56	2.44	2.63	2.60	2.61	2.63	2.69	2.59	2,902
2010	2.83	2.65	2.66	2.60	2.00	1.88	1.94	1.96	1.94	2.00	2.04	2.22	2.23	2,495
2011	2.07	2.12	2.06	2.01	2.04	2.25	2.23	2.13	2.10	2.08	2.19	2.13	2.12	2,371
2012	2.19	2.64	2.19	2.23	2.29	2.24	2.28	2.29	2.24	2.70	2.38	2.33	2.33	2,614
2013	2.76	2.80	2.80	2.81	2.78	2.78	2.81	2.82	2.89	2.83	2.21	2.50	2.73	3,061
2014	2.62	2.22	2.45	2.48	2.61	2.62	2.61	2.74	2.87	2.74	2.99	3.12	2.67	2,992

Recycled Water Daily Average Discharges to DDP7 - Marshall's Canyon

Year	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Average (mgd)	Annual ac-ft
2010			0.82	0.67	0.57	0.62	0.70	0.69	0.69	0.70	0.67	0.65	0.68	633
2011	0.66	0.63	0.63	0.63	0.58	0.45	0.52	0.63	0.64	0.60	0.55	0.54	0.59	660
2012	0.54	0.54	0.52	0.47	0.45	0.45	0.45	0.49	0.50	0.47	0.41	0.53	0.49	545
2013	0.48	0.52	0.45	0.43	0.25	0.44	0.52	0.61	0.33	0.69	0.57	0.41	0.47	530
2014	0.21	0.65	0.61	0.66	0.61	0.42	0.49	0.35	0.21	0.24	0.02	0.02	0.37	418

**Table 3-6
Overlying Parties Production Rights Allocation Based on Revised Safe Yield**

Overlying Party to the 2003 Judgment	Initial Overlying Water Right	New Overlying Water Right	5-Year (2010-14) Running Average (ac-ft)	5-Year (2010-14) Running Avg % of Water Right
Sharondale Mesa Owners Association	200.0	154.9	139.0	89.7%
California Oak Valley Golf and Resort LLC	950.0	735.8	528.5	71.8%
Rancho Calimesa Mobile Home Park	150.0	116.2	69.3	59.6%
Tukwet Canyon Golf Club	2,200.0	1,704.0	1,009.1	59.2%
Plantation on the Lake LLC	581.0	450.0	224.8	50.0%
Gutierrez, Hector, et al.	10.0	7.7	1.4	18.1%
Darmont, Boris and Miriam	2.5	1.9	0.4	18.1%
Aldama, Nicolas and Amalia	7.0	5.4	0.9	15.7%
McAmis, Ronald L.	5.0	3.9	0.6	14.3%
Beckman, Walter M.	75.0	58.1	5.5	9.4%
Nikodinov, Nick	20.0	15.5	0.8	4.9%
Albor Properties III, LP	300.0	232.4	2.3	1.0%
Stearns, Leonard M. and Dorothy D.	200.0	154.9	0.7	0.5%
Sunny-Cal Egg and Poultry Company	1,439.5	1,115.0	4.2	0.4%
Merlin Properties	550.0	426.0	1.6	0.4%
Oak Valley Partners, LP	1,806.0	1,398.9	2.5	0.2%
Roman Catholic Bishop of San Bernardino	154.0	119.3	0.0	0.0%
	8,650.0	6,700.0	1,991.4	29.7%

Table 3-7
Summary of Unused Overlying Water - Calendar Year Accounting (ac-ft)

Watermaster Accounting Year	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014
Annual Overlying Water Right	4,325.0	8,650.0	8,650.0	8,650.0	8,650.0	8,650.0	8,650.0	8,650.0	8,650.0	8,650.0	8,650.0	6,700.0
Annual Overlying Production	2,440.8	3,576.3	3,292.6	3,596.7	3,306.5	2,871.6	2,838.2	1,976.5	1,971.4	2,085.4	2,001.8	1,922.0
Annual Deliveries by Appropriators			0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Unused Overlying Water Right	1,884.2	5,073.7	5,357.4	5,053.3	5,343.5	5,778.4	5,811.8	6,673.5	6,678.6	6,564.6	6,648.2	4,778.0

Table 3-8
Allocation of Unused Overlying Water -- Calendar Year Accounting (ac-ft)

Appropriator Party	Share of Safe Yield	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019
Banning, City of	31.43%	592.2	1,594.7	1,683.8	1,588.2	1,679.5	1,816.1	1,826.7	2,097.5	2,099.1	2,063.2	2,089.5	1,501.7
Beaumont, City of	0.00%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Beaumont Cherry Valley WD	42.51%	801.0	2,156.8	2,277.4	2,148.1	2,271.5	2,456.4	2,470.6	2,836.9	2,839.1	2,790.6	2,826.2	2,031.1
South Mesa Water Company	12.48%	235.2	633.2	668.6	630.6	666.9	721.1	725.3	832.9	833.5	819.3	829.7	596.3
Yucaipa Valley WD	13.58%	255.9	689.0	727.5	686.2	725.6	784.7	789.2	906.3	907.0	891.5	902.8	648.9
Total	100.00%	1,884.2	5,073.7	5,357.4	5,053.3	5,343.5	5,778.4	5,811.8	6,673.5	6,678.6	6,564.6	6,648.2	4,778.0

**Table 3-9
Consolidation of Appropriator Production and Storage Accounts
Calendar Year Accounting (ac-ft) 2003 through 2014**

Calendar Year	Storage Account Balance at Beginning of CY	Share of Surplus Water	Groundwater Production for CY	Additions to Storage Account							Ending Account Balance	
				Under Production ⁽¹⁾	Overlying Users Parcel Conversion	Unused Overlying Production Allocation	Transfers Among Appropriators	Supplemental Water		Local Recharge		Total Additions to Storage Account
								SWP Water Recharge	Recycled Water Recharge			
Totals												
2003	0.0	8,000.0	7,071.7	928.3	0.0	0.0	0.0	0.0	0.0	0.0	928.3	928.3
2004	928.3	16,000.0	12,587.4	3,412.6	0.0	0.0	0.0	0.0	0.0	0.0	3,412.6	4,340.9
2005	4,340.9	16,000.0	10,778.6	5,221.4	0.0	0.0	0.0	0.0	0.0	0.0	5,221.4	9,562.3
2006	9,562.3	16,000.0	13,524.9	2,475.1	0.0	0.0	0.0	3,501.0	0.0	0.0	5,976.1	15,538.3
2007	15,538.3	16,000.0	16,504.6	-504.6	0.0	0.0	0.0	4,501.0	0.0	0.0	3,996.4	19,534.8
2008	19,534.8	16,000.0	14,687.0	1,313.0	0.0	1,884.2	0.0	3,933.0	0.0	0.0	7,130.2	26,665.0
2009	26,665.0	16,000.0	13,115.6	2,884.4	0.0	5,073.7	0.0	5,482.4	0.0	0.0	13,440.6	40,105.6
2010	40,105.6	16,000.0	11,642.3	4,357.7	0.0	5,357.4	0.0	7,065.0	0.0	0.0	16,780.1	56,885.7
2011	56,885.7	16,000.0	11,727.1	4,272.9	0.0	5,053.3	0.0	8,779.0	0.0	0.0	18,105.2	74,990.9
2012	74,990.9	16,000.0	12,348.9	3,651.1	0.0	5,343.5	0.0	8,983.0	0.0	0.0	17,977.6	92,968.5
2013	92,968.5	8,000.0	14,537.2	-6,537.2	0.0	5,778.4	0.0	8,603.0	0.0	0.0	7,844.2	100,812.7
2014	100,812.7	0.0	15,062.8	-15,062.8	0.0	5,811.8	0.0	5,013.0	0.0	0.0	-4,237.9	96,574.8

1 -- Negative values of under production indicate that the appropriator pumped more than its share of the operating yield.

Section 4

Water Quality Conditions

The purpose of this section is to document the water quality conditions in the Beaumont Basin during the 2010-2014 reporting period. TDS and nitrate concentrations in the basin are compared against groundwater quality objectives for anti-degradation and maximum benefit as established by the Regional Board for TDS and nitrate-nitrogen in the Beaumont Management Zone (BMZ). In addition, water quality concentrations for a number of compounds are compared against Federal and State Drinking Water Standards. Figure 4-1 depicts all the wells that have groundwater quality data for the reporting period.

4.1 Comparison with Management Zone Objectives

Groundwater quality objectives for anti-degradation and maximum benefit have been established by the Regional Board for TDS and nitrate-nitrogen in the BMZ, which encompasses portions of the Beaumont Basin, the Singleton and South Beaumont basins, and limited portions of Edgar Canyon above the Banning Fault as illustrated in Figure 4-1. The anti-degradation objectives are based on the historic ambient TDS and nitrate-nitrogen concentration of 230 mg/L and 1.5 mg/L respectively.

The maximum benefit objectives were adopted by the Regional Board in 2004 at the request of STWMA and Beaumont to allow for recharge of imported water and the reuse of recycled water. The maximum benefit objectives, set to 330 mg/L for TDS and 5.0 mg/L for Nitrate-N, are relatively low compared to other basins and are protective of the beneficial uses of the Basin groundwater. According to the Basin Plan, salt mitigation will be required once the ambient TDS and nitrate-nitrogen concentration exceeds the BMZ maximum benefit objectives.

4.1.1 Total Dissolved Solids

Figure 4-2 shows the maximum TDS concentrations measured at Basin wells during the 2010-2014 reporting period for 50 wells including 24 domestic wells owned by Appropriators or by Overlying Parties. The maximum TDS concentrations for domestic wells ranged from 180 to 380 mg/L and averaged 256 mg/L; this average value is just 1 mg/L higher than the average maximum TDS concentration reported in the 2008-11 Engineering Report indicating that TDS concentrations have been stable in the last seven years. Of the 18 potable wells, nine wells had a maximum concentration below the anti-degradation objective of 230 mg/L, 12 wells were between the anti-degradation and maximum benefit objective of 330 mg/L, and three exceeded the maximum benefit objective for the BMZ. None of the production wells samples exceeded the secondary federal or state drinking water standard for TDS (500 mg/L). BCVWD wells along Edgar Canyon were not included in this analysis.

Maximum TDS concentrations for the non-domestic wells had a much wider range from 203 to 768 mg/L and averaged 319 mg/L just below the maximum benefit objectives. Average concentrations were slightly below those previously reported in the 2008-11 Engineering

Report. Of the 26 non-domestic wells, 3 had a maximum TDS concentration below the anti-degradation objective, 14 wells were between the anti-degradation and maximum benefit objectives, and eight exceeded the maximum benefit objective; two of these wells also exceeded the secondary drinking standard of 500 mg/L.

Most of the wells with the highest TDS concentrations, include those that exceeded drinking water standards are located within the BMZ, but outside the Beaumont Basin.

4.1.2 Nitrate-Nitrogen

Figure 4-3 shows the maximum Nitrate-N concentrations measured at Basin wells during the 2010-2014 reporting period for 47 wells including 23 domestic wells owned by Appropriators or by Overlying Parties. The maximum Nitrate-N concentrations for domestic wells ranged from 0.87 to 8.44mg/L and averaged 2.94 mg/L. Of these wells, six had a maximum concentration below the anti-degradation objective of 1.5 mg/L, 12 wells had a maximum concentration between the anti-degradation and maximum benefit objective of 5.0 mg/L, and five wells exceeded the maximum benefit objective for the BMZ. Three of these wells (Sharondale Mesa No. 2, BCVWD 21, and Rancho Calimesa Mobile Home Park No. 2) also exceeded the 80 percent MCL for Nitrate-N, which is considered as a threshold level that CDPH uses to begin considering potential blending and/or treatment alternatives to address high nitrate concentrations in drinking water. None of the potable wells exceeded the primary federal and state drinking water standard for nitrate-nitrogen of 10 mg/L.

Maximum Nitrate-N concentrations in the 24 non-domestic wells ranged from 0.51 to 47 mg/L. Average maximum concentrations for these wells (6.84 mg/L) exceeded the maximum benefit objective for the BMZ. Of these wells, three had maximum concentrations below the anti-degradation objective, five had maximum concentrations between the anti-degradation and the maximum benefit objective, and the remaining 16 above the maximum benefit objective. In addition, eight of these wells had maximum concentrations equal to or higher than the primary federal and state drinking water standard.

The highest Nitrate-N concentration within the Beaumont Basin was observed at a private well with a concentration of 47 mg/L; this well is located a little more than half a mile north of BCVWD Well No. 29 in the Singleton Basin. Other wells exceeding the current MCL are mainly located south of the basin in the South Beaumont Basin.

4.1.3 Nitrate Studies in the Beaumont Management Zone

Rising nitrate concentrations observed in 2005 along the northern portion of the Basin prompted STWMA to launch an investigation in 2006 to determine the potential impact on groundwater quality from on-site waste disposal systems (OSWDS) commonly used in the Cherry Valley Community of Interest (CVCOI). STWMA retained the services of Wildermuth Environmental Inc. (WEI) to conduct this study.

The results of this study were disputed by the Beaumont Board of Supervisors' Groundwater Quality Evaluation Committee (Committee) as they identified potential shortcomings in sampling design and project execution. The Committee recommended that an independent assessment be conducted. They recommended that the second study should expand the study area, consider reasonable build-out projections and other sources of groundwater

contamination. This independent study was conducted by scientist at the University of California, Riverside and funded as a Supplemental Environmental Project by the State Water Resources Control Board. The results of this study were published in early 2012. A brief summary and their findings is presented below for information purposes only.

Summary of Wildermuth Environmental Inc. Study

This study is titled: "*Water Quality Impacts from On-Site Waste Disposal Systems in the Cherry Valley Community of Interest*" (WEI, 2007). The bases for this study include the following:

- A review of scientific literature,
- A field study to estimate nitrogen concentrations in soil water below selected OSWDS,
- A tracer study of nitrogen isotope and pharmaceutical and personal care products (PPCP) to confirm the presence of effluent from OSWDS,
- An estimation of current and future discharge from OSWDS to groundwater,
- A planning-level evaluation of basin impacts using the groundwater flow and nitrate transport model, and
- A review of the threshold used in California to compel sewerage when OSWDS contaminate or threaten to contaminate groundwater

The results of the investigation are summarized as follows:

- Parcel density in the CVCOI violates the minimum half-acre parcel size requirement of the Regional Board to be on a septic system.
- Water produced from high nitrate wells in the area has a nitrogen isotopic signature and contain PPCPs consistent with discharge from OSWDS.
- Present contribution of OSWDS discharges is estimated at 665 ac-ft/yr.; this represents about five percent of total recharge to the BMZ. At ultimate buildout, there will be between 4,900 to 8,800 OSWDS in the CVCOI. Discharge contribution from these OSWDS is estimated between 1,700 and 3,100 ac-ft/yr. representing 13 to 21 percent of total recharge to the BMZ.
- At 4,900 lots, the contributions from OSWDS will significantly impact water quality to the point that well head treatment will be required at certain well locations in order to meet drinking water standards. At 8,800 lots, the contributions from OSWDS will rendered the entire BMZ non-potable.
- Left unmitigated, OSWDS discharges will contribute enough nitrate to exceed the Basin Plan objectives for the BMZ.
- There is sufficient evidence of groundwater contamination by OSWDS to warrant the Regional Board to issue a prohibition on new OSWDS in the CVCOI.

According to WEI, as a result of this investigation, the County of Riverside issued a moratorium, followed by a permanent prohibition on the installation of septic systems in Cherry Valley unless the septic system is designed to remove at least 50 percent of the nitrogen in the

wastewater. In 2009, the County passed a new ordinance that removed the prohibition on conventional OSWDS. WEI further indicates that the Regional Board initiated a process in 2009 that may lead to amending the Basin Plan prohibiting conventional OSWDS and regulating the discharges to meet antidegradation objectives.

Summary of University of California, Riverside Study

This study is titled: *“Water Quality Assessment of the Beaumont Management Zone: Identifying Sources of Groundwater Contamination Using Chemical and Isotopic Tracers” (UCR, 2012).*

The study divides the BMZ into four distinct zones; their location is depicted in Figure 2 of the UCR report (not included here). A brief description of the zones is as follows:

Zone 1 – Region Influenced by Wastewater Treatment Plant Effluent. This zone occupies the southernmost area of the BMZ. Water quality in this zone is influenced by effluent from the City of Beaumont wastewater treatment plant.

Zone 2 – Wildland and Low Density Septic Disposal Region. This zone is defined as the area uphill of Edgar Canyon to the north of Cherry Valley. Water quality in this area had low to moderate concentrations of TDS and nitrate.

Zone 3 – Urban Region with On-site Septic Disposal Systems. This zone overlies the Cherry Valley area including the area around the Noble Creek and Little San Geronio Spreading Ponds. Human waste from homes and business in this zone is primarily disposed of in on-site waste disposal systems.

Zone 4 – Urban Region with Consolidate Sewer System. Zone 4 comprises those portions of the City of Beaumont utilizing a municipal wastewater system.

The UCR report attempted to answer a series of questions; the questions and a summary of their response is provided below.

1.- Can different groundwater regions within the BMZ be defined using isotope, PPCP, and general chemical parameters?

According to the study,

- Zone 1 was characterized by relatively high levels of PPCPs and it has the highest likelihood for nitrate contamination from human waste.
- Zone 2 had detectable levels of some PPCPs. Septic contributions to groundwater are relatively minor.
- Zone 3 had several wells with clear signs of contamination by septic systems. Groundwater in the central portion of Cherry Valley appeared to be more strongly affected by septic systems than on the periphery of Cherry Valley.
- Zone 4 shows the fewest signs of human waste as most homes are served by consolidated sewer systems.

1A.- Do areas with septic systems have different chemistry than areas with sewers?

The report indicates that there are statistically significant differences between groundwater in areas with septic systems and groundwater where sewer service is available. The concentrations of PPCPs, TDS, Nitrate-N, the sum of base cations, Boron, and Isotopes of Nitrate were all significantly higher in areas with septic systems than in areas with sewer service.

1B.- Do areas where groundwater recharge with water from the State Water Project or wastewater treatment plant effluent have different chemistry from other areas?

Strong evidence of nitrate deriving from human waste was detected in Zone 1 as well as strong biological attenuation of nitrate transported in groundwater.

2.- What sources contribute nitrate to groundwater of the BMZ?

The report indicates that in Zone 1 the isotopes of nitrate values overlap those expected for human or animal waste. Similarly, in Zone 3 the isotopic composition of water suggest a high probability of inputs of nitrate from human or animal waste. The presence of PPCPs in most samples indicates the possibility that septic systems are contaminating groundwater within the central part of Cherry Valley.

3.- How much nitrate from human waste is making its way into the groundwater of the BMZ?

The report documents the following findings:

- Mixing models suggest that between 18 to 30 percent of the nitrate in central Cherry Valley groundwater is derived from septic systems.
- If septic systems were completely phased out, nitrate concentrations in central Cherry Valley groundwater could decline by 30 percent once a steady state condition is achieved. The time to reach a steady state is anticipated to be shorter than in other portions of the BMZ due to relatively high rates of recharge in Zone 3.
- Mass balance calculations show that nitrate-nitrogen inputs from septic systems is one of the largest inputs of nitrogen to groundwater in the BMZ.
- If the waste from septic tanks were to be conveyed to the City of Beaumont WWTP, about 30 percent of the current input of nitrate from human waste to groundwater would be removed.

4.2 Comparison with Federal and State Drinking Water Standards

The California Department of Health Services (CDPH) maintains an active water quality database of all public and private drinking water wells throughout the state. This database, available at CDPH's website, was assessed for the 2010-2014 reporting period for 33 wells including 22 production wells in the Beaumont Basin. The objective of this analysis was to determine whether any of these potable and non-potable wells had exceeded the Primary or Secondary Federal and State standards or the notification levels set by the state. Federal standards are set by the United States Environmental Protection Agency (USEPA) while state standards in California are set by CDPH. Primary standards at the federal and state level are enforceable criteria that have been established to protect the public against consumption of

drinking water contaminants that present a risk to human health. Secondary standards are not enforceable standards; they have been established for aesthetic qualities of water, such as taste, color, and other. Contaminants with a secondary MCL are not considered to present a risk to human health at the established maximum level. Notification levels (NL) are not enforceable standards; however, they require that municipal water suppliers notify the public if the NL for a chemical has been exceeded.

A total of 951 water quality results were extracted from the CDPH database for the 33 production wells in the Beaumont Basin. Results were obtained for 25 analytes sampled between 2010 and 2014. The results of the analysis indicate that not a single production well exceeds either the primary or secondary federal and state standards during the reporting period. However, the California Notification Limit for Vanadium was exceeded once at SMWC Well No. 4 during the reporting period.

Additional water quality information from 2008 through 2011 was obtained from WEI as part of the Maximum Benefit Monitoring Program. A total of 2,822 water quality results were analyzed to determine if the water quality at the monitoring wells exceeded drinking water standards. Drinking standards were exceeded for a limited number of constituents as follows:

- Nitrate-N – Eight of the 17 monitoring wells sampled for Nitrate-N exceeded this federal and state primary MCL of 10 mg/L – Total of 22 readings. All of these wells are located outside the Beaumont Basin.
- pH – Three of the 16 monitoring wells sampled for pH exceeded this secondary federal MCL of 8.5 – Total of 3 readings. One of these wells is located in the Beaumont Basin.
- Total Dissolved Solids – Three of the 16 monitoring wells exceeded this federal and state secondary MCL of 500 mg/L – Total of 10 readings. These wells are located outside the Beaumont Basin.
- Turbidity – None of the eight monitoring wells sampled for turbidity exceeded this secondary California MCL of 5 NTU – Total of nine readings.

Appendix D contains summary statistics of the analytical results for the 2010-2014 period for all chemicals that have a federal or state drinking water standard whether maximum contaminant levels were exceeded.

4.2.1 Trace Metals

As indicated earlier, not a single production well exceeded either the primary or secondary federal and state standards during the reporting period. This represents a significant improvement over previous reporting periods when several wells exceeded the MCL for trace metals. Trace metals are briefly discussed here and compared to previous reporting periods.

Aluminum. There were 46 water samples taken during the reporting period and tested for aluminum. Aluminum concentration at all wells was below 50 ug/L, significantly below the secondary MCL of 200 ug/L. Aluminum above the MCL can add color to water. One well exceeded the MCL during the FY 2004-08 reporting period.

Arsenic. There were 45 water samples collected and tested for arsenic during the reporting period. The highest arsenic concentration was observed at SMWC's Well No. 4; arsenic concentration at this well has increased from 4.2 mg/L in 2009, to 4.6 mg/L in 2012, to the latest value of 5.2 mg/L in April 2013. This highest value is slightly over 50 percent the current primary MCL of 10 mg/L. One well exceeded the MCL during the FY 2004-08 reporting period.

Iron. A total of 47 water samples were taken during the reporting period and tested for iron. In most cases iron concentration was below 100 ug/L., which is significantly below the current secondary MCL of 300 ug/L. However, there are two wells that exceeded the MCL during the 2010-14 period; BCVWD Well No. 11 at 800 mg/L and BCVWD Well No. 20 at 450 mg/L in December 2012. Iron concentration at BCVWD Well No. 11 decreased significantly to 340 mg/L in August 2013. Highest iron concentration was recorded at BCVWD Well No. 4A at 120 ug/L. Iron at a concentration above the MCL can impact color, odor, and taste in water. Five wells exceeded the MCL during the FY 2004-08 reporting period.

Lead. There were 46 water samples collected and tested for lead during the reporting period. The highest concentration reported were 0.0065 mg/L at BCVWD Well No. 25 and 0.0058 mg/L at Rancho Calimesa Mobile Home Park Well No. 1. Both of these concentrations are significantly below the current primary MCL for Lead of 0.015 mg/L. Lead concentrations in water above the MCL can have significant impacts on human health. One well exceeded the MCL during the FY 2004-08 reporting period.

Manganese. There were 46 water samples taken during the reporting period and tested for Manganese. Manganese concentration at all wells was below 20 ug/L, significantly below the secondary MCL of 50 ug/L. Manganese can significantly impact color and taste in water at concentrations above the MCL. One monitoring well exceeded the MCL during the FY 2004-08 reporting period.

Total Chromium. A total of 46 water samples were taken during the reporting period and tested for total chromium. The highest reported concentration of total chromium was observed in March 2010 at BCVWD Well No. 3 at 0.02 ug/L, which is significant less than the current state primary MCL of 0.05 ug/L. One well exceeded the state primary MCL during the FY 2004-08 reporting period.

Vanadium. Three water samples were tested for vanadium during the reporting period from SMWC's Well 4 and YVWD No. 48. Vanadium at the SMWC well increased significantly during the reporting period from 17 ug/L in March 2010 to 84 ug/L in April 2013. This latest value exceeds the state notification level of 50 ug/L. Vanadium concentration at YVWD No. 48 was 25 ug/L, which is half the state notification level.


Copper. There were 46 water samples collected and tested for copper during the reporting period. Over the last five years only two wells have exceeded the detection limit of 50 ug/L; the Rancho Calimesa Well No. 2 at 62 ug/L and BCVWD Well No. 1 at 240 ug/L. Both of these concentrations are significantly below the state primary MCL of 1,300 ug/L. This is consistent with previous reporting periods.


4.2.3 pH


There are two secondary standards for pH, a lower limit of 6.5 and an upper limit of 8.5. With the exception of one well, all other production wells were within these limits with pH concentrations ranging from a low of 7.0 to a high of 8.2 with most wells in the 7.8 to 8.0 range. The highest pH was recorded at SMWC Well No. 4 at 8.9. Four wells in the basin exceeded the upper limit for pH during the FY 2004-08 reporting period.

4.2.4 Turbidity

Turbidity is a measure of the cloudiness of water, and is used to indicate water quality and filtration effectiveness. All production wells in the Basin were tested for turbidity and none exceeded the primary federal and state MCL of 5 NTU.

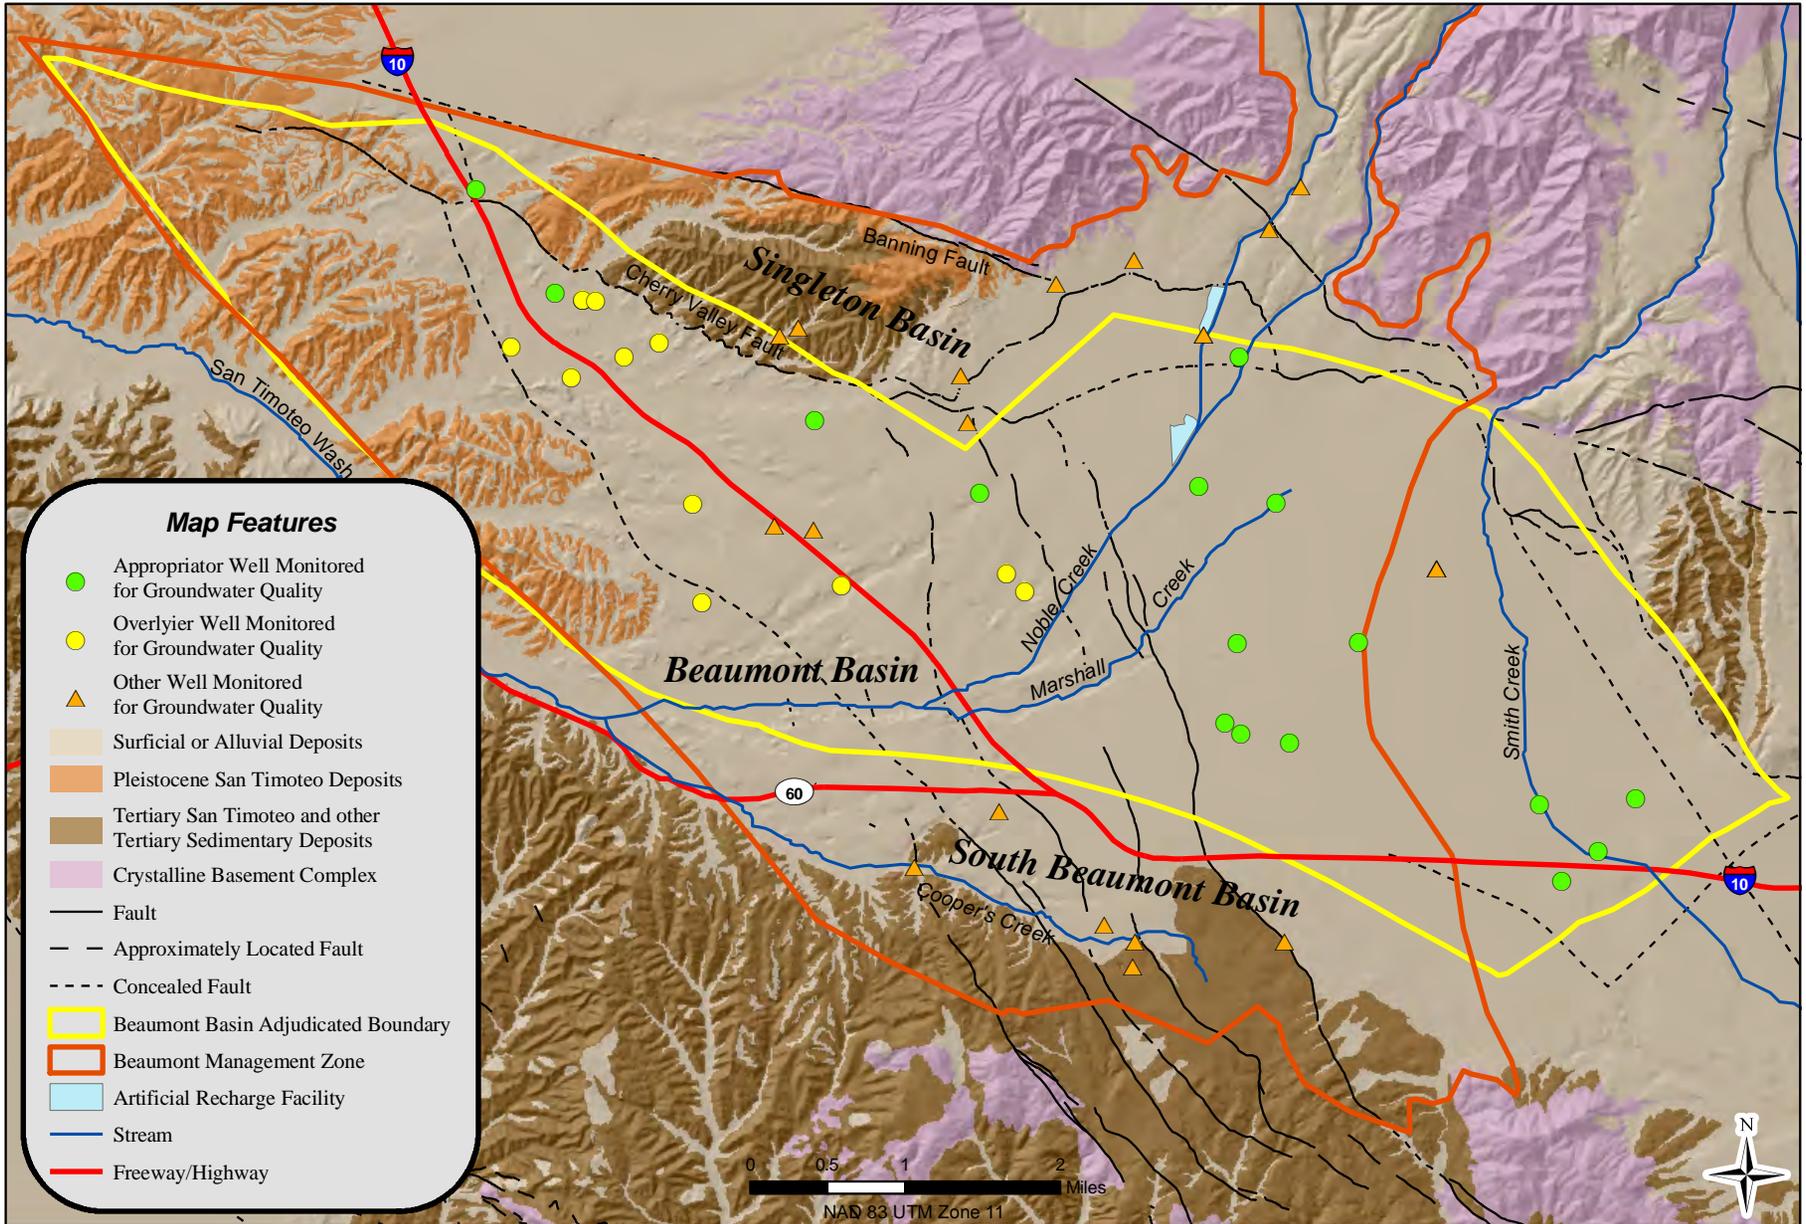

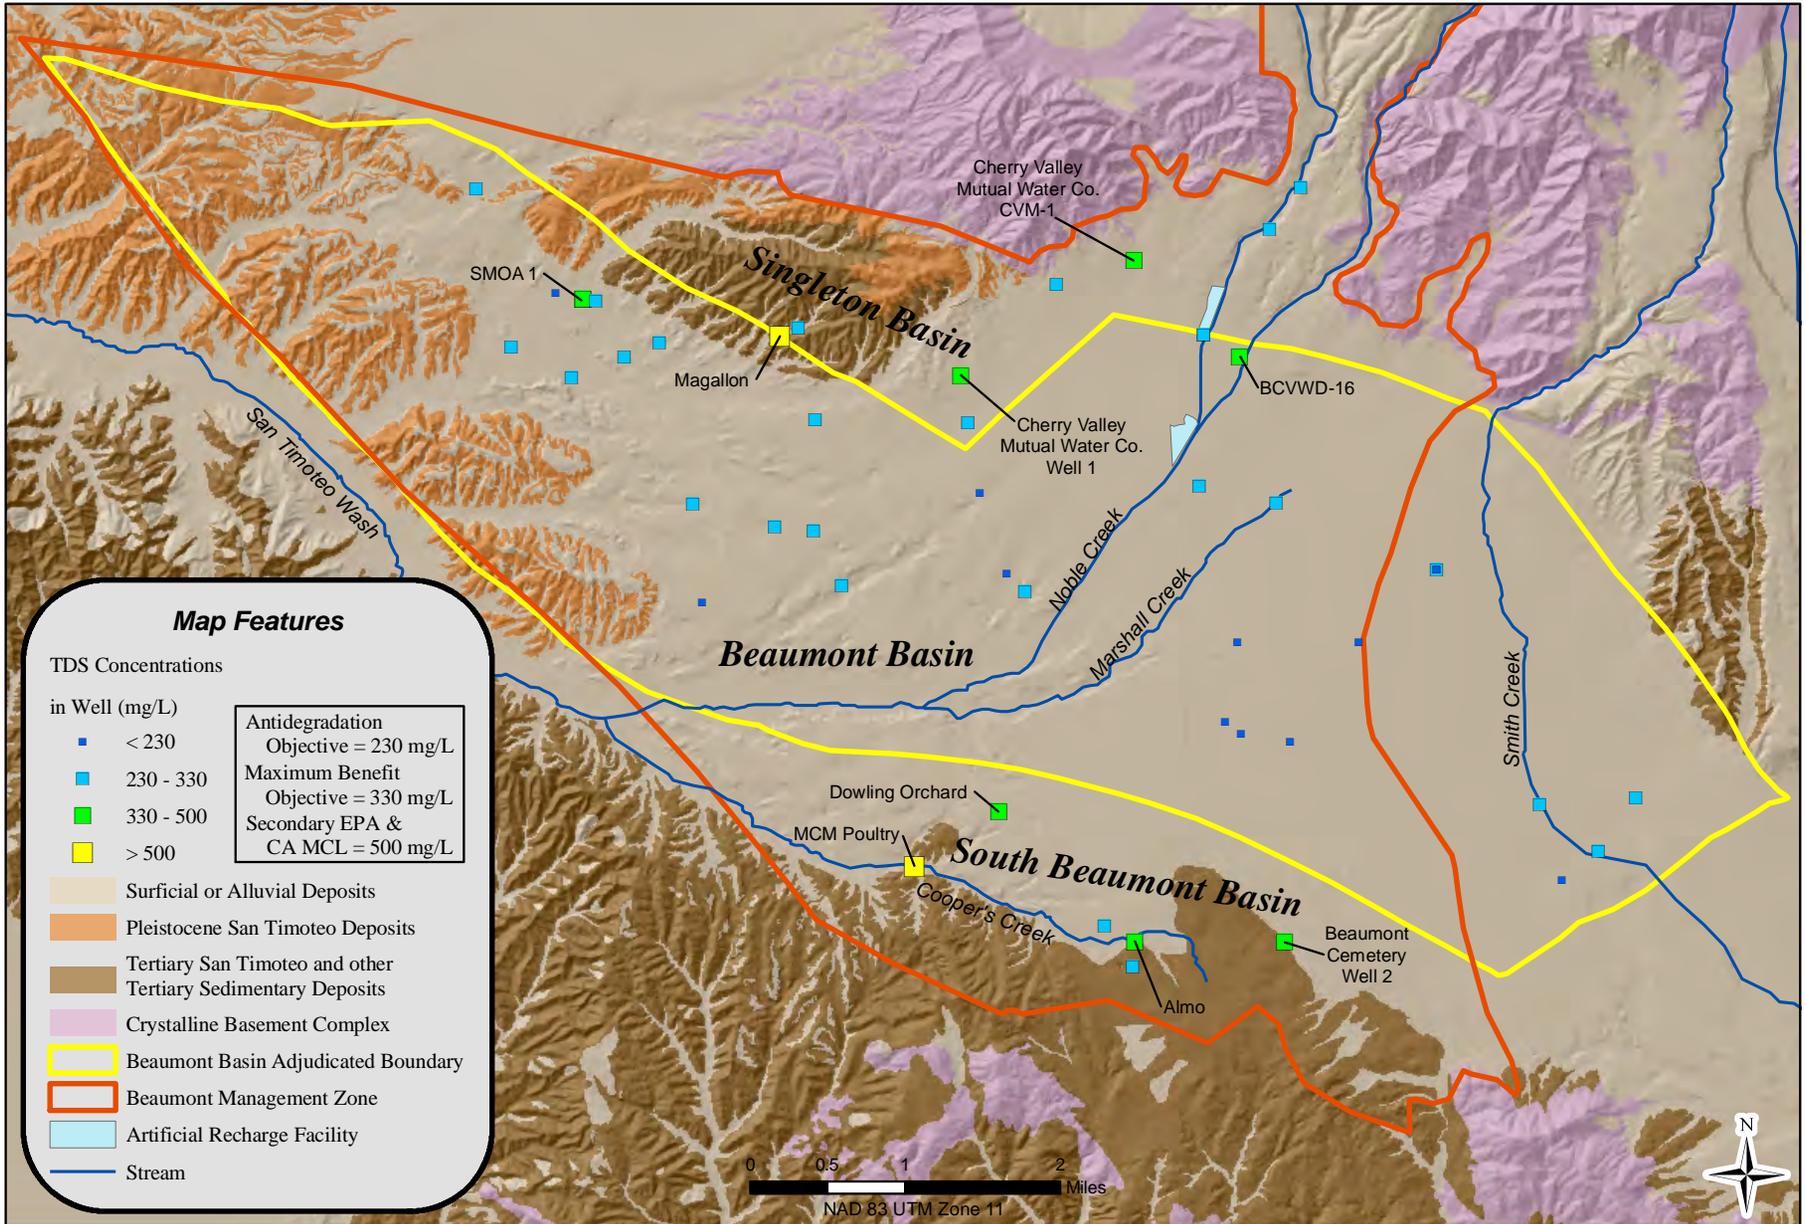

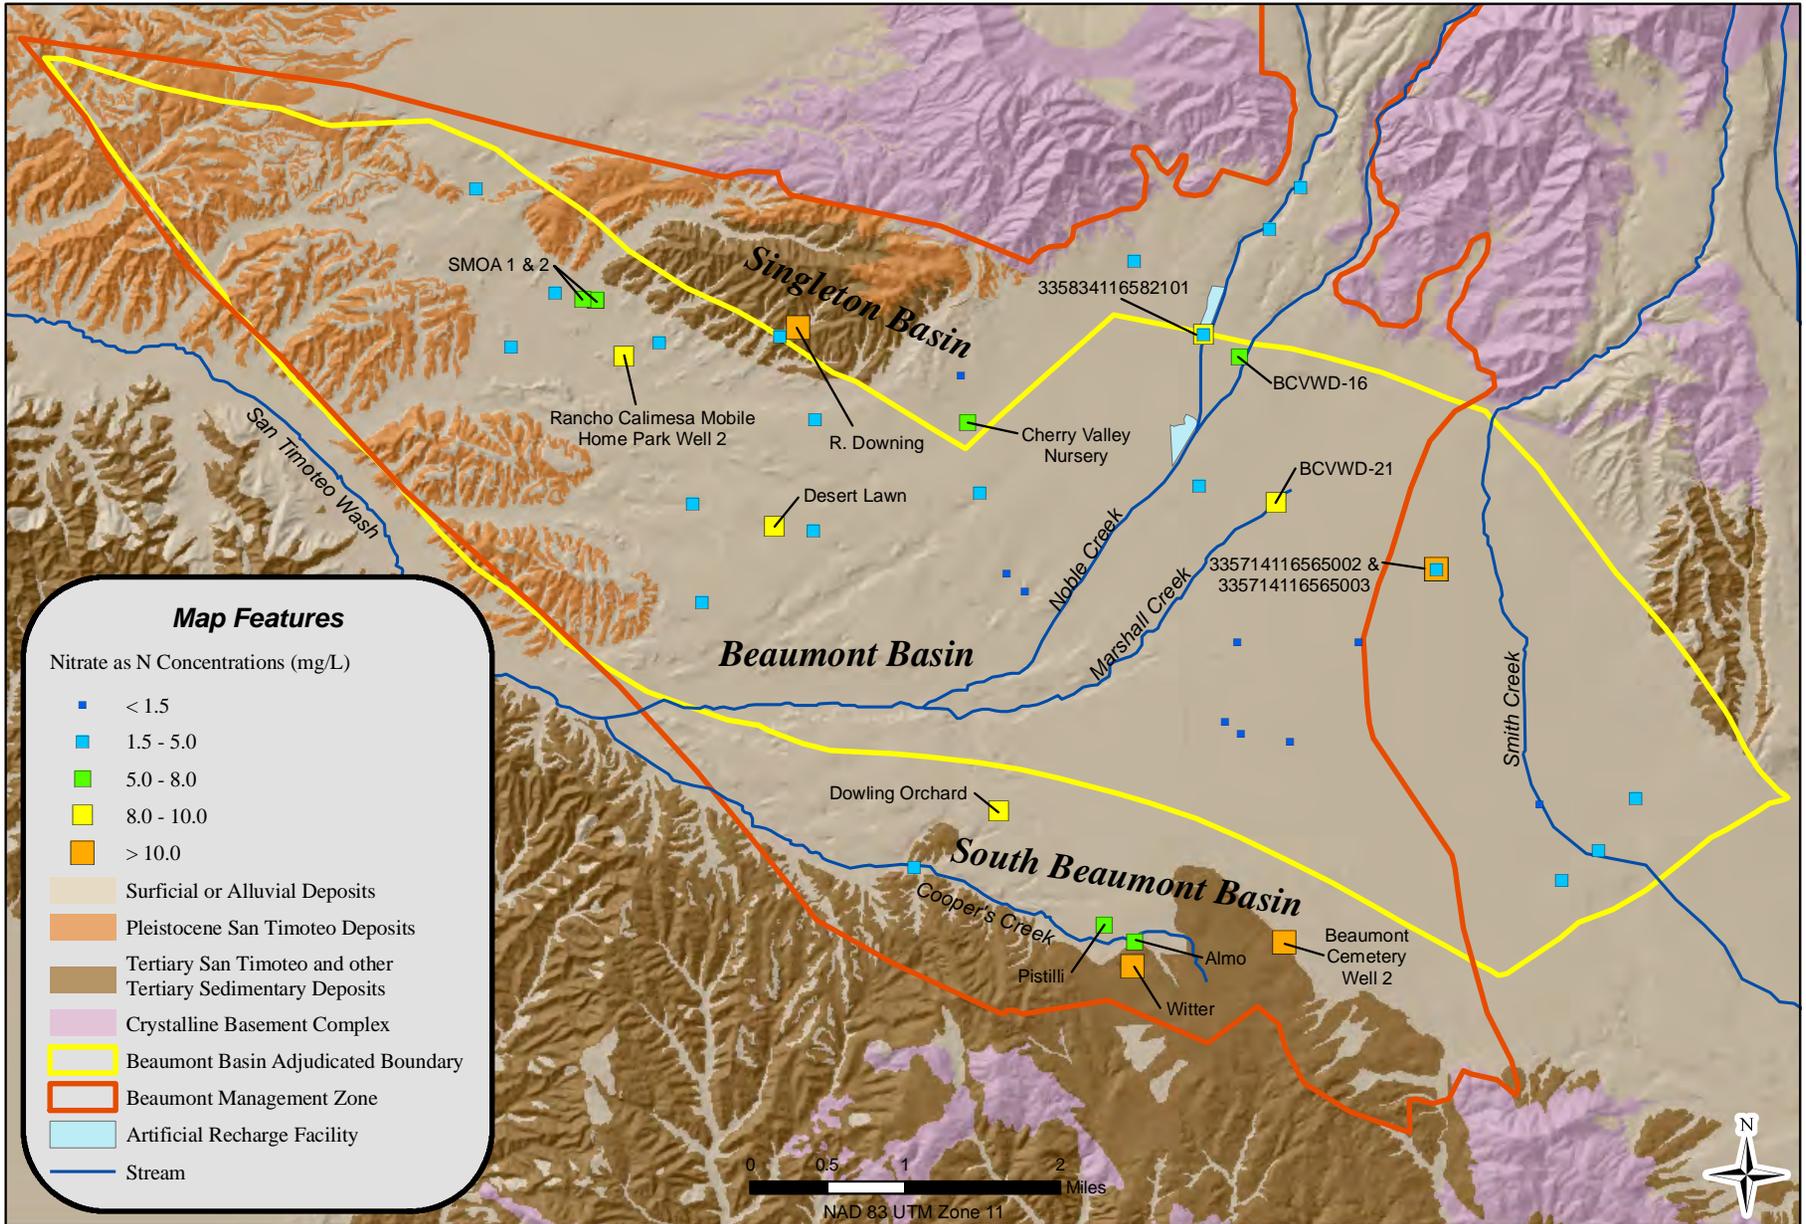

Section 5

Land Subsidence

In the first ten years of operations under the Judgment, a temporary surplus was established that allows up to 160,000 acre-ft of overdraft within the Basin. The purpose of the temporary surplus was to create room for the safe storage of supplemental water and to reduce losses from the basin. A major concern is that overdraft of the groundwater basin may lead to the lowering of groundwater levels and, subsequently, to land subsidence and ground fissuring. To proactively address this concern, the STWMA and the Watermaster developed a monitoring program specifically to assess the occurrence of subsidence from past groundwater pumping and future pumping. To implement this program, the STWMA, on behalf of the Watermaster, successfully applied for an AB303 Grant from the California Department of Water Resources (DWR)

The Subsidence Monitoring Program was established in 2005. Initially, ground level information for the 1928 to 2000 period was analyzed. In mid to late 2006, 72 benchmark monuments were installed across the Basin and in nearby basins and an initial ground-level survey conducted to establish the initial elevations of all benchmarks. A second survey was conducted in 2007. A comparison analysis of the two surveying efforts reveals little vertical change; in addition, this minimum subsidence was fairly evenly distributed across the Basin. According to the program, the ground level survey of all benchmarks was to be conducted on a tri-annual basis with the next round of survey scheduled for the spring of 2009. The 2009 survey was not conducted by Watermaster since it was determined that the level of subsidence was minimal. No additional surveys are scheduled at this time.

Appendix A

Active and Interested Party List

Beaumont Basin - 2014 Active and Interested Party List

City of Banning

Duane Burk
Post Office Box 998
Banning, CA 92220
dburk@ci.banning.ca.us

City of Banning

Arturo Vela
Post Office Box 998
Banning, CA 92220
avela@ci.banning.ca.us

Yucaipa Valley Water District

Joseph Zoba
Post Office Box 730
Yucaipa, CA 92399
jzoba@yvwd.dst.ca.us

South Mesa Mutual Water Company

George Jorritsma
Post Office Box 458
Calimesa, CA 92320
smwc@verizon.net

South Mesa Mutual Water Company

Dave Armstrong
Post Office Box 458
Calimesa, CA 92320
darmstrongsmwc@yahoo.com

Beaumont-Cherry Valley Water District

Eric Fraser
560 Magnolia Avenue
Beaumont, CA 92223
eric.fraser@bcvwd.org

Beaumont-Cherry Valley Water District

Anthony Lara
560 Magnolia Avenue
Beaumont, CA 92223
tony.lara@bcvwd.org

Beaumont-Cherry Valley Water District

Dawn Jorge
560 Magnolia Avenue
Beaumont, CA 92223
dawn.jorge@bcvwd.org

Yucaipa Valley Water District

Jack Nelson
Post Office Box 730
Yucaipa, CA 92399
jnelson@yvwd.dst.ca.us

City of Beaumont

Kyle Warsinski
550 East Sixth Street
Beaumont, CA 92223
kwarsinski@ci.beaumont.ca.us

Urban Logic Consultants

Dave Dillon
43517 Ridge Park Drive, Suite 200
Temecula, CA 92590
ulcdave@aol.com

Urban Logic Consultants

Dee Moorjani
43517 Ridge Park Drive, Suite 200
Temecula, CA 92590

Sharondale Mesa Owners Association

William Wood
9525 Sharon Way
Calimesa, CA 92320

Sharondale Mesa Owners Association

Ira Pace
9525 Sharon Way
Calimesa, CA 92320
rbnjp@msn.com

Plantation on the Lake

James Krueger
10961 Desert Lawn Drive
Calimesa, CA 92320
jimk@mrc1.com

Robert Hawkins, Esq.

110 Newport Center Drive, Suite 200
Newport Beach, CA 92660

California Oak Valley Golf and Resort, LLC.

Ron Sullivan
27710 Jefferson Avenue, Suite 301
Temecula, CA 92590

Oak Valley Partners, LP.

John Ohanian
Post Office Box 645
10410 Roberts Road
Calimesa, CA 92320

Beaumont Basin - 2014 Active and Interested Party List

Latham and Watkins, LLP.

Paul Singarella, Esq.
650 Town Center Drive, 20th Floor
Costa Mesa, CA 92626-1925

Southern California Professional Golfers Association of America

Tom Addis
36201 Champions Drive
Beaumont, CA 92223

Best, Best and Krieger

Greg Wilkinson, Esq.
3750 University Avenue, Suite 400
Riverside, CA 92501

Manheim, Manheim and Berman

Steve Anderson, Esq.
c/o Best, Best and Krieger
3750 University Avenue, Suite 400
Riverside, CA 92501

Sunny Cal Egg and Poultry Company

Steve Anderson, Esq.
c/o Best, Best and Krieger
3750 University Avenue, Suite 400
Riverside, CA 92501

Mrs. Beckman

38201 Cherry Valley Boulevard
Cherry Valley, CA 92223

Merlin Properties, LLC.

Fred and Richard Reidman
6475 East Pacific Coast Highway, Suite 399
Long Beach, CA 90803
riedman@gte.net

Leonard Stearns

Post Office Box 141
Calimesa, CA 92320

San Bernardino Valley Municipal Water District

Douglas Headrick
380 East Vanderbilt Way
San Bernardino, CA 92408

San Gorgonio Pass Water Agency

Ted Haring
1210 Beaumont Avenue
Beaumont, CA 92223

San Bernardino Valley Municipal Water District

Sam Fueller
380 East Vanderbilt Way
San Bernardino, CA 92408

San Gorgonio Pass Water Agency

Jeff Davis
1210 Beaumont Avenue
Beaumont, CA 92223

San Gorgonio Pass Water Agency

Barbara Voigt
1210 Beaumont Avenue
Beaumont, CA 92223

San Gorgonio Pass Water Agency

John Jeter
1210 Beaumont Avenue
Beaumont, CA 92223

San Gorgonio Pass Water Agency

Ray Morris
1210 Beaumont Avenue
Beaumont, CA 92223

San Gorgonio Pass Water Agency

Mary Ann Melleby
1210 Beaumont Avenue
Beaumont, CA 92223

San Gorgonio Pass Water Agency

Ron Duncan
1210 Beaumont Avenue
Beaumont, CA 92223

San Gorgonio Pass Water Agency

Bill Dickson
1210 Beaumont Avenue
Beaumont, CA 92223

Ted Haring

10961 - 354 Desert Lawn Drive
Calimesa, CA 92320
tdharing@msn.com

Robert C. Newman

29455 Live Oak Canyon Road
Redlands, CA 92373
newman4governor@aol.com

Beaumont Basin - 2014 Active and Interested Party List

San Geronio Pass Water Agency

Cheryle Rasmussen
1210 Beaumont Avenue
Beaumont, CA 92223

Aklufi and Wysocki

Joe Aklufi, Esq.
3403 Tenth Street, Suite 610
Riverside, CA 92501

Redwine and Sherrill

Gil Granito, Esq.
1950 Market Street
Riverside, CA 92501

Wildermuth Environmental, Inc.

Mark J. Wildermuth
23692 Birtcher Drive
Lake Forest, CA 92630-1790

Wildermuth Environmental, Inc.

Samantha Adams
23692 Birtcher Drive
Lake Forest, CA 92630-1790

Patsy Reeley

10096 Live Oak Avenue
Cherry Valley, CA 92223

Luwana Ryan

9574 Mountain View Avenue
Cherry Valley, CA 92223

Frances Flanders

41045 Mohawk Circle
Cherry Valley, CA 92223

Albor Properties

Eric Borstein
12301 Wilshire Boulevard, Suite 302
Los Angeles, CA 90025

Niki Magee

38455 Vineland Street
Cherry Valley, CA 92223

Judy Bingham

115 Viele Avenue
Beaumont, CA 92223

Thomas Harder and Company

Thomas Harder
1260 N. Hancock, Suite 109
Anaheim, CA 92807
tharder@thomashardercompany.com
714.792.3875

Alvarado Smith

Thierry Montoya
1 Mac Arthur Place
Santa Ana, CA 92707
714.852.6800

Alda, Inc.


Anibal Blandon
5928 Vineyard Avenue
Rancho Cucamonga, CA 91701
blandon@aldaengineering.com
909.587.9916

Appendix B


Fiscal Year 2013-14 Audit Letter

BEAUMONT BASIN WATERMASTER
INDEPENDENT ACCOUNTANT'S REPORT ON APPLYING
AGREED-UPON PROCEDURES
ON THE BEAUMONT BASIN WATERMASTER SCHEDULES

June 30, 2014



ROGERS, ANDERSON, MALODY & SCOTT, LLP
CERTIFIED PUBLIC ACCOUNTANTS, SINCE 1948



ROGERS, ANDERSON, MALODY & SCOTT, LLP
 CERTIFIED PUBLIC ACCOUNTANTS, SINCE 1948

735 E. Carnegie Dr. Suite 100
 San Bernardino, CA 92408
 909 889 0871 T
 909 889 5361 F
 ramscpa.net

**INDEPENDENT ACCOUNTANT'S REPORT ON APPLYING
 AGREED-UPON PROCEDURES**

PARTNERS

Brenda L. Odle, CPA, MST
 Terry P. Shoa, CPA
 Kirk A. Franks, CPA
 Matthew B. Wilson, CPA, MSA, CGMA
 Scott W. Manno, CPA, CGMA
 Leana Stambing, CPA, MST, CGMA
 Jay H. Zercher, CPA (Partner Emeritus)
 Phillip H. Walter, CPA (Partner Emeritus)

MANAGERS / STAFF

Bradford A. Welebir, CPA, MBA
 Jenny Liu, CPA, MST
 Papa Hagar Thilaw, CPA, MBA
 Maya S. Ivanova, CPA, MBA
 Seong-Hyea Lee, CPA, MBA
 Charles De Simon, CPA
 Yuen Fang, CPA
 Daniel T. Turner, CPA, MSA
 David D. Henwood, CPA
 Nathan Starham, CPA, MBA
 Brigitta Bartha, CPA
 Gardenya Duran, CPA
 Juan Romero, CPA
 Ivan Gonzales, CPA, MSA

Yucaipa Valley Water District as treasurer
 of the Beaumont Basin Watermaster
 Yucaipa, California

We have performed the procedures enumerated below, which were agreed to by the Yucaipa Valley Water District (District), as treasurer of the Beaumont Basin Watermaster (Watermaster), solely to assist the District in evaluating certain amounts reported in the Watermaster Schedules (Schedules), attached as Exhibit A and Exhibit B, on the full accrual basis of accounting as of June 30, 2014 and for the year then ended. The District and Watermaster are responsible for the accuracy of the Schedules. This agreed-upon procedures engagement was conducted in accordance with attestation standards established by the American Institute of Certified Public Accountants. The sufficiency of the procedures is solely the responsibility of those parties specified in the report. Consequently, we make no representations regarding the sufficiency of the procedures described below, either for the purpose for which this report has been requested or for any other purpose.

Our procedures and findings are as follows:

1. Procedure

Agree the opening equity on Exhibit B to the ending equity noted on the trial balance for the fiscal year ended June 30, 2013.

Finding

No exceptions were noted as a result of applying the procedure.

2. Procedure

Agree the cash balance reported on Exhibit A to the bank reconciliation, bank statement and trial balance. Select all of the deposits in transit and outstanding checks and trace their clearing to the subsequent month's bank statement.

Finding

No exceptions were noted as a result of applying the procedure.

MEMBERS

American Institute of
 Certified Public Accountants

*FCPS The AICPA Alliance
 for CPA Firms*

*Governmental Audit
 Quality Center*

California Society of
 Certified Public Accountants

3. Procedure

Trace all member agency assessments recorded in the schedule to invoices and the bank statements.

Finding

No exceptions were noted as a result of applying the procedure.

4. Procedure

Compare the ending check number for the fiscal year ended June 30, 2013 to the beginning check number for the period beginning on July 1, 2013. Note any breaks in check sequence for the period of July 1, 2013 through June 30, 2014.

Finding

No exceptions were noted as a result of applying the procedure. We noted a break in the sequence which was due to two voided checks. The Watermaster was able to provide the original copies of the voided checks.

5. Procedure

Based on the population of checks issued during July 1, 2013 through June 30, 2014, select all payments and trace the check to supporting invoice noting whether the activity pertains to the Watermaster. Agree the dollar amount and vendor on the invoice to the check for accuracy.

Finding

No exceptions were noted as a result of applying the procedure.

6. Procedure

Obtain the general ledger detail for the period of July 1, 2013 to June 30, 2014. Select all journal entries and trace the transaction to an approved journal entry and documentation supporting the nature and rationale of the journal entry.

Finding

No exceptions were noted as a result of applying the procedure.

We were not engaged to, and did not conduct an audit, the objective of which would be the expression of an opinion on the schedules of assets, liabilities and equity (Exhibit A) and assessments and expenses (Exhibit B) or the related internal control structure. Accordingly, we do not express such an opinion. Had we performed additional procedures, other matters might have come to our attention that would have been reported to you.

This report is intended solely for the use of the Watermaster and the District and is not intended to be and should not be used by anyone other than the specified party.

Rogers Anderson Maloney & Scott, LLP

August 19, 2014
San Bernardino, CA

Beaumont Basin Watermaster
Schedule of Assets, Liabilities and Net Assets
(Unaudited)
June 30, 2014

Assets

Cash and cash equivalents

\$ 22,057**Liabilities**

Accounts payable

-**Net assets**

Unrestricted

\$ 22,057

**Beaumont Basin Watermaster
Schedule of Revenues and Expenses
(Unaudited)
For the year ended June 30, 2014**

Revenues	
Assessments	\$ 50,253
Interest	154
	<hr/>
Total revenues	50,407
	<hr/>
Expenses	
Special projects	
Acquisition/computation and annual report	47,443
Engineering	187,591
Administrative	
Meetings and miscellaneous	432
Legal and professional	12,428
Bank charges	9
	<hr/>
Total expenses	247,903
	<hr/>
Change in net assets	(197,496)
Unrestricted net assets, beginning of year	219,553
	<hr/>
Unrestricted net assets, end of year	\$ 22,057
	<hr/> <hr/>

Appendix C

Production Estimation Methods for Unmetered Overlying Producers

Production Estimation for Un-metered Overlying Producers

Introduction

The Water Duty Method is a method used to estimate groundwater production for individual Overlying Users whose wells do not have water meters. The method was initially developed by Wildermuth Environmental Inc. (WEI) during the preparation of the 2005-06 Annual Report for the Watermaster. This method was later updated by WEI and it has been used since.

This appendix presents a list of un-metered Overlying Users, a summary of the Water Duty Method, and updated production estimates.

Unmetered Overlying Users

The Water Duty Method was applied to the following un-metered Overlying Users:

- Merlin Properties
- Roman Catholic Bishop of San Bernardino County
- Leonard M. and Dorothy D. Stearns
- Sunny-Cal Egg and Poultry Company
- Albor Properties III, LP
- Nick Nikodinov
- Ronald L. McAmis
- Nicolas and Amalia Aldama
- Hector Gutierrez, Luis Gutierrez, and Sebastian Monroy
- Boris and Miriam Darmont

Water Duty Method

The following is a summary of the main elements of the water duty method.

- The method is used to estimate groundwater pumping for indoor, outdoor, and agricultural use.
- Indoor water use is estimated based on the number of dwelling units on each producer's property. From historical water sales records in the BCVWD's service area, indoor water used was estimated 0.35 ac-ft/yr per dwelling unit. This consumption rate was applied to each Overlying User based on the number of dwelling units in their property.
- Outdoor water uses the Crop Water Requirement approach to estimate, based on the acreage of irrigated landscape, the volume of water pumped on each producer's property. This approach uses evapotranspiration records from the CIMIS Station 44, located at the University of California, Riverside, and crop type to determine the amount

of water required for landscape use; an irrigation efficiency of 70 percent is then used to estimate the volume of water pumped.

- Agricultural water use was limited to the operations of the former Sunny-Cal Egg and Poultry Company. The approach considers the water consumption of chickens and the amount of water used for washing ranch facilities. A water consumption rate of 60 gallons per day per 1,000 chickens was used, based on published daily nutritional requirements. Water for washing of ranch facilities was considered to be equal to the amount use for landscape irrigation on a per acre basis.

Estimated Water Production

The estimate of groundwater production from un-metered Overlying Users is presented for each user in the tables attached. It should be noted that very small differences exists between the amounts published in previous reports and the numbers presented here. The differences are based on the evapotranspiration values obtained from the CIMIS station; some published values currently used were slightly different than those used in the past for selected months.

**University of California Riverside - CIMIS Station 44
Monthly Evapotranspiration Values - 2002 through 2014**

Year	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
2002	2.65	3.60	4.68	4.88	6.34	7.13	7.55	6.95	5.66	3.13	3.15	2.01	57.73
2003	3.05	2.57	4.61	5.00	5.65	5.16	7.05	7.46	5.54	4.08	2.23	2.07	54.47
2004	2.49	2.76	4.81	5.90	7.10	6.50	7.55	6.81	5.83	3.39	2.44	2.30	57.88
2005	2.02	2.21	3.93	5.41	6.47	6.49	7.28	6.68	5.32	3.65	2.84	2.15	54.45
2006	2.92	3.35	3.42	4.26	6.02	7.73	7.20	7.20	5.70	3.95	3.14	2.94	57.79
2007	3.28	2.91	5.02	5.04	6.47	7.16	7.57	7.09	5.44	4.34	2.81	2.24	59.37
2008	1.69	2.31	5.30	6.04	6.28	7.59	7.53	7.23	5.79	5.02	3.14	1.89	59.81
2009	3.32	2.41	4.62	5.58	6.32	5.37	7.60	6.68	5.89	4.40	3.18	2.08	57.45
2010	2.35	2.44	4.67	5.11	6.18	6.25	6.57	6.99	5.45	2.10	3.22	1.78	53.11
2011	2.91	2.91	4.22	5.57	6.67	6.95	7.76	7.65	5.47	4.03	2.45	2.82	59.41
2012	3.02	3.41	4.51	5.85	7.00	7.62	7.93	7.83	6.44	4.38	2.72	1.70	62.41
2013	2.72	3.18	4.80	5.71	7.01	7.36	7.13	7.37	6.14	4.27	2.76	2.80	61.25
2014	3.27	3.03	4.95	6.52	7.65	7.62	7.76	7.29	6.19	4.40	3.21	2.01	63.90

Crop Coefficient (Warm Season Bermuda Grass)

Year	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Kc	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7

Monthly Water Requirements (inches)

Year	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
2004	1.74	1.93	3.37	4.13	4.97	4.55	5.29	4.77	4.08	2.37	1.71	1.61	40.52
2005	1.41	1.55	2.75	3.79	4.53	4.54	5.10	4.68	3.72	2.56	1.99	1.51	38.12
2006	2.04	2.35	2.39	2.98	4.21	5.01	5.41	5.04	3.99	2.77	2.20	2.06	40.45
2007	2.30	2.04	3.51	3.53	4.53	5.01	5.30	4.96	3.81	3.04	1.97	1.57	41.56
2008	1.18	1.62	3.71	4.23	4.40	5.31	5.27	5.06	4.05	3.51	2.20	1.32	41.87
2009	2.32	1.69	3.23	3.91	4.42	3.76	5.32	4.68	4.12	3.08	2.23	1.46	40.22
2010	1.65	1.71	3.27	3.58	4.33	4.38	4.60	4.89	3.82	1.47	2.25	1.25	37.18
2011	2.04	2.04	2.95	3.90	4.67	4.87	5.43	5.36	3.83	2.82	1.72	1.97	41.59
2012	2.11	2.39	3.16	4.10	4.90	5.33	5.55	5.48	4.51	3.07	1.90	1.19	43.69
2013	1.90	2.23	3.36	4.00	4.91	5.15	4.99	5.16	4.30	2.99	1.93	1.96	42.88
2014	2.29	2.12	3.47	4.56	5.36	5.33	5.43	5.10	4.33	3.08	2.25	1.41	44.73

Indoor Water Use: 0.35 ac-ft/yr/du
Irrigation Efficiency: 70%

Estimated Pumping - All Unmetered Accounts

Year	Total Use (ac-ft/yr)
2004	534.36
2005	511.89
2006	149.53
2007	81.53
2008	83.08
2009	82.77
2010	81.15
2011	81.97
2012	82.37
2013	82.28
2014	82.47

Estimated Pumping by Merilin Properties

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	48	3	1.05	0.11	0.37	0.53	1.58
2005	48	3	1.05	0.11	0.35	0.50	1.55
2006	48	3	1.05	0.11	0.37	0.53	1.58
2007	48	3	1.05	0.11	0.38	0.54	1.59
2008	48	3	1.05	0.11	0.38	0.55	1.60
2009	48	3	1.05	0.11	0.37	0.53	1.58
2010	48	3	1.05	0.11	0.34	0.49	1.54
2011	48	3	1.05	0.11	0.38	0.54	1.59
2012	48	3	1.05	0.11	0.40	0.57	1.62
2013	48	3	1.05	0.11	0.39	0.56	1.61
2014	48	3	1.05	0.11	0.41	0.59	1.64

Estimated Pumping by Rancho Calimesa

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	29	195	68.25	0.00	0.00	0.00	68.25
2005	29	195	68.25	0.00	0.00	0.00	68.25
2006	29	195	68.25	0.00	0.00	0.00	68.25
2007	29	198	69.30	0.00	0.00	0.00	69.30
2008	29	198	69.30	0.00	0.00	0.00	69.30
2009	29	198	69.30	0.00	0.00	0.00	69.30
2010	29	198	69.30	0.00	0.00	0.00	69.30
2011	29	198	69.30	0.00	0.00	0.00	69.30
2012	29	198	69.30	0.00	0.00	0.00	69.30
2013	29	198	69.30	0.00	0.00	0.00	69.30
2014	29	198	69.30	0.00	0.00	0.00	69.30

Estimated Pumping by Roman Catholic Bishop of San Bernardino

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	34	2	0.70	12.10	40.85	58.36	59.06
2005	34	2	0.70	12.10	38.43	54.90	55.60
2006	34	2	0.70	12.10	40.79	58.27	58.97
2007	34	2	0.70	0.00	0.00	0.00	0.70
2008	34	2	0.70	0.00	0.00	0.00	0.70
2009	34	2	0.70	0.00	0.00	0.00	0.70
2010	34	0	0.00	0.00	0.00	0.00	0.00
2011	34	0	0.00	0.00	0.00	0.00	0.00
2012	34	0	0.00	0.00	0.00	0.00	0.00
2013	34	0	0.00	0.00	0.00	0.00	0.00
2014	34	0	0.00	0.00	0.00	0.00	0.00

Estimated Pumping by Leonard Stearns

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	91	3	1.05	0.00	0.00	0.00	1.05
2005	91	3	1.05	0.00	0.00	0.00	1.05
2006	91	3	1.05	0.00	0.00	0.00	1.05
2007	91	3	1.05	0.00	0.00	0.00	1.05
2008	91	3	1.05	0.00	0.00	0.00	1.05
2009	91	3	1.05	0.00	0.00	0.00	1.05
2010	91	2	0.70	0.00	0.00	0.00	0.70
2011	91	2	0.70	0.00	0.00	0.00	0.70
2012	91	2	0.70	0.00	0.00	0.00	0.70
2013	91	2	0.70	0.00	0.00	0.00	0.70
2014	91	2	0.70	0.00	0.00	0.00	0.70

Estimated Pumping by Sunny Cal

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Number of Chickens	Chicken Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	200	10	3.50	1,200,000	80.65	66.40	224.19	320.27	404.42
2005	200	10	3.50	1,200,000	80.65	66.40	210.90	301.29	385.44
2006	185	2	0.70	0.00	0.00	0.40	1.35	1.93	2.63
2007	185	2	0.70	0.00	0.00	0.40	1.39	1.98	2.68
2008	185	2	0.70	0.00	0.00	0.70	2.44	3.49	4.19
2009	185	2	0.70	0.00	0.00	0.70	2.35	3.35	4.05
2010	185	2	0.70	0.00	0.00	0.70	2.17	3.10	3.80
2011	185	2	0.70	0.00	0.00	0.70	2.43	3.47	4.17
2012	185	2	0.70	0.00	0.00	0.70	2.55	3.64	4.34
2013	185	2	0.70	0.00	0.00	0.70	2.55	3.64	4.34
2014	185	2	0.70	0.00	0.00	0.70	2.55	3.64	4.34

Water consumption per chicken estimated at 6.0 gal/100 chickens

Estimated Pumping by Albor Properties

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	0	0	0.00	0.00	0.00	0.00	0.00
2005	0	0	0.00	0.00	0.00	0.00	0.00
2006	122	2	0.70	2.60	8.76	12.52	13.22
2007	122	1	0.35	0.40	1.39	1.98	2.33
2008	122	1	0.35	0.40	1.40	1.99	2.34
2009	122	1	0.35	0.40	1.34	1.92	2.27
2010	122	1	0.35	0.40	1.24	1.77	2.12
2011	122	1	0.35	0.40	1.39	1.98	2.33
2012	122	1	0.35	0.40	1.46	2.08	2.43
2013	122	1	0.35	0.40	1.43	2.04	2.39
2014	122	1	0.35	0.40	1.49	2.13	2.48

Estimated Pumping by Nikodinov

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	0	0	0.00	0.00	0.00	0.00	0.00
2005	0	0	0.00	0.00	0.00	0.00	0.00
2006	10	1	0.35	0.08	0.27	0.39	0.74
2007	10	1	0.35	0.08	0.28	0.40	0.75
2008	10	1	0.35	0.08	0.28	0.40	0.75
2009	10	1	0.35	0.08	0.27	0.38	0.73
2010	10	1	0.35	0.08	0.25	0.35	0.70
2011	10	1	0.35	0.08	0.28	0.40	0.75
2012	10	1	0.35	0.08	0.29	0.42	0.77
2013	10	1	0.35	0.08	0.29	0.41	0.76
2014	10	1	0.35	0.08	0.30	0.43	0.78

Estimated Pumping by McAmis

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	0	0	0.00	0.00	0.00	0.00	0.00
2005	0	0	0.00	0.00	0.00	0.00	0.00
2006	0.9	1	0.35	0.04	0.13	0.19	0.54
2007	0.9	1	0.35	0.04	0.14	0.20	0.55
2008	0.9	1	0.35	0.04	0.14	0.20	0.55
2009	0.9	1	0.35	0.04	0.13	0.19	0.54
2010	0.9	1	0.35	0.04	0.12	0.18	0.53
2011	0.9	1	0.35	0.04	0.14	0.20	0.55
2012	0.9	1	0.35	0.04	0.15	0.21	0.56
2013	0.9	1	0.35	0.04	0.14	0.20	0.55
2014	0.9	1	0.35	0.04	0.15	0.21	0.56

Estimated Pumping by Aldama

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	0	0	0.00	0.00	0.00	0.00	0.00
2005	0	0	0.00	0.00	0.00	0.00	0.00
2006	1.4	1	0.35	0.10	0.34	0.48	0.83
2007	1.4	1	0.35	0.10	0.35	0.49	0.84
2008	1.4	1	0.35	0.10	0.35	0.50	0.85
2009	1.4	1	0.35	0.10	0.34	0.48	0.83
2010	1.4	1	0.35	0.10	0.31	0.44	0.79
2011	1.4	1	0.35	0.10	0.35	0.50	0.85
2012	1.4	1	0.35	0.10	0.36	0.52	0.87
2013	1.4	1	0.35	0.10	0.36	0.51	0.86
2014	1.4	1	0.35	0.10	0.37	0.53	0.88

Estimated Pumping by Gutierrez

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	0	0	0.00	0.00	0.00	0.00	0.00
2005	0	0	0.00	0.00	0.00	0.00	0.00
2006	2	2	0.70	0.14	0.47	0.67	1.37
2007	2	2	0.70	0.14	0.48	0.69	1.39
2008	2	2	0.70	0.14	0.49	0.70	1.40
2009	2	2	0.70	0.14	0.47	0.67	1.37
2010	2	2	0.70	0.14	0.43	0.62	1.32
2011	2	2	0.70	0.14	0.49	0.69	1.39
2012	2	2	0.70	0.14	0.51	0.73	1.43
2013	2	2	0.70	0.14	0.50	0.71	1.41
2014	2	2	0.70	0.14	0.52	0.75	1.45

Estimated Pumping by Damont

Year	Parcel Size (acres)	No. DU	Indoor Water Use (ac-ft/yr)	Irrigated Acres	Irrigation Requirement (ac-ft/yr)	Outdoor Water Use (ac-ft/yr)	Total Use (ac-ft/yr)
2004	0	0	0.00	0.00	0.00	0.00	0.00
2005	0	0	0.00	0.00	0.00	0.00	0.00
2006	0.5	1	0.35	0.00	0.00	0.00	0.35
2007	0.5	1	0.35	0.00	0.00	0.00	0.35
2008	0.5	1	0.35	0.00	0.00	0.00	0.35
2009	0.5	1	0.35	0.00	0.00	0.00	0.35
2010	0.5	1	0.35	0.00	0.00	0.00	0.35
2011	0.5	1	0.35	0.00	0.00	0.00	0.35
2012	0.5	1	0.35	0.00	0.00	0.00	0.35
2013	0.5	1	0.35	0.00	0.00	0.00	0.35
2014	0.5	1	0.35	0.00	0.00	0.00	0.35

Appendix D
Water Quality Analysis Summary (2010-2014)
for Production Wells

**Beaumont Basin Watermaster
Water Quality Analysis Summary (2009-2013) for Drinking Water Production Wells**

Analyte	Units	Federal Primary MCL	Federal Secondary MCL	California Primary MCL	California Secondary MCL	Public Health Goal	DLR	Wells Sampled	Wells Exceeding CA MCLs	Average Value	Maximum Value
Color, Apparent (Unfiltered)	UNITS		15		15			33	0	3	5
Odor Threshold @ 60 C	TON		3		3		1	33	0	1	1
Specific Conductance (E.C.)	umhos				900			33	0	418	730
pH, Laboratory	Std Units		8.5					33		8	8.9
Bicarbonate (as HCO3)	mg/L							33		199	280
Carbonate (as CO3)	mg/L							33		3	16
Nitrite as Nitrogen (N)	ug/L	1000		1000		1000	400	33	0	94	100
Calcium (Ca)	mg/L							33		40	55
Magnesium (Mg)	mg/L							33		13	23
Sodium (Na)	mg/L							33		26	62
Potassium (K)	mg/L							30		2	2.3
Chloride	mg/L		250		250			33	0	11	39
Sulfate (SO4)	mg/L		250		250		0.5	33	0	18	63
Fluoride (F) (Natural-Source)	mg/L	4	2	2			0.1	33	0	0	1
Arsenic	ug/L	10		10		zero	2	33	0	2	5.2
Barium (Ba)	ug/L	2000		1000		2000	100	33	0	94	100
Beryllium	ug/L	4		4		4	1	33	0	1	1
Boron	ug/L						100	1		0	0
Cadmium (Cd)	ug/L	5		5		5	1	33	0	1	1
Chromium (Total Cr)	ug/L	100		50		100	10	33	0	9	20
Copper (Cu)	ug/L		1000		1000	1300	50	33	0	47	62
Iron (Fe)	ug/L		300		300		100	33	0	94	120
Lead (Pb)	ug/L					zero	5	33	0	5	6.5
Manganese (Mn)	ug/L		50		50		20	33	0	19	20
Thallium	ug/L	2		2		0.5	1	33	0	1	1
Nickel	ug/L			100			10	33	0	9	14
Silver (Ag)	ug/L		100		100		10	33	0	9	10
Vanadium	ug/L						3	1		51	84
Zinc (Zn)	ug/L		5000		5000		50	33	0	51	250
Antimony	ug/L	6		6		6	6	33	0	6	6
Aluminum (Al)	ug/L		200	1000	200		50	33	0	47	50
Selenium (Se)	ug/L	50		50		50	5	33	0	5	5
Cyanide	ug/L	200		150			100	30	0	88	100
Gross Alpha	pCi/L	15		15			3	10	0	1	2.55
Uranium	pCi/L	30		20		zero	1	4	0	1	1.72
Carbon Tetrachloride	ug/L	5		0.5		zero	0.5	31	0	0	0.5
Toluene	ug/L	1000		150		1000	0.5	31	0	0	0.5
Benzene	ug/L	5		1		zero	0.5	31	0	0	0.5
Benzo(a)pyrene	ug/L	0.2		0.2		zero	0.1	15	0	0	0.1
Monochlorobenzene (Chlorobenzene)	ug/L	100		70		100	0.5	31	0	0	0.5
Ethyl Benzene	ug/L	700		300			0.5	31	0	0	0.5

Beaumont Basin Watermaster
Water Quality Analysis Summary (2009-2013) for Drinking Water Production Wells

Analyte	Units	Federal Primary MCL	Federal Secondary MCL	California Primary MCL	California Secondary MCL	Public Health Goal	DLR	Wells Sampled	Wells Exceeding CA MCLs	Average Value	Maximum Value
Hexachlorocyclopentadiene	µg/L	50		50		50	1	6	0	1	1
Dichloromethane (Methylene Chloride)	µg/L	5		5			0.5	31	0	0	0.5
Tetrachloroethylene (PCE)	µg/L	5		5		zero	0.5	31	0	0	0.5
Trichlorofluoromethane (FREON 11)	µg/L			150			5	31	0	5	5
1,1-Dichloroethane (1,1-DCA)	µg/L			5			0.5	31	0	0	0.5
1,1-Dichloroethylene (1,1-DCE)	µg/L	7		6			0.5	31	0	0	0.5
1,1,1-Trichloroethane (1,1,1-TCA)	µg/L	200		200		200	0.5	31	0	0	0.5
1,1,2-Trichloroethane (1,1,2-TCA)	µg/L	5		5		3	0.5	31	0	0	0.5
1,1,2,2-Tetrachloroethane	µg/L			1			0.5	31	0	0	0.5
1,2-Dichloroethane (1,2-DCA)	µg/L	5		0.5			0.5	31	0	0	0.5
1,2-Dichlorobenzene (o-DCB)	µg/L	600		600			0.5	31	0	0	0.5
1,2-Dichloropropane	µg/L	5		5			0.5	31	0	0	0.5
trans-1,2-Dichloroethylene (t-1,2-DCE)	µg/L	100		10			0.5	31	0	0	0.5
1,2,4-Trichlorobenzene	µg/L	70		5	70		0.5	31	0	0	0.5
1,3-Dichloropropene, Total	µg/L			0.5			0.5	31	0	0	0.5
1,4-Dichlorobenzene (p-DCB)	µg/L	75		5			0.5	31	0	0	0.5
Dichlorodifluoromethane (Freon 12)	µg/L						0.5	30		1	0.5
2,3,7,8-TCDD (Dioxin)	pg/L	0.00003		30			5	4	0	0	0
Naphthalene	µg/L						0.5	30		1	0.5
Foaming Agents (MBAS)	mg/L		0.5		0.5			33	0	0	0.14
Dalapon	µg/L	200		200			10	6	0	10	10
Propachlor	µg/L						0.5	6	6	1	0.5
Bentazon (BASAGRAN)	µg/L			18			2	6	0	2	2
Dibromochloropropane (DBCP)	µg/L	0.2		0.2			0.01	27	0	0	0.01
Oxamyl (Vydate)	µg/L	200		50		200	20	4	0	0	0
Endothall	µg/L	100		100			45	4	0	45	45
Pentachlorophenol (PCP)	µg/L	1		1		zero	0.2	6	0	0	0.2
Atrazine (AATREX)	µg/L	3		1		3	0.5	27	0	1	0.5
2,4,5-TP (SILVEX)	µg/L	50		50		50	1	6	0	1	1
Simazine (PRINCEP)	µg/L	4		4		4	1	27	0	1	1
Diethylhexylphthalate (DEHP)	µg/L	6		4		zero	3	15	0	3	3
Vinyl Chloride (VC)	µg/L	2		0.5		zero	0.5	31	0	0	0.5
Trichloroethylene (TCE)	µg/L	5		5		zero	0.5	31	0	0	0.5
Lindane (gamma-BHC)	µg/L	0.2		0.2		0.2	0.2	6	0	0	0.2
Chlordane	µg/L	2		0.1		zero	0.1	6	0	0	0.1
Endrin	µg/L	2		2		zero	0.1	6	0	0	0.1
Toxaphene	µg/L	3		3		zero	1	6	0	1	1
Heptachlor	µg/L	0.4		0.01		zero	0.01	6	0	0	0.01
Heptachlor Epoxide	µg/L	0.2		0.01			0.01	6	0	0	0.01
Methoxychlor	µg/L	40		30		40	10	6	0	10	10
Polychlorinated Biphenyls, Total, as DCB	µg/L	0.5		0.5		zero	0.5	6	0	1	0.5

**Beaumont Basin Watermaster
Water Quality Analysis Summary (2009-2013) for Drinking Water Production Wells**

Analyte	Units	Federal Primary MCL	Federal Secondary MCL	California Primary MCL	California Secondary MCL	Public Health Goal	DLR	Wells Sampled	Wells Exceeding CA MCLs	Average Value	Maximum Value
Hexachlorobenzene	µg/L	1		1		zero	0.5	6	0	1	0.5
Picloram	µg/L	500		500		500	1	6	0	1	1
2,4-D	µg/L	70		70			10	6	0	10	10
Methyl tert-Butyl Ether (MTBE)	µg/L			13	5		3	31	0	3	3
Total Filterable Residue @ 180 C (TDS)	mg/L		500		500			33	0	237	380
Mercury (Hg)	µg/L	2		2		2	1	33	0	1	1
cis-1,2-Dichloroethylene (c-1,2-DCE)	µg/L	70		6			0.5	31	0	0	0.5
Styrene	µg/L	100		100		100	0.5	31	0	0	0.5
1,2,4-Trimethylbenzene	µg/L							30		1	0.5
Isopropylbenzene (Cumene)	µg/L						0.5	30		1	0.5
n-Propylbenzene	µg/L						0.5	30		1	0.5
1,3,5-Trimethylbenzene	µg/L						0.5	30		1	0.5
sec-Butylbenzene	µg/L						0.5	30		1	0.5
tert-Butylbenzene	µg/L						0.5	30		1	0.5
Ethylene Dibromide (EDB)	µg/L	0.05		0.05			0.02	27	0	0	0.02
Alachlor (ALANEX)	µg/L	2		2		zero	1	13	0	1	1
Diquat	µg/L	20		20			4	4	0	0	0
Glyphosate	µg/L	700		700			25	4	0	0	0
Dinoseb (DNBP)	µg/L	7		7			2	6	0	2	2
Carbofuran (FURADAN)	µg/L	40		18		40	5	4	0	0	0
Total Xylenes (m, p, & o)	µg/L	10000		1750		10000		31	0	0	0.5
Methyl Isobutyl Ketone (MIBK)	µg/L						5	30		5	5
Trichlorofluoroethane (FREON 113)	µg/L			1200			10	31	0	10	10
Asbestos	MFL	7		7		7 MFL	0.2	4	0	0	0.2
Turbidity, Laboratory	NTU		5		5			28	0	0	0.96
Molinate (ORDRAM)	µg/L			20			2	8	0	2	2
Thiobencarb (BOLERO)	µg/L			70	1		1	12	0	1	1
2-Chlorotoluene	µg/L						0.5	30		1	0.5
4-Chlorotoluene	µg/L						0.5	30		1	0.5
n-Butylbenzene	µg/L						0.5	30		1	0.5
Di(2-ethylhexyl) Adipate	µg/L	400		400			5	15	0	5	5
Perchlorate	µg/L			6			4	33	0	4	4