


FOR PERMANENT PAVING REQUIREMENTS
REFER TO STANDARD SPECIFICATIONS FOR
THE CITY OR COUNTY OF JURISDICTION

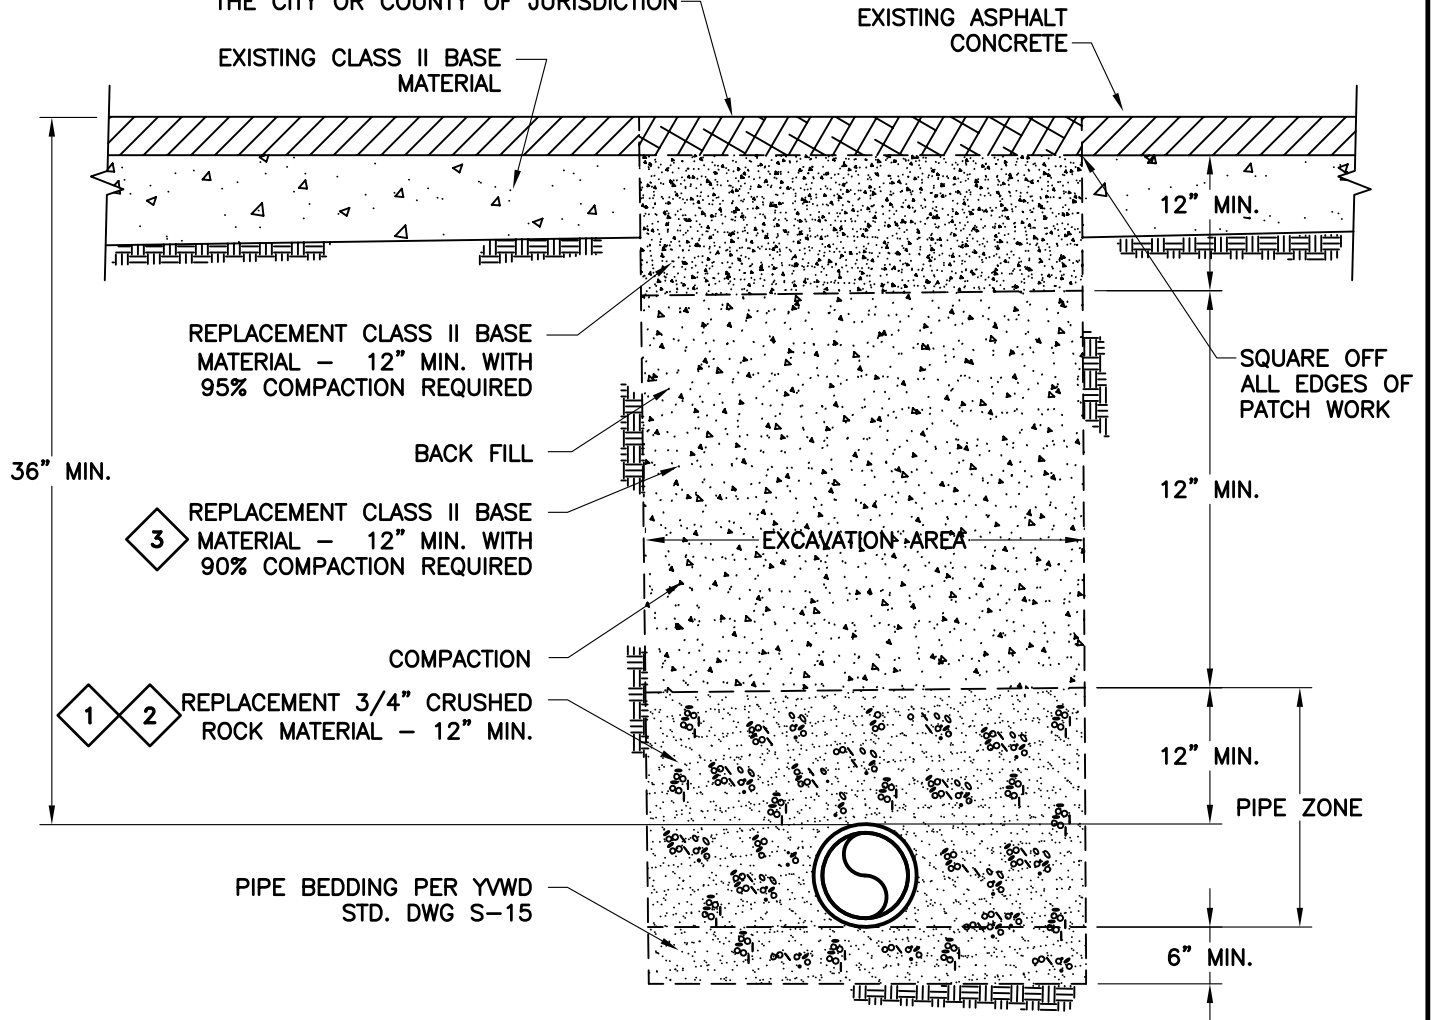

NOTES:

1. 3/4" CRUSHED ROCK MATERIAL SHALL BE USED FOR PIPE ZONE BACK FILL. REMAINING BACK FILL WILL BE IN ACCORDANCE WITH DISTRICT REQUIREMENTS.
2. WHEN DEPTH REACHES 10'-0", ALL PIPE ZONE BEDDING SHALL BE 3/4" CRUSHED ROCK WITH A MINIMUM DEPTH OF 6" BELOW PIPE UNLESS OTHERWISE NOTED ON PLANS.
3. OUTSIDE OF STREET RIGHT OF WAY, COMPACTION SHALL BE 90%.
4. ADDITIONAL ARTERIAL STREET BACKFILL MAY BE REQUIRED BY APPROPRIATE CITY JURISDICTION.
4. SEE SHEET 2 OF 2 FOR PIPE VS. TRENCH SIZES.

TRENCH REPAIR DETAIL

2016



Yucaipa Valley Water District

Approved by the Yucaipa
Valley Water District Board of
Directors on March 16, 2016 as
Resolution No. 2016-13

S-17

Sheet 1 of 2

TRENCH REPAIR—PIPE SIZE VS TRENCH SIZE		
PIPE SIZE—INCHES (INSIDE DIAMETER)	TRENCH WIDTH—INCHES	
	MINIMUM	MAXIMUM
4	20	28
6	22	32
8	24	32
10	26	36
12	30	36
14	32	42
16	34	42

TRENCH REPAIR DETAIL

2016



Yucaipa Valley Water District

Approved by the Yucaipa
Valley Water District Board of
Directors on March 16, 2016 as
Resolution No. 2016-13

S-17

Sheet 2 of 2