

IRON COVER WITH THE WORD "WATER" CAST
THEREON FOR DOMESTIC WATER LINES OR
"RECYCLED" FOR RECLAIMED WATERLINES. VALVE
LIDS MUST BE TAPERED

VALVE AND VALVE BOX INSTALLATION

2016




Yucaipa Valley Water District

Approved by the Yucaipa
Valley Water District Board of
Directors on March 16, 2016 as
Resolution No. 2016-13

W-20

Sheet 1 of 2

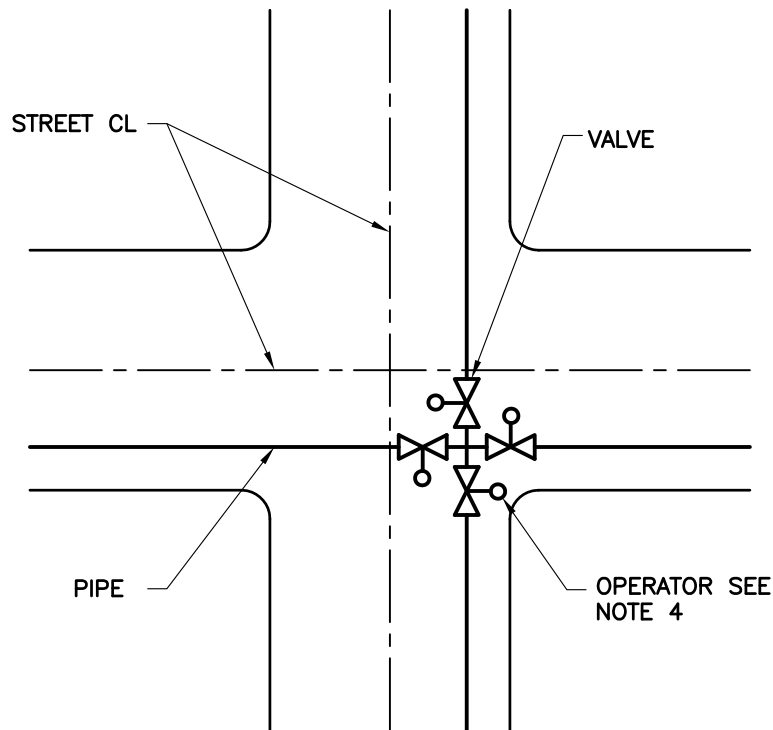

TYPICAL BUTTERFLY
VALVE OPERATOR
POSITION

NOTES:

1. PROVIDE VALVE STEM EXTENSION IF DEPTH TO VALVE NUT EXCEEDS 4 FEET. SEE YWD STD. DWG. W-21.
2. IN NEW TRACT DEVELOPMENTS EXTEND VALVE WELL PIPE 2' ABOVE GROUND ON "KEY VALVES" FOR EMERGENCY SHUTOFFS.
3. BUTTERFLY VALVE OPERATORS SHALL BE LOCATED ON THE LEFT-HAND SIDE OF THE VALVE (AT THE TEE OR CROSS), LOOKING THROUGH THE VALVE TOWARD THE PIPE END.
4. WHERE CONCRETE CROSS GUTTERS AT STREET INTERSECTIONS WILL INTERFERE WITH VALVE BOXES, THE PIPELINE SHALL BE MOVED TO A POSITION 7 FEET OFF THE CURB FACE TO CLEAR THE CROSS GUTTER.
5. VALVES TO BE LOCATED ADJACENT TO FITTINGS WHEREVER POSSIBLE.
6. VALVES BOLTED TO FITTINGS WILL NOT REQUIRE ANCHOR BLOCKS.
7. ALL GATE VALVES SHALL BE MUELLER, RESILIENT WEDGE, EPOXY COATED, FLG. X FLG. ENDS.
8. ALL BURRIED METALIC SURFACES SHALL BE PROTECTED BY AN ASPHALTIC OR BITUMINUOS COATING IN ACCORDANCE WITH AWWA C151 (ANSI A21.51).

VALVE AND VALVE BOX INSTALLATION

2016



Yucaipa Valley Water District

Approved by the Yucaipa
Valley Water District Board of
Directors on March 16, 2016 as
Resolution No. 2016-13

W-20

Sheet 2 of 2