


1 1/4" THK MILL & CAP FOR PERMANENT PAVING REQUIREMENTS REFER TO STANDARD SPECIFICATIONS FOR THE APPROPRIATE CITY OR COUNTY OF JURISDICTION

EXISTING ASPHALT CONCRETE
 SQUARE OFF ALL EDGES OF PATCH WORK.
 EXISTING CLASS II BASE MATERIAL

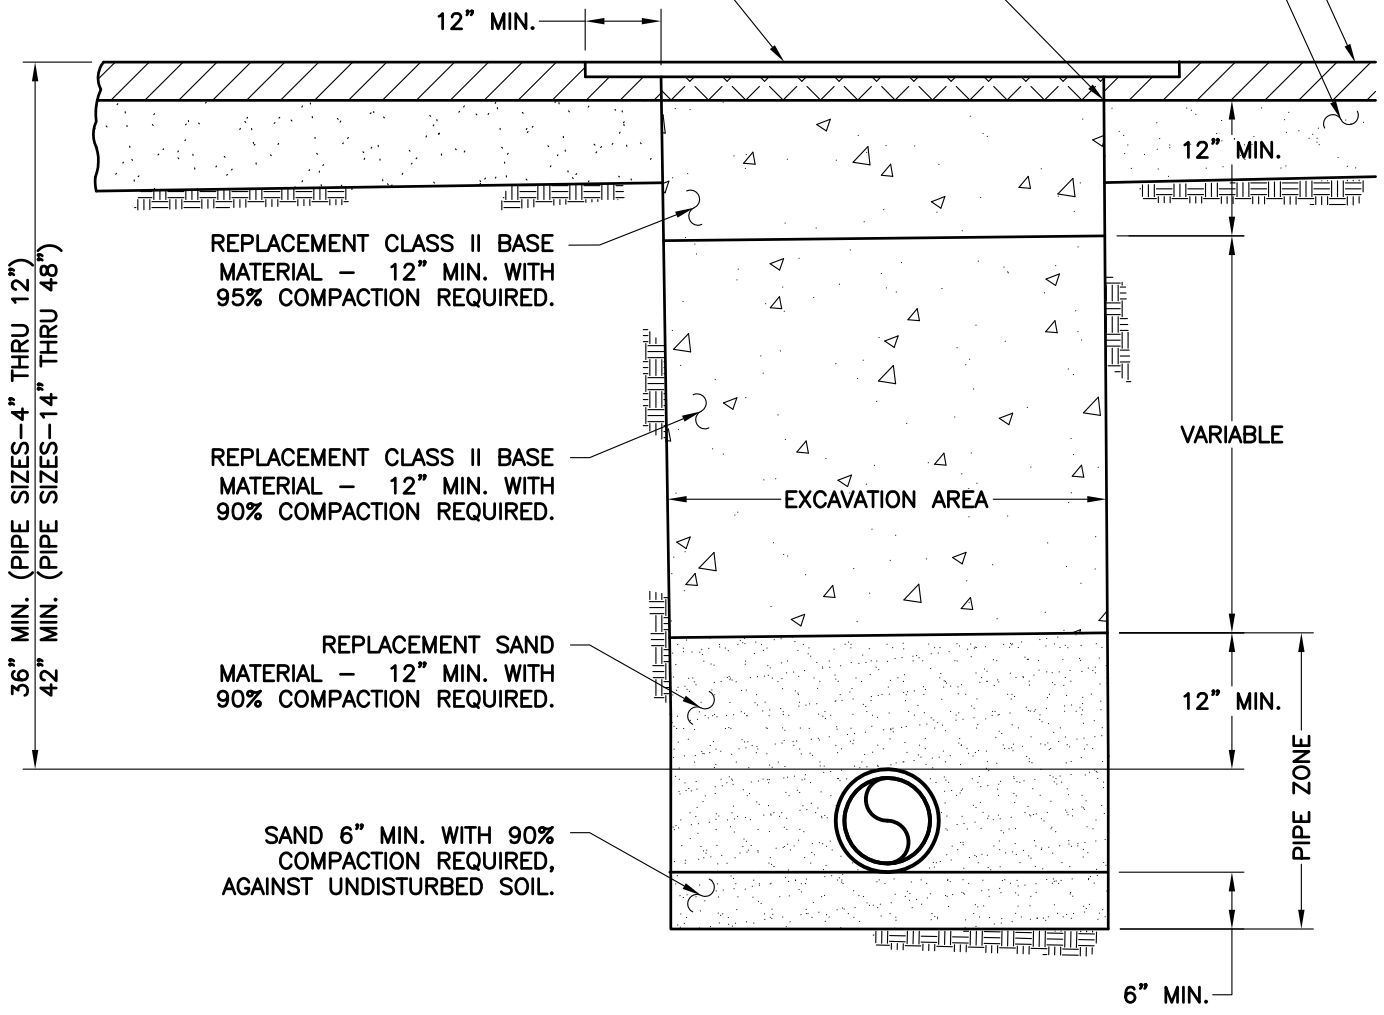

NOTES:

1. PLANT-MANUFACTURED SAND MATERIAL WITH AN SAE OF 30 OR BETTER SHALL BE USED FOR PIPE ZONE BACK FILL. REMAINING BACK FILL WILL BE IN ACCORDANCE WITH CITY/YWWD REQUIREMENTS (WHICH EVER IS GREATER)
2. BACKFILL UNDER EXISTING CURB WITHIN THE CITY OF YUCAIPA, MUST BE 2 SACK SLURRY PER CITY STANDARDS.
3. ADDITIONAL ARTERIAL STREET BACKFILL MAY BE REQUIRED BY APPROPRIATE CITY JURISDICTION.
4. SEE SHEET 2 OF 2 FOR PIPE VS. TRENCH SIZES.

TRENCH REPAIR DETAIL

2016



Yucaipa Valley Water District

Approved by the Yucaipa Valley Water District Board of Directors on March 16, 2016 as Resolution No. 2016-13

W-30

Sheet 1 of 2

TRENCH REPAIR—PIPE SIZE VS TRENCH SIZE		
PIPE SIZE—INCHES (INSIDE DIAMETER)	TRENCH WIDTH—INCHES	
	MINIMUM	MAXIMUM
4	18	24
6	20	30
8	24	32
10	24	36
12	30	36
14	32	42
16	34	42
24	38	46
29	42	46
30	46	48
36	—	—
48	—	—

TRENCH REPAIR DETAIL

2016



Yucaipa Valley Water District

Approved by the Yucaipa
Valley Water District Board of
Directors on March 16, 2016 as
Resolution No. 2016-13

W-30

Sheet 2 of 2