



Yucaipa Valley Water District

12770 Second Street • Post Office Box 730 • Yucaipa, California 92399-0730
(909) 797-5117 • Fax: (909) 797-6381 • www.yvwd.dst.ca.us

Date: January 12, 2019

Water Testing Indicates That Your Water Is Safe to Drink

SINGLETON ROAD (PARTIAL), CHANDLER AVENUE (PARTIAL)

On Thursday January 10, 2019, the Yucaipa Valley Water District shut off a water main for needed repairs. As a result some residences in the area may have experienced a temporary loss of water pressure. Due to the loss of water pressure the Yucaipa Valley Water District, as a precautionary measure, issued a Boil Water Notice. The Yucaipa Valley Water District also initiated water sampling in the affected area.

The Yucaipa Valley Water District has received the results of the water sampling and the results indicate the water is safe to drink.

The Yucaipa Valley Water District regrets any inconvenience that this may have caused.


For up to date water outage information, visit the Yucaipa Valley Water District website <http://www.yvwd.dst.ca.us>, select the “SERVICES” tab, scroll to “Public Works”, and click on “Water Outage Information”

Or Call

Water Utility contact: Mike Kostelecky, Operations Manager, Yucaipa Valley Water District
Cell: 909-208-1607 or Office: 909-790-9208 ext. 2
State Water Resources Control Board, Division of Drinking Water - Office 909-383-4328

Thank You,

Yucaipa Valley Water District

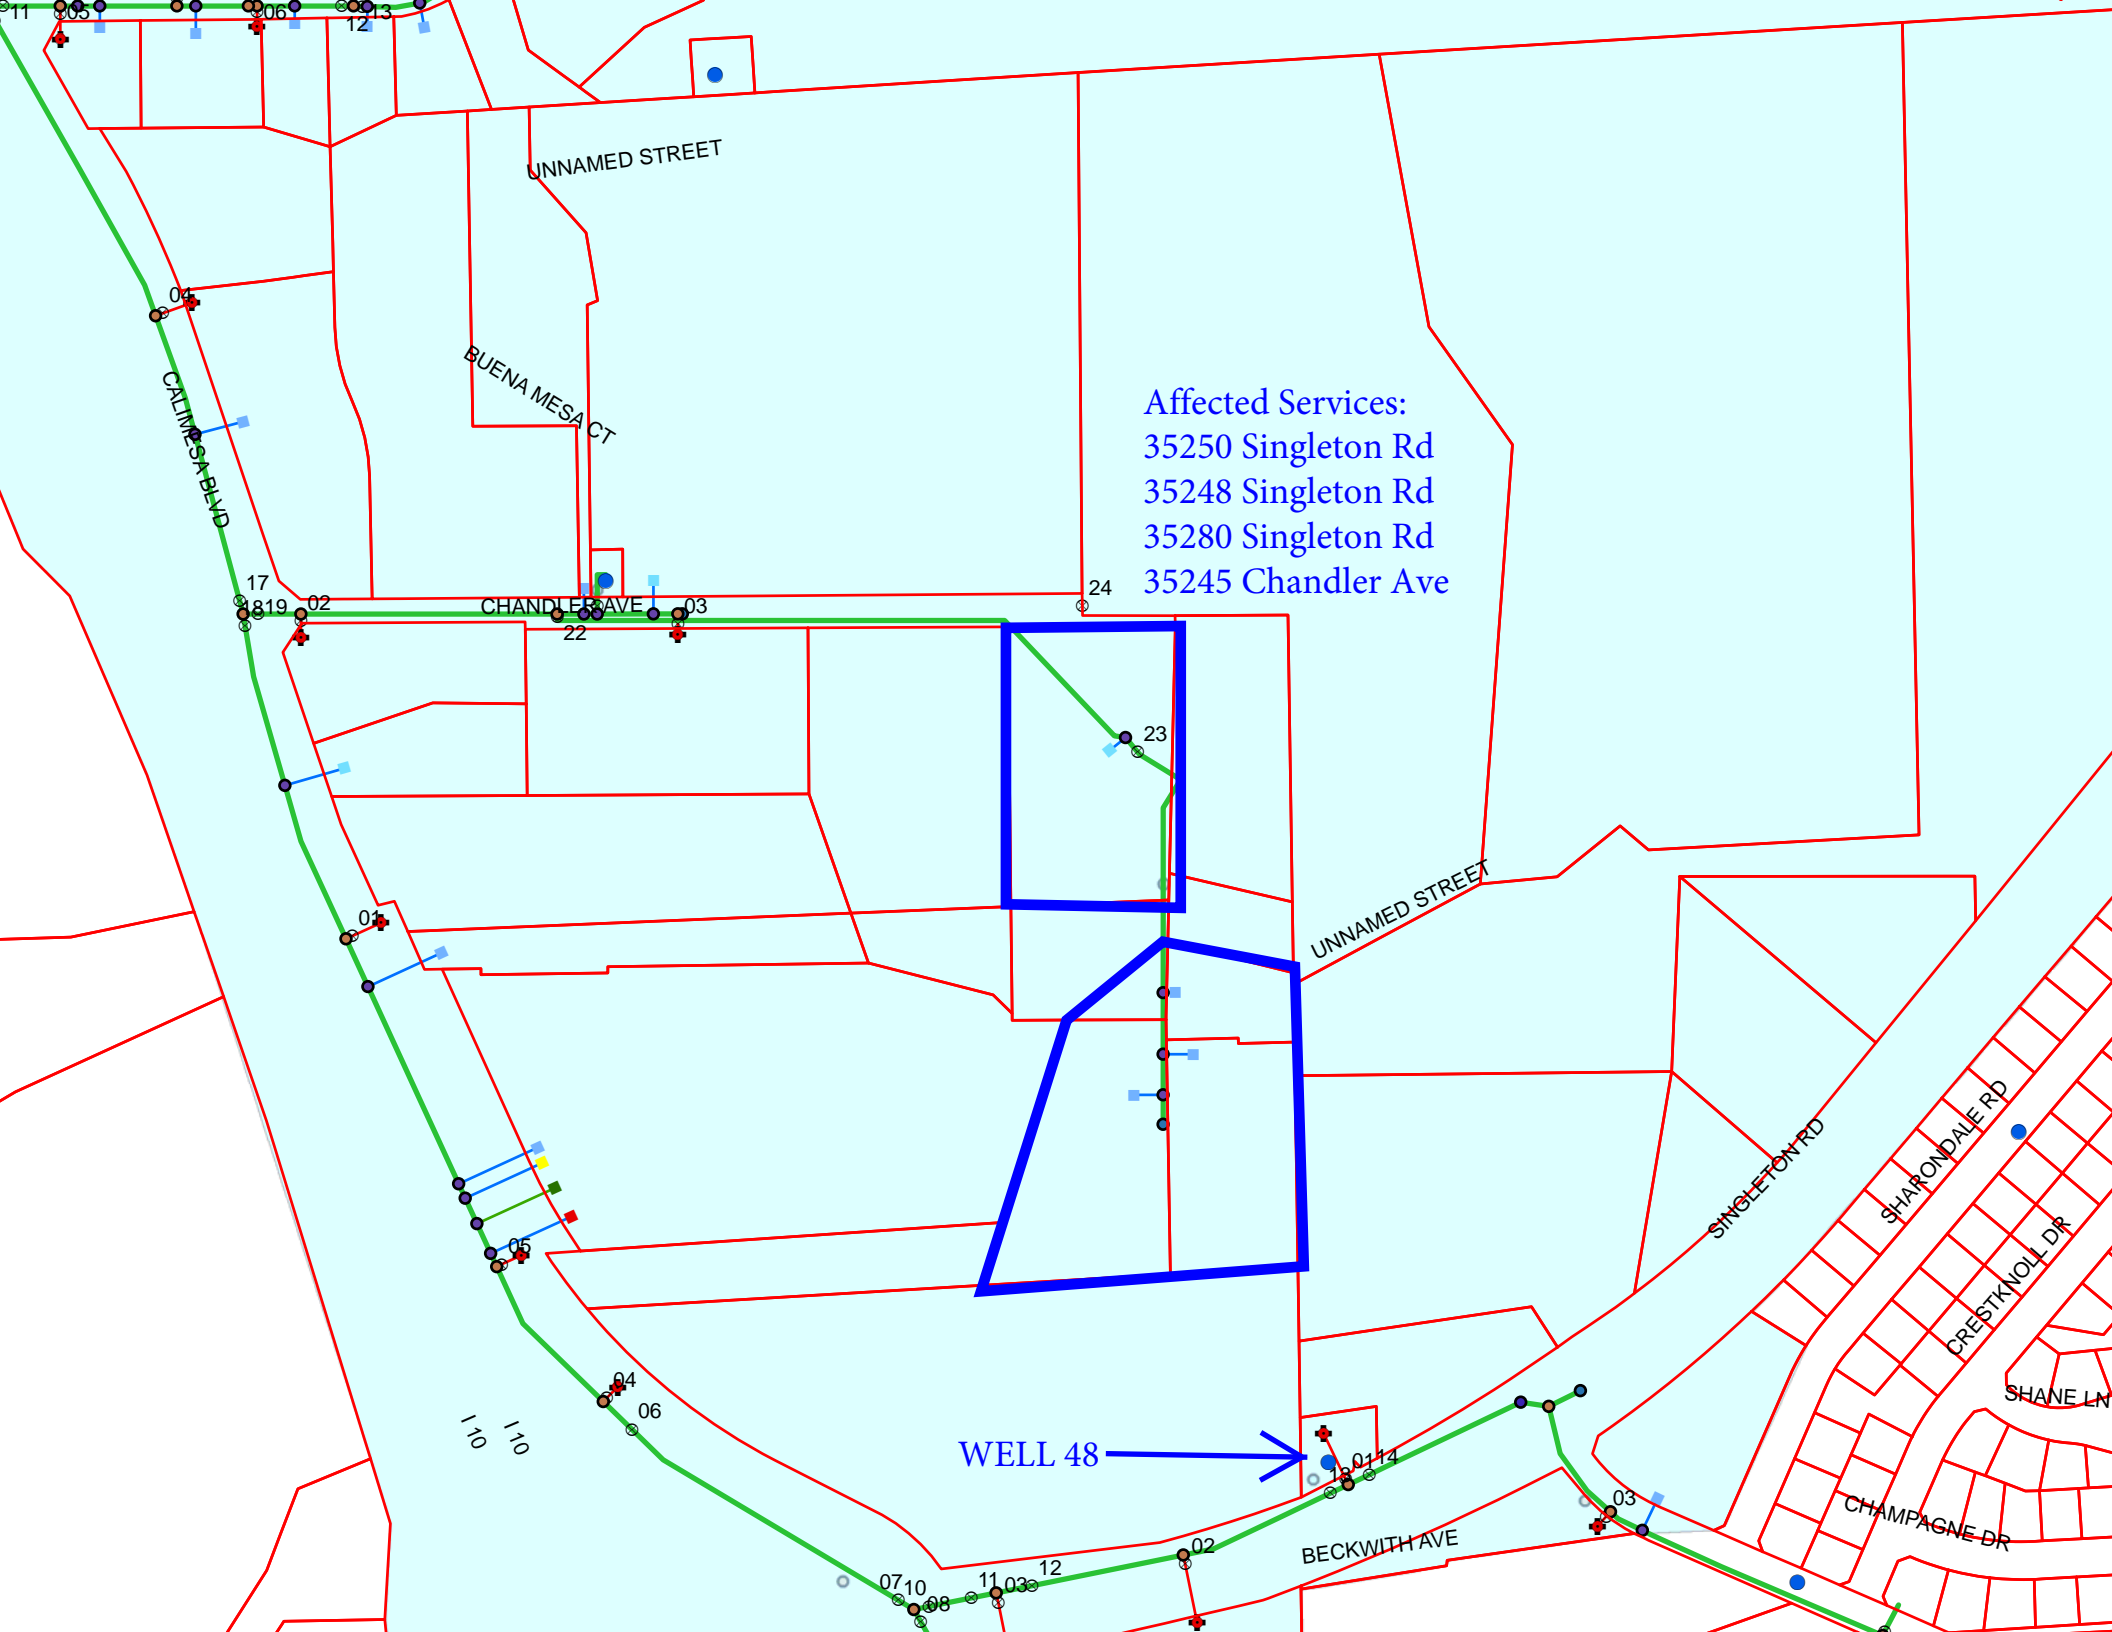

Affected Services:
35250 Singleton Rd
35248 Singleton Rd
35280 Singleton Rd
35245 Chandler Ave

WELL 48 →

UNNAMED STREET

BUENA MESA CT

CALIMESA BLVD

CHANDLER AVE

UNNAMED STREET

SINGLETON RD

SHARONDALE RD

CRESTKNOLL DR

SHANE LN

CHAMPAGNE DR

BECKWITH AVE

1/10

07/10

08

11/03

12

02

03

17

02

01/19

22

03

24

23

04

06

01/14